

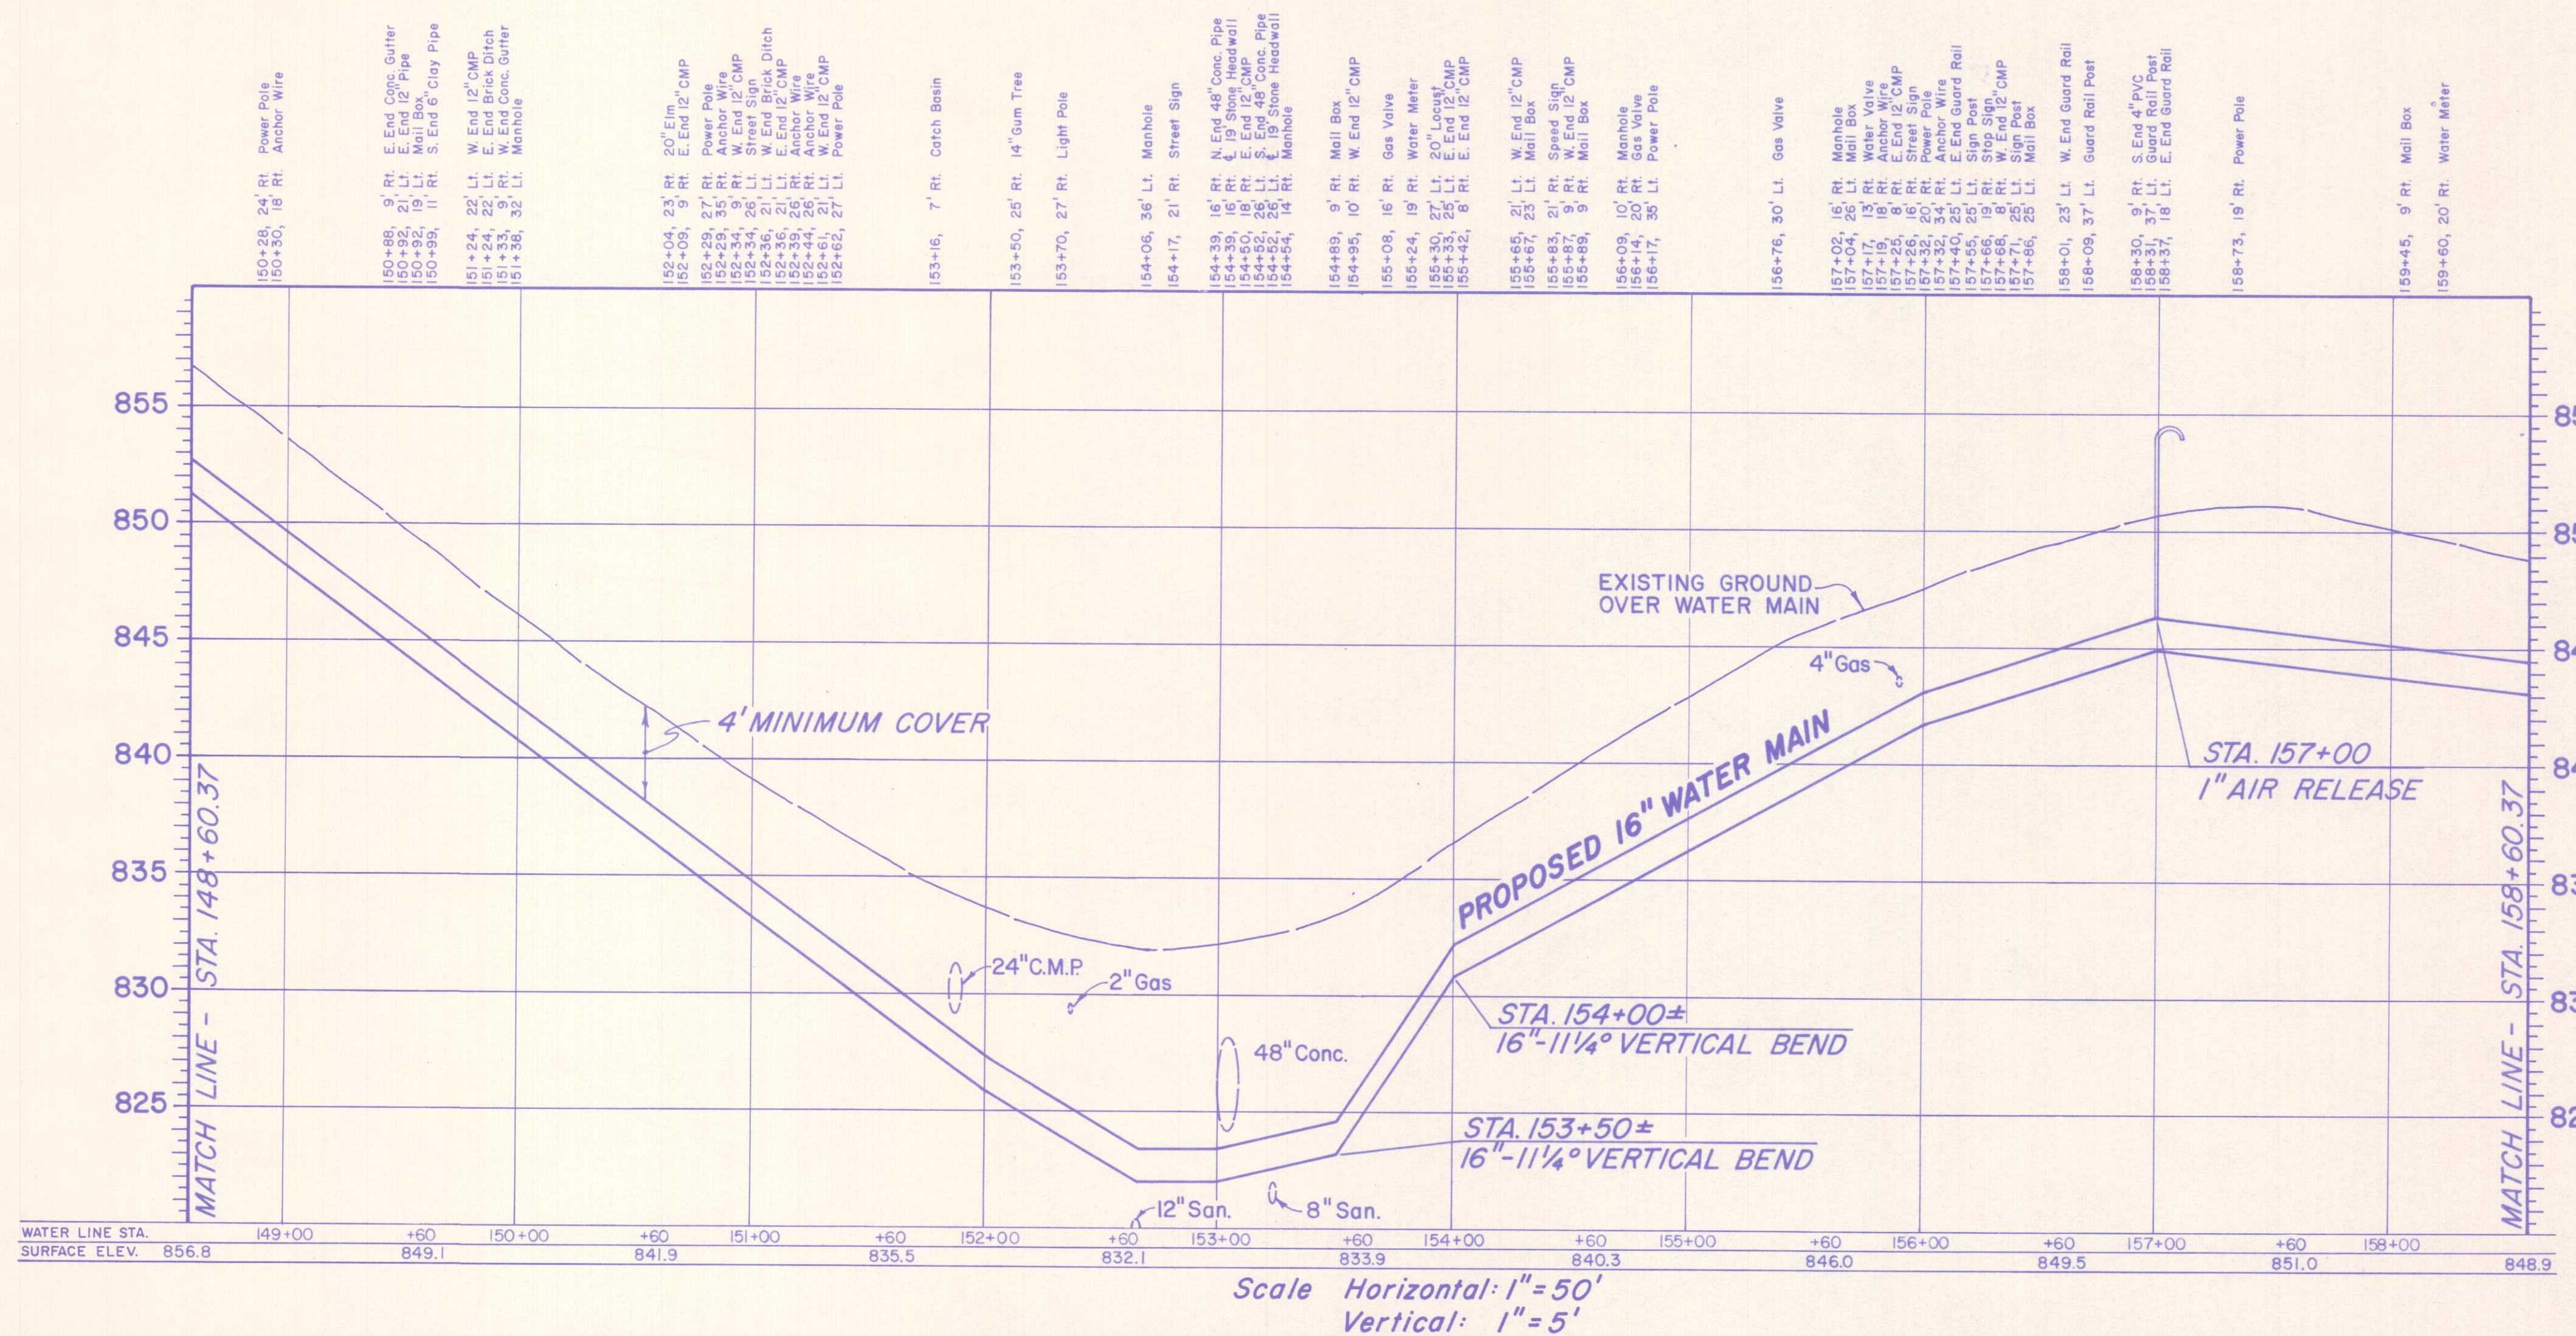
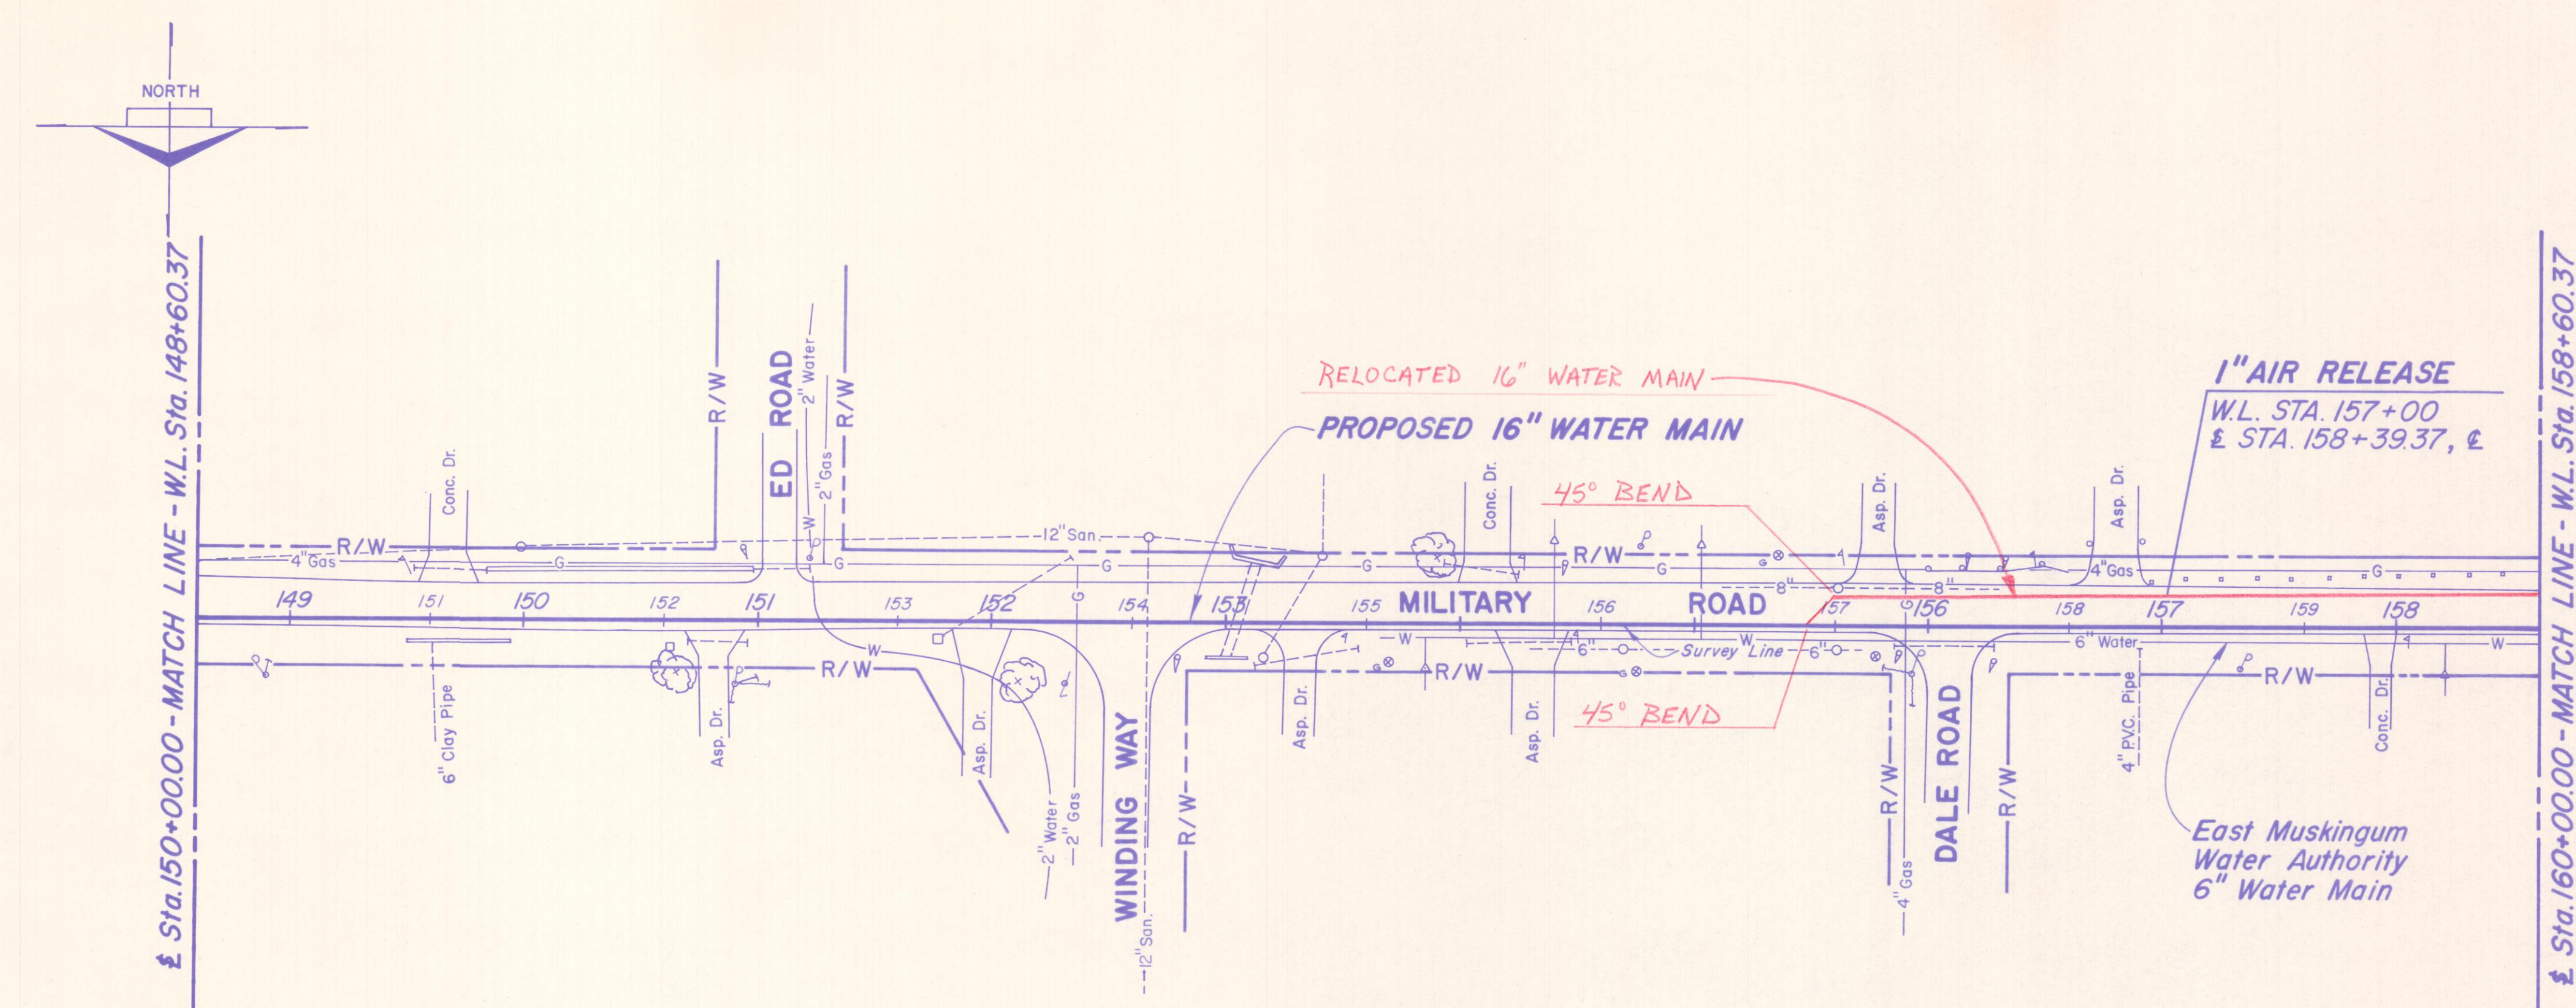


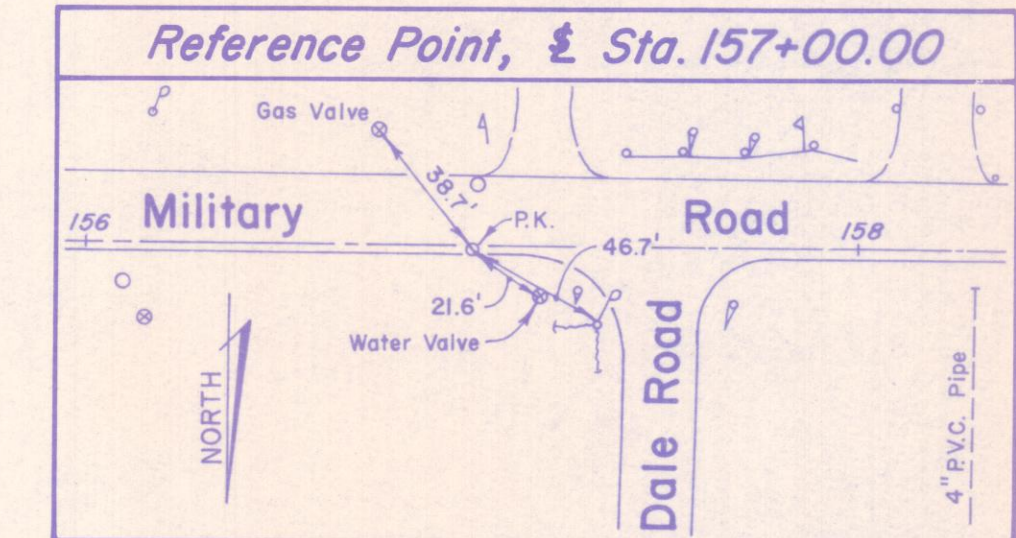

- NOTE #1**
All topographic information is located with respect to survey line stationing.
- NOTE #2**
No deflected pipe joint shall exceed 4° 30' or 17' of centerline deflection at 18 lineal feet.
- NOTE #3**
CAUTION: A telephone cable is buried North of Military Road. No actual location was confirmed.
- NOTE #4**
CAUTION: The 6" water line indicated North of the edge of pavement, Military Road, is an approximate location. No actual location was confirmed.
- NOTE #5**
Contractor shall exercise extreme caution when working in the vicinity of the East Muskingum Water Authority 6" water main.
- BENCH MARK-**
Railroad spike in power pole #OP 588 D4-150 at the intersection of Military Road and Winding Way.
Elev. 864.54

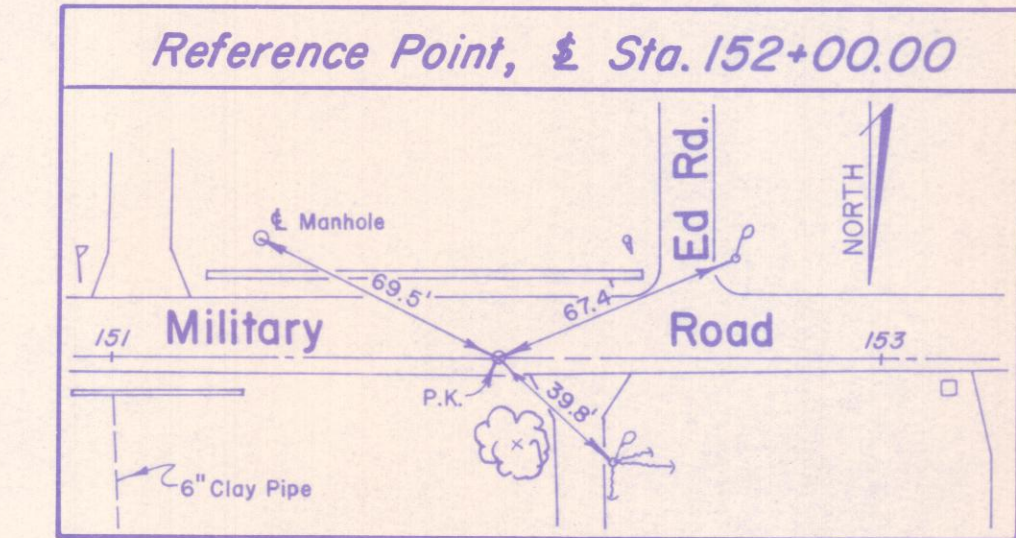

JOHN E. FOSTER AND ASSOCIATES, INC.
555 Buttlers Avenue, Columbus, Ohio 43215

CITY OF ZANESVILLE, OHIO
CENTRAL LINDEN TAYLOR
WATER MAIN
16" WATER MAIN
MILITARY ROAD
Sta. 148+60.37 to Sta. 158+60.37

DESIGNED	DRAWN	TRACED	CHECKED	REVIEWED	DATE	REVISED
D.P.K.	W.E.H.	W.E.H.	E.L.F.	J.E.F.	6-10-88	