




NOTE:
The indicated existing pipe and fittings layout is shown from data gleaned from water atlas sheets. No field confirmation was done.

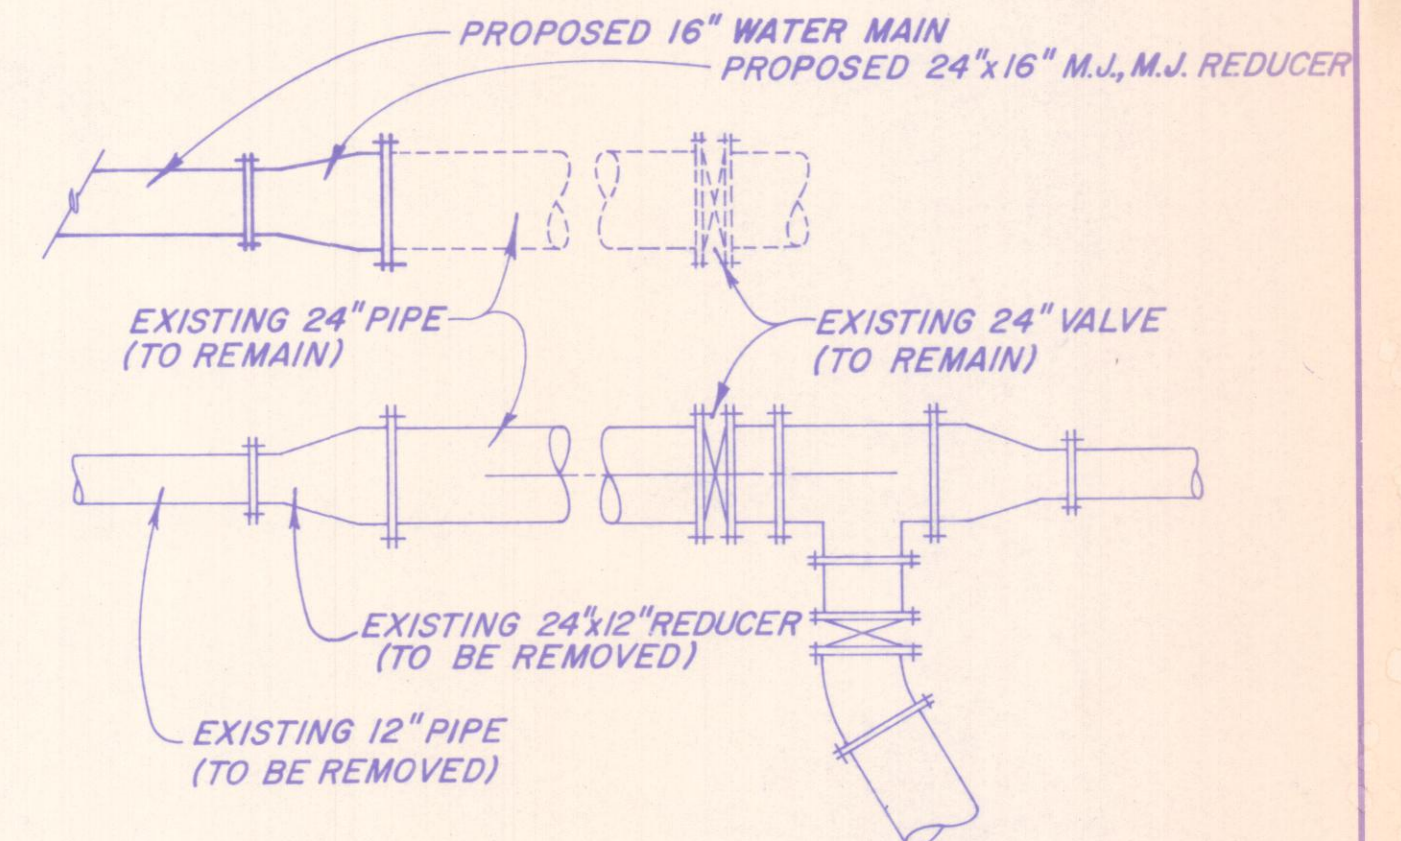

The Contractor shall complete the proposed 16" water main connection by removing all existing pipe and fittings from the existing 24" pipe. The proposed pipe and fittings shall be installed as per this detail. All pipe and fittings removed during this connection shall be delivered to the City of Zanesville, Department of Water.



DETAIL "V"

CONTRACTOR TO FIELD LOCATE EXISTING WATER MAIN PRIOR TO ANY CONSTRUCTION BEYOND STA. 177+00
W.L. STA. 177+80±
STA. 179+20±, 4' LT.

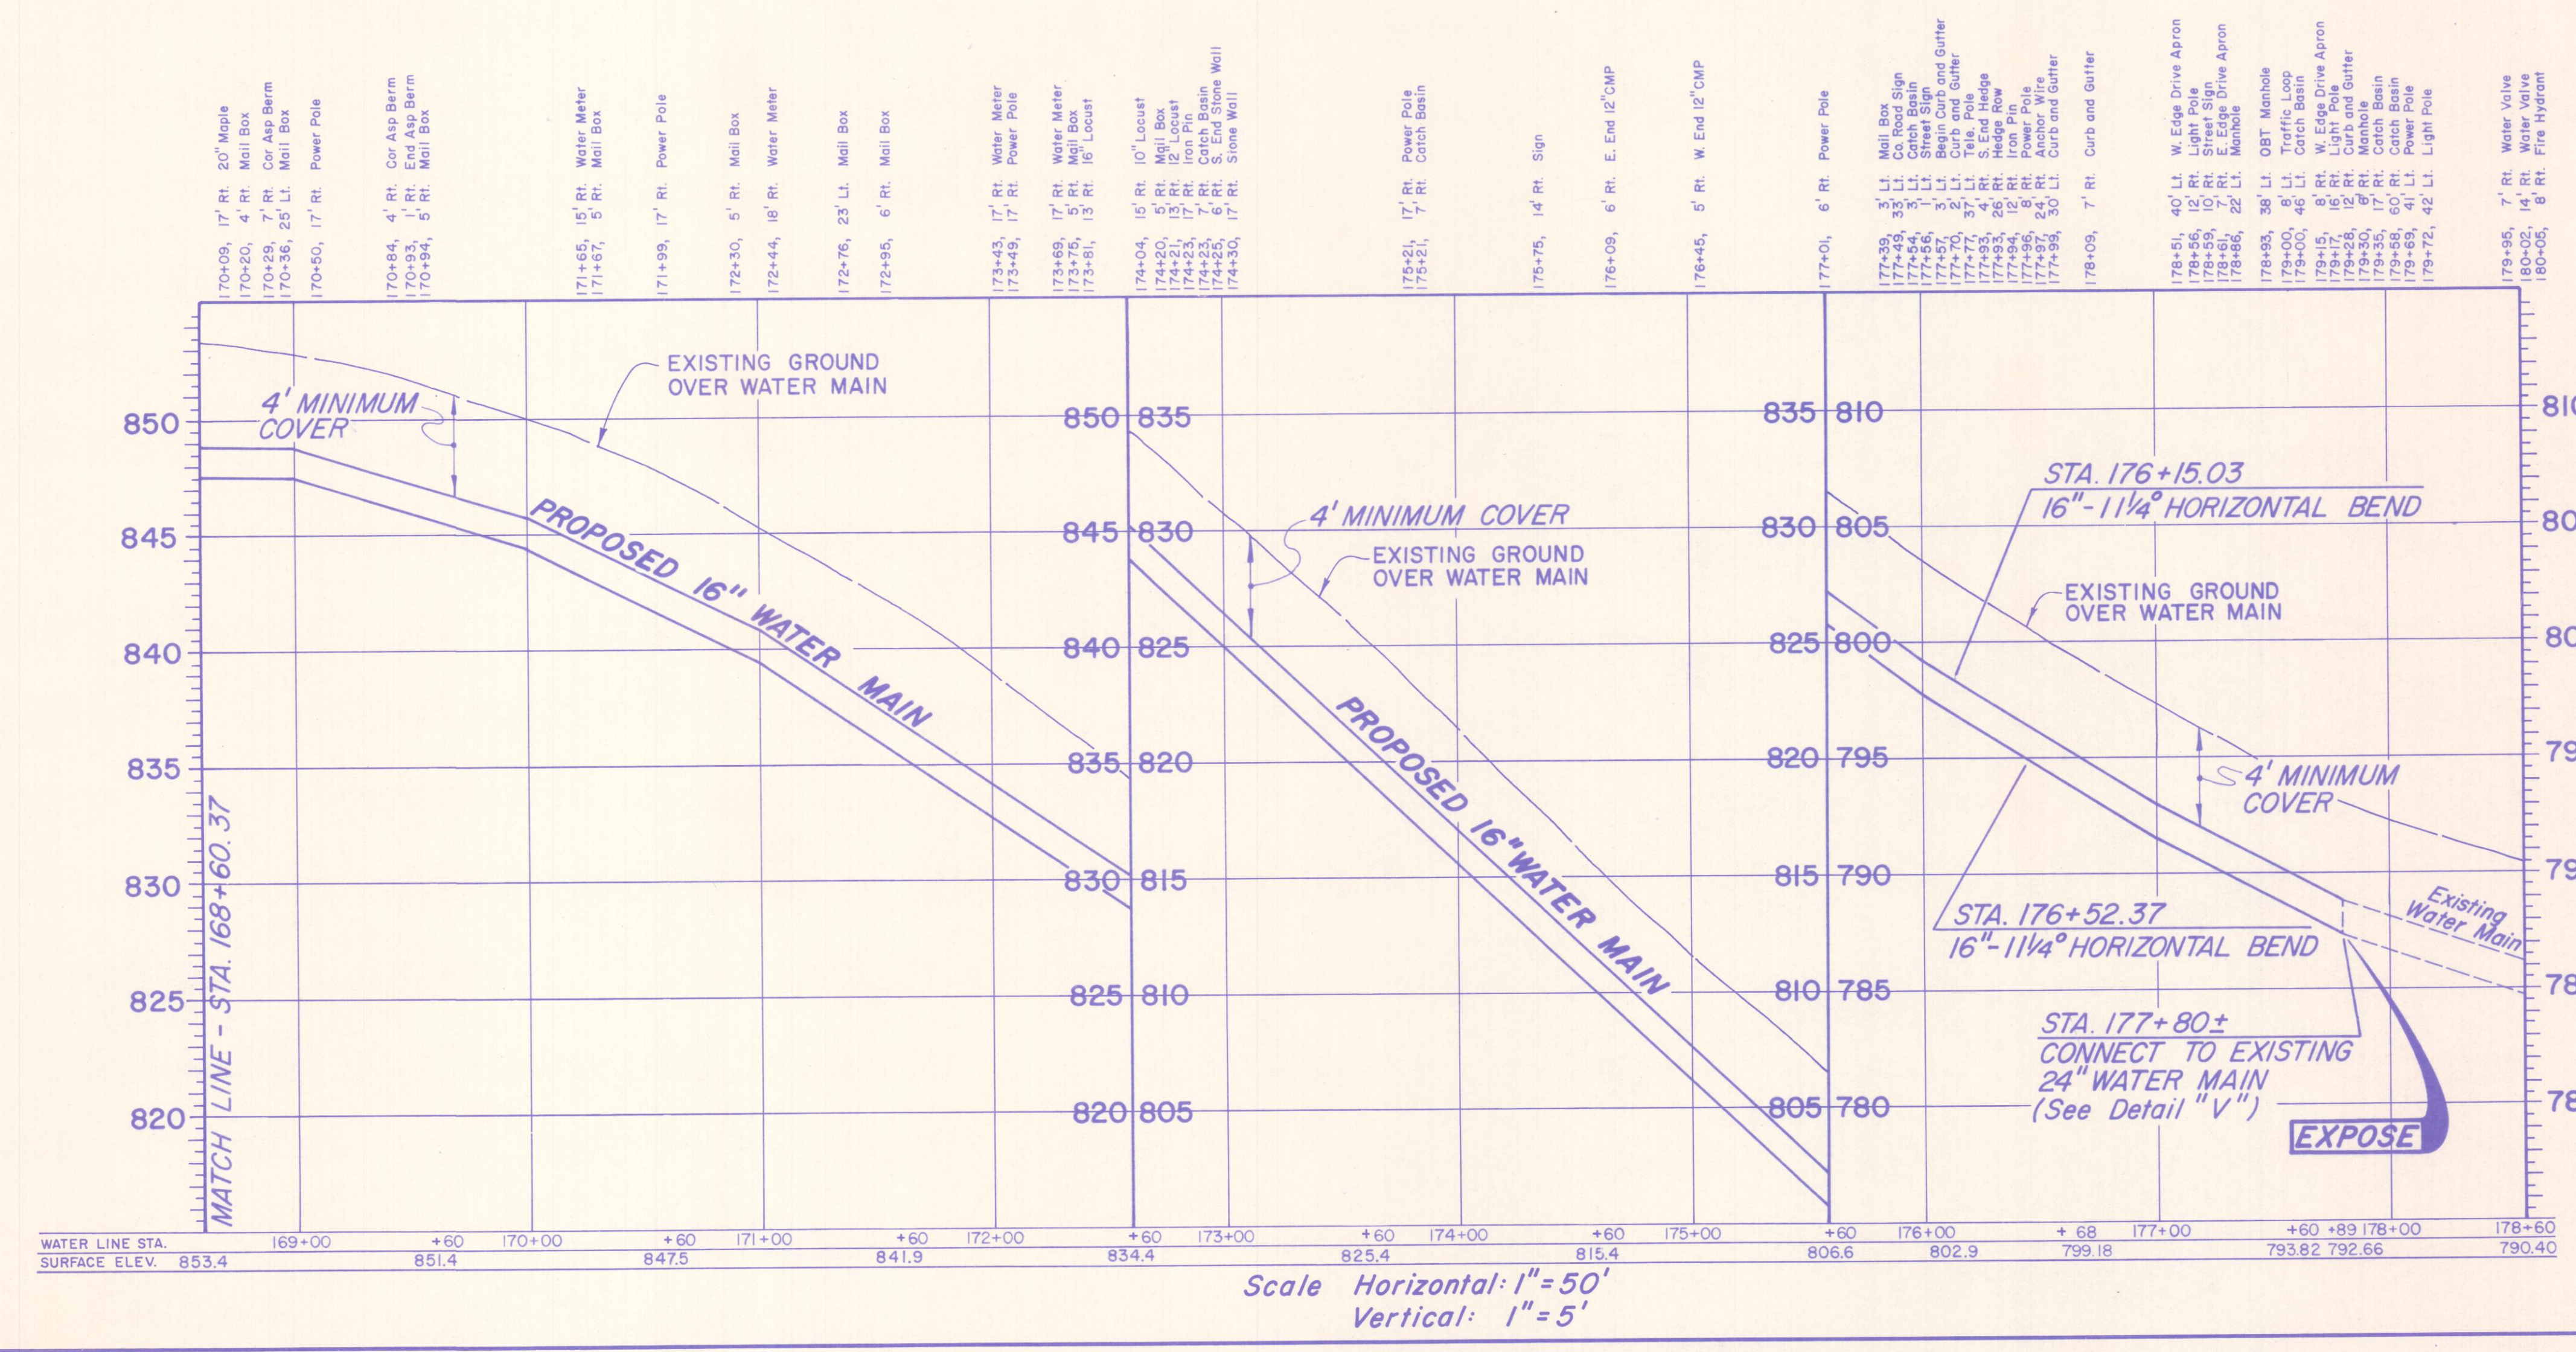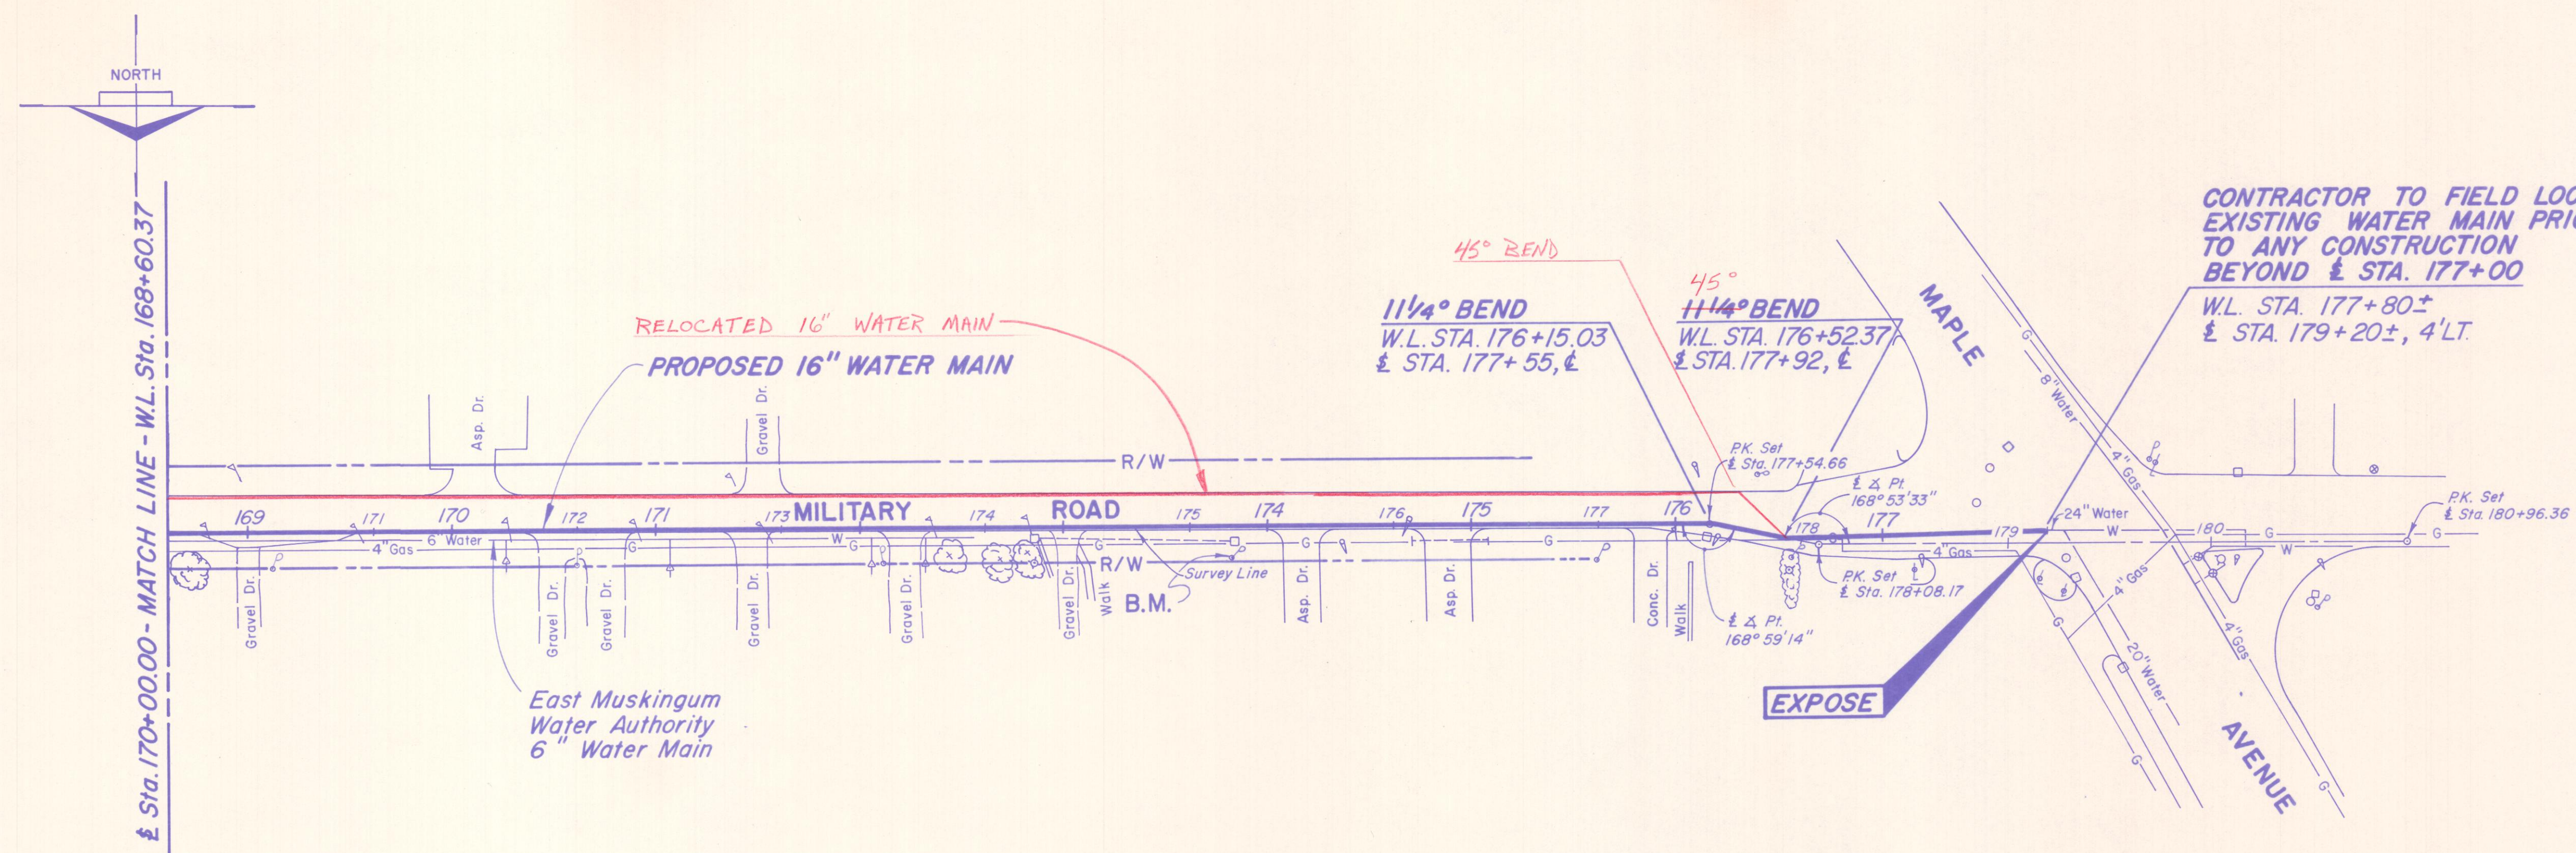

- NOTE #1**
All topographic information is located with respect to survey line stationing.
- NOTE #2**
No deflected pipe joint shall exceed 4° 30' or 17' of centerline deflection at 18 lineal feet.
- NOTE #3**
CAUTION: A telephone cable is buried North of Military Road. No actual location was confirmed.
- NOTE #4**
CAUTION: The 6" water line indicated North of the edge of pavement, Military Road, is an approximate location. No actual location was confirmed.
- NOTE #5**
Contractor shall exercise extreme caution when working in the vicinity of the East Muskingum Water Authority 6" water main.

- BENCH MARK -
Railroad spike in power pole right of Sta. 175+20, Military Road.
Elev. 826.93

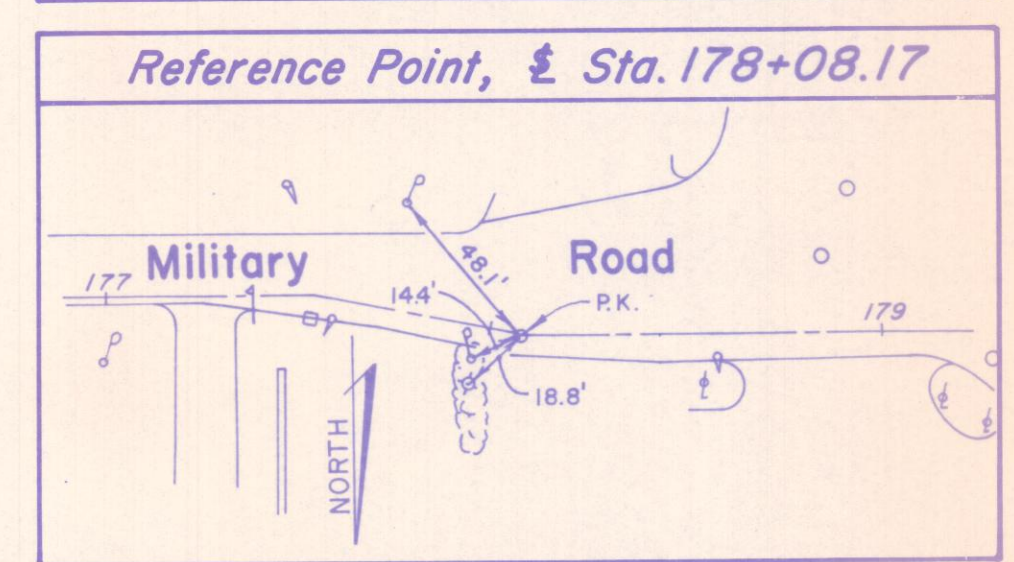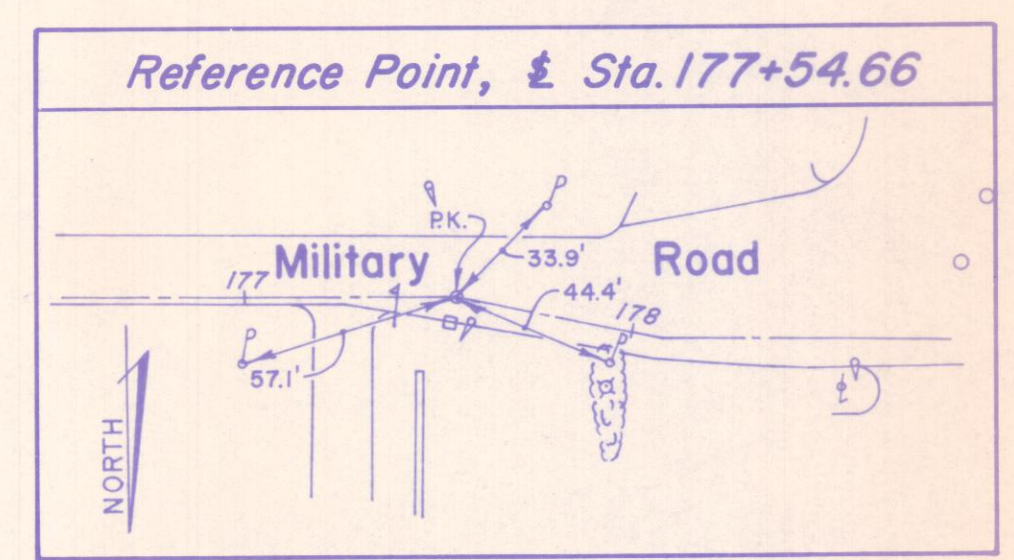

JOHN E. FOSTER AND ASSOCIATES, INC.
555 Buttles Avenue, Columbus, Ohio 43215

CITY OF ZANESVILLE, OHIO
CENTRAL LINDEN TAYLOR
WATER MAIN

16" WATER MAIN
MILITARY ROAD / MAPLE AVENUE
Sta. 168+60.37 to Sta. 177+80±

DESIGNED	DRAWN	TRACED	CHECKED	REVIEWED	DATE	REVISED
D.P.K.	W.E.H.	W.E.H.	E.L.F.	J.E.F.	6-10-88	