
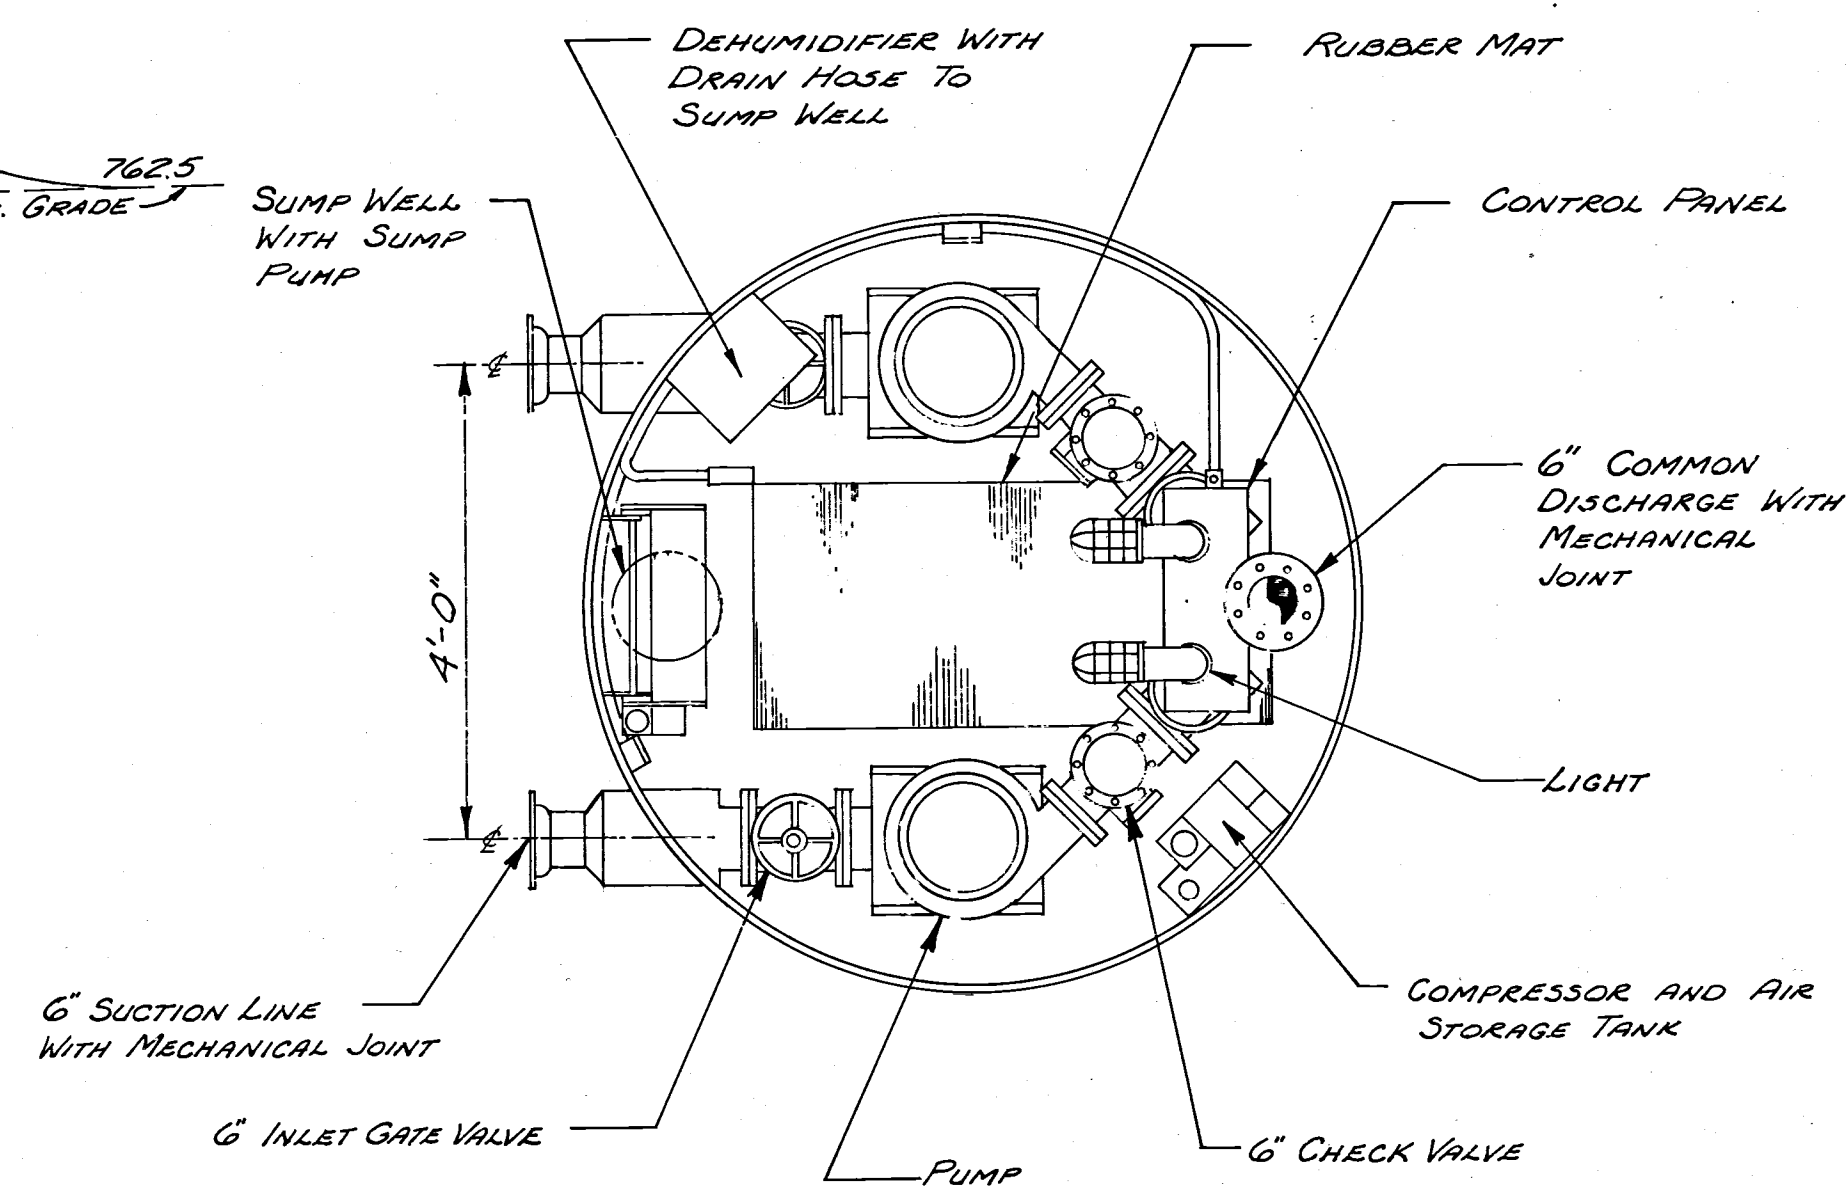
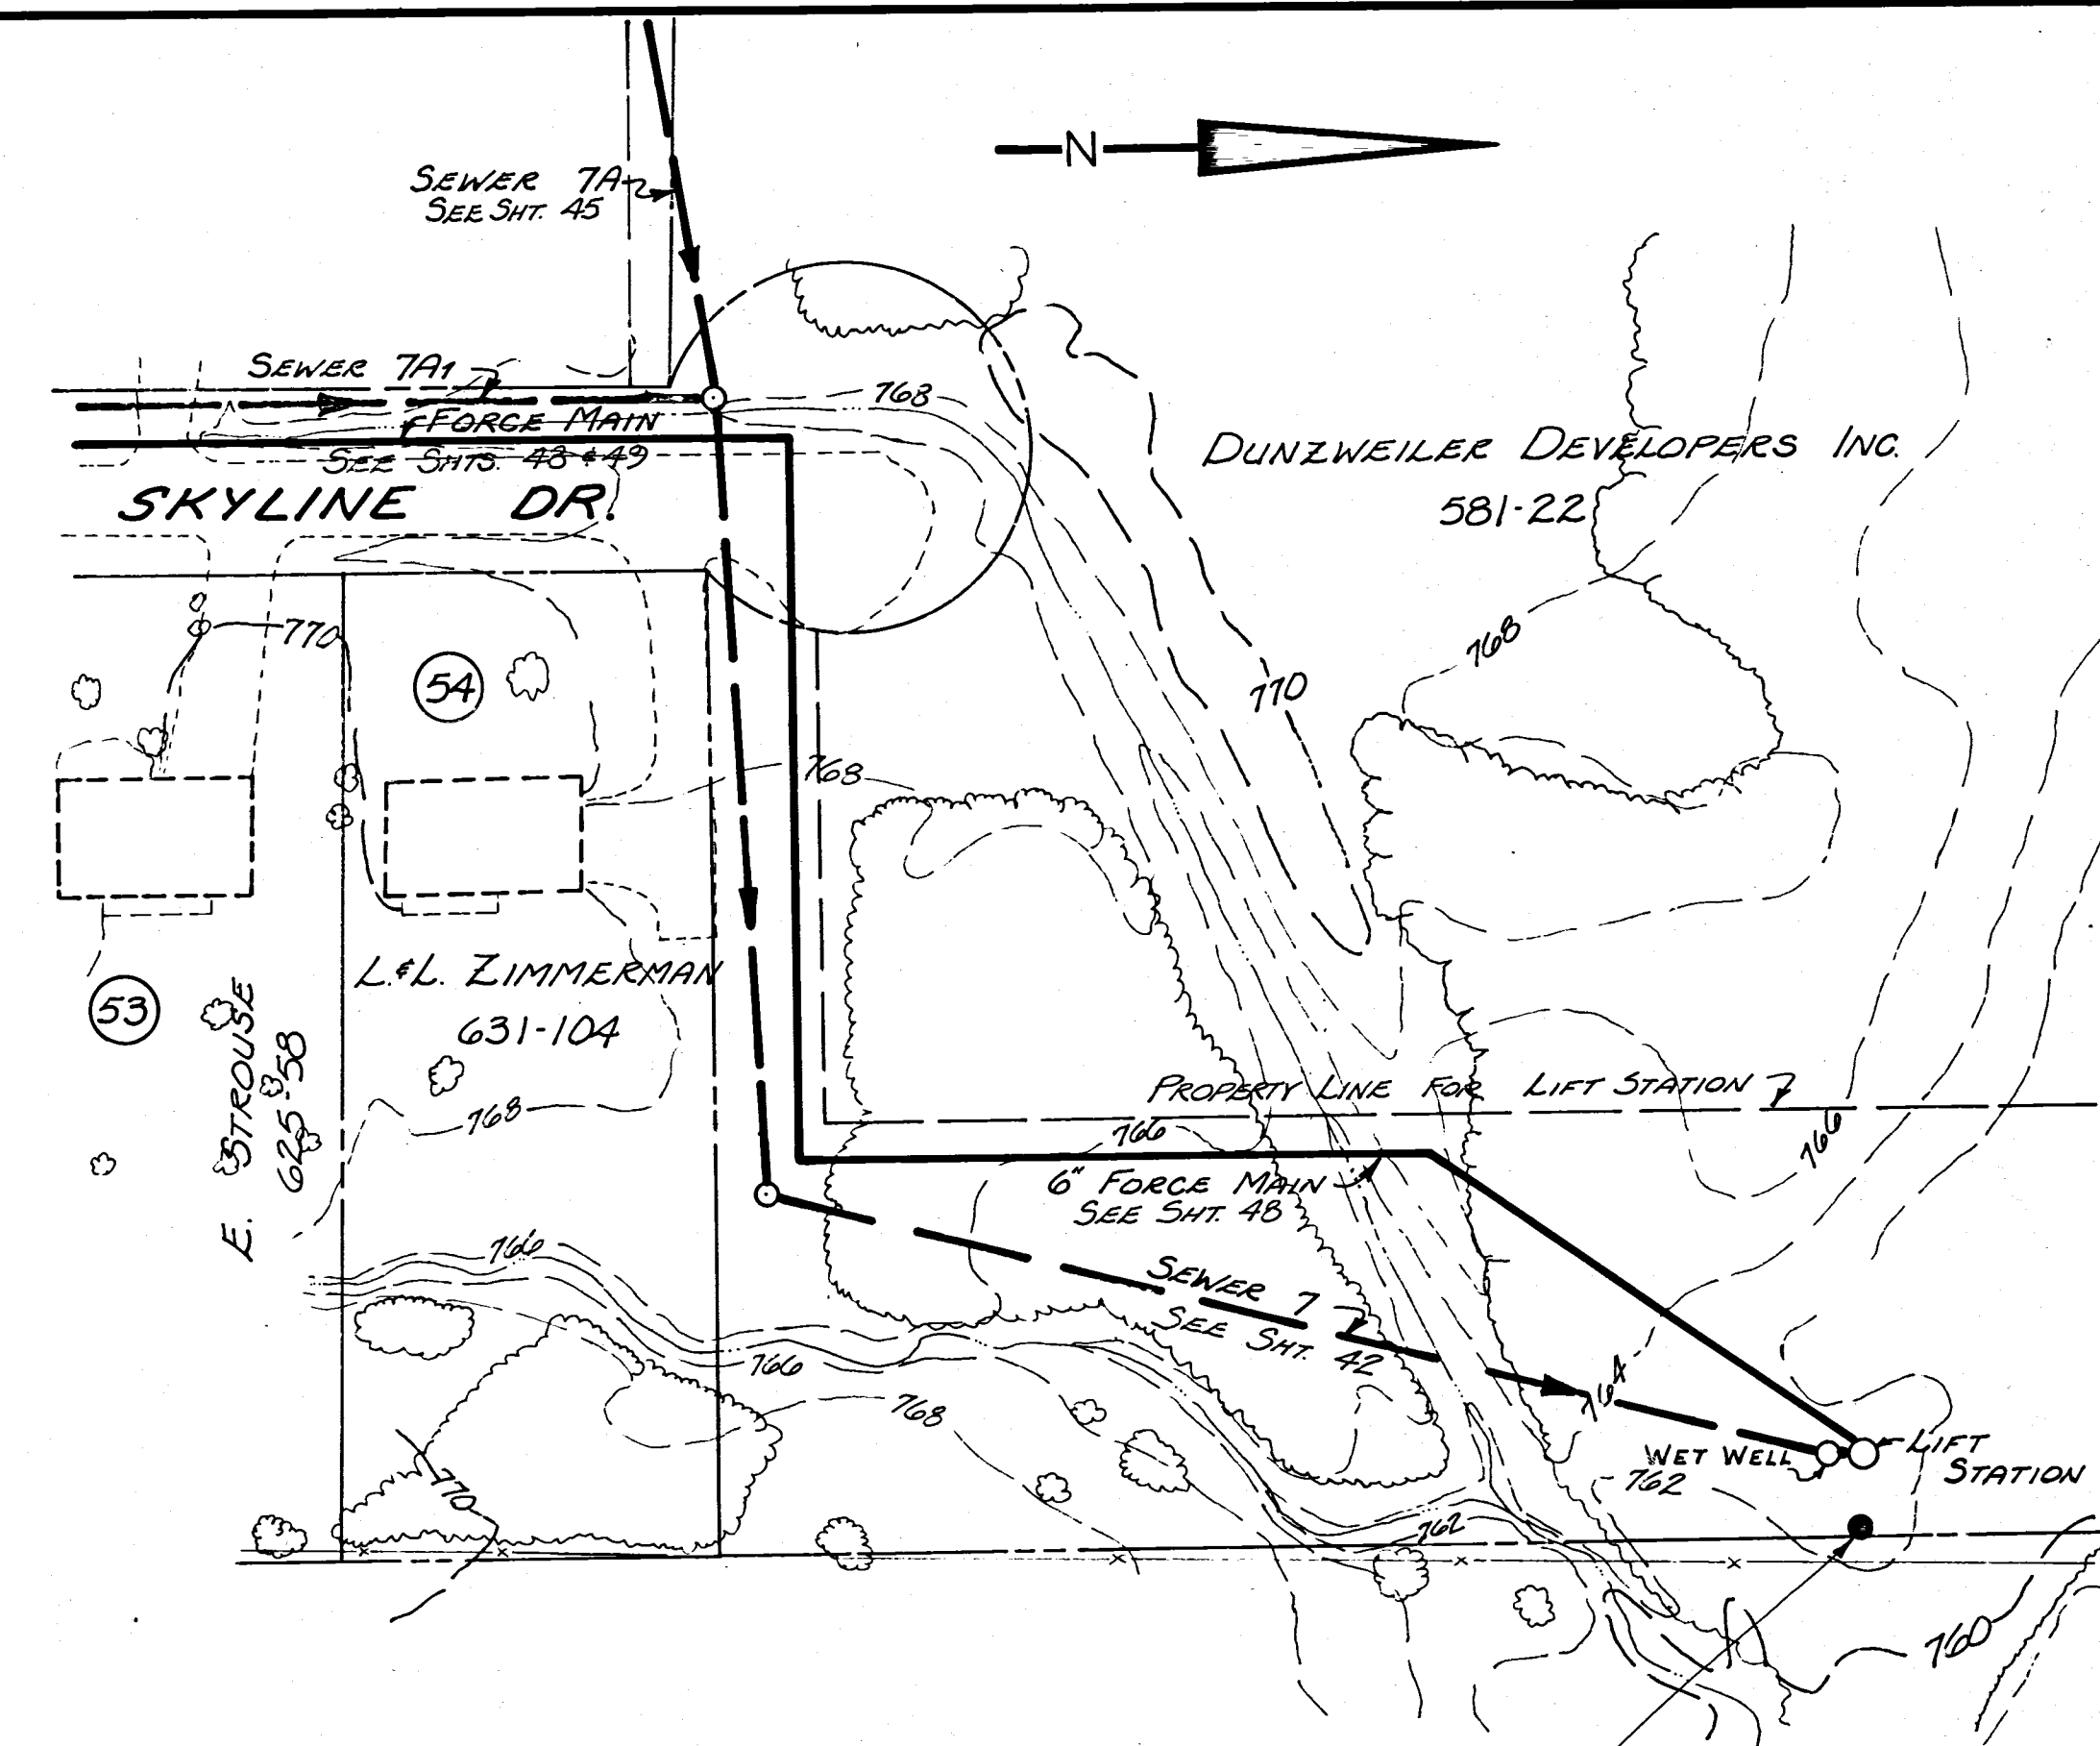
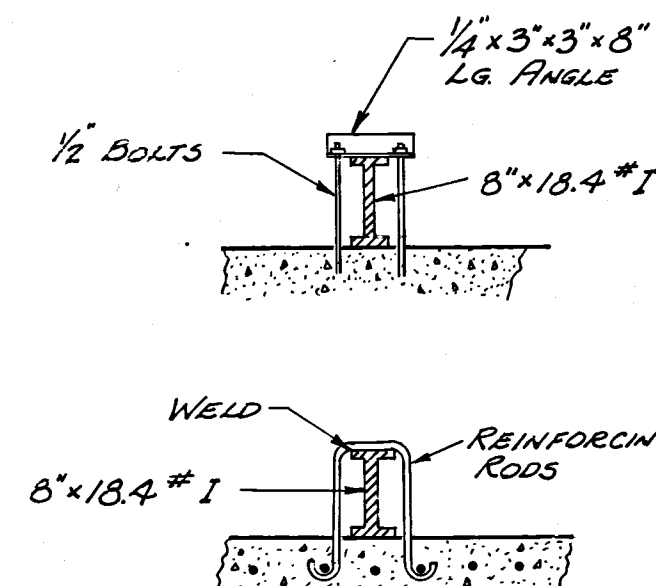
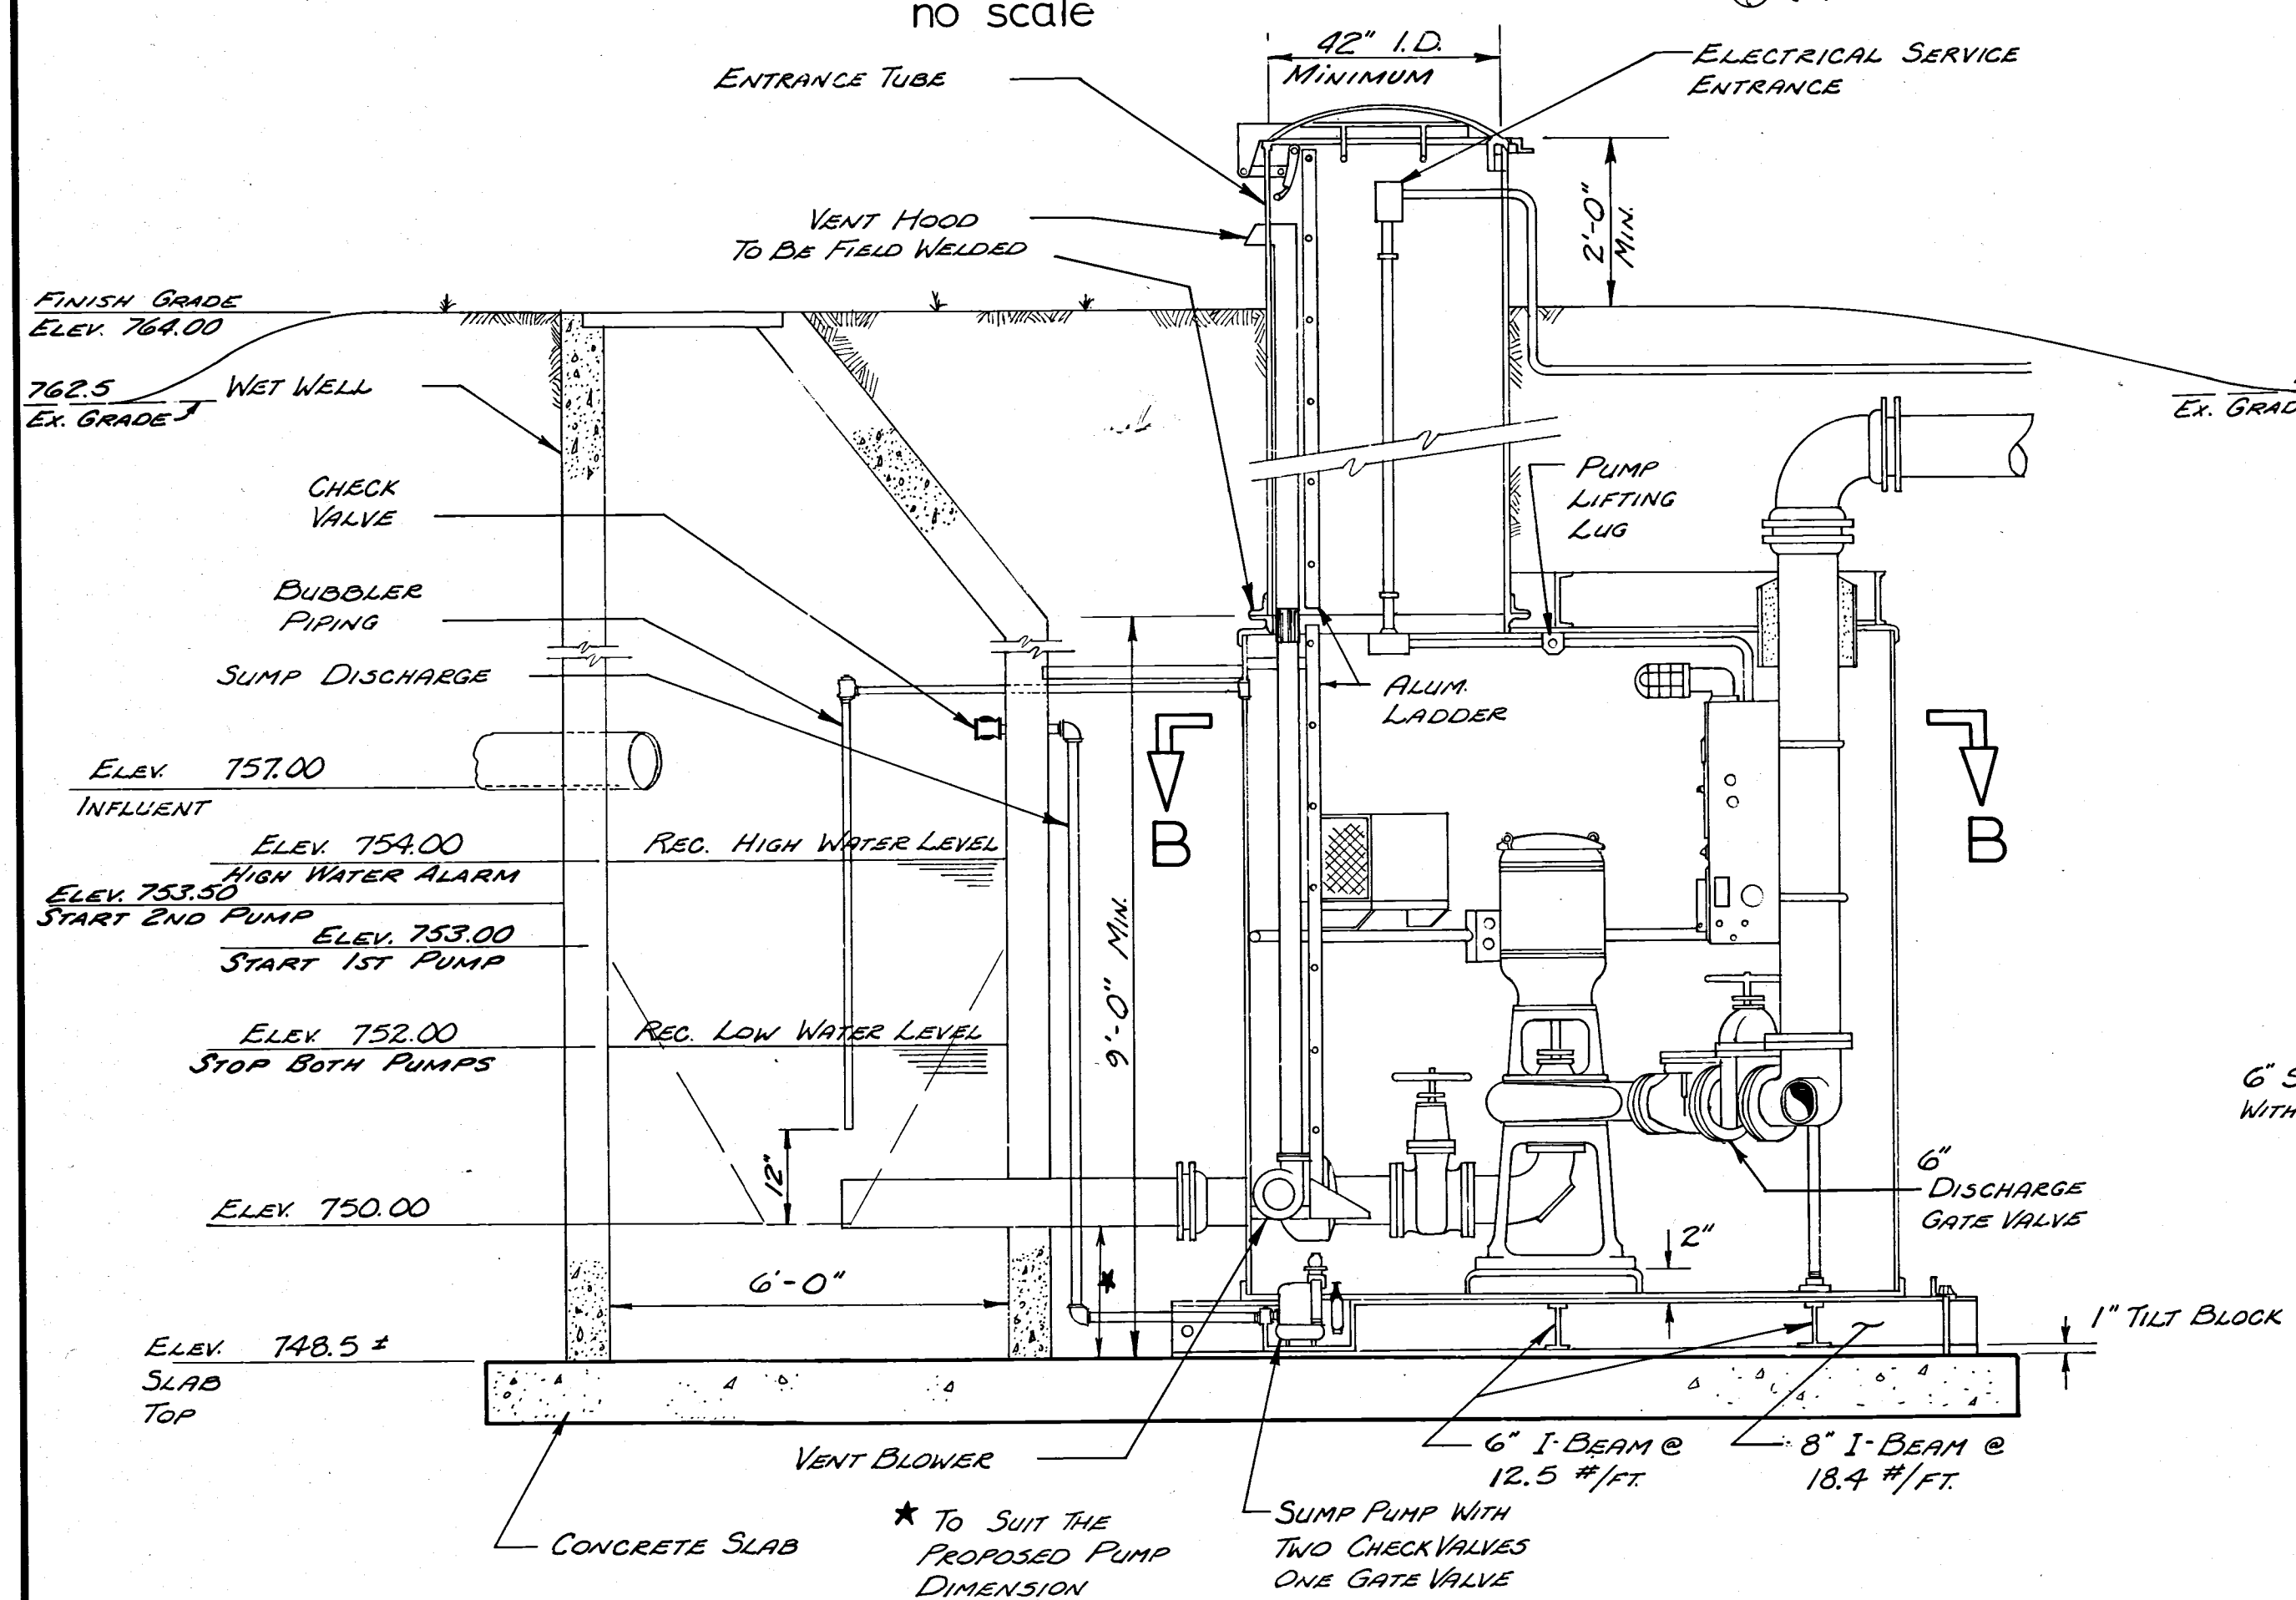


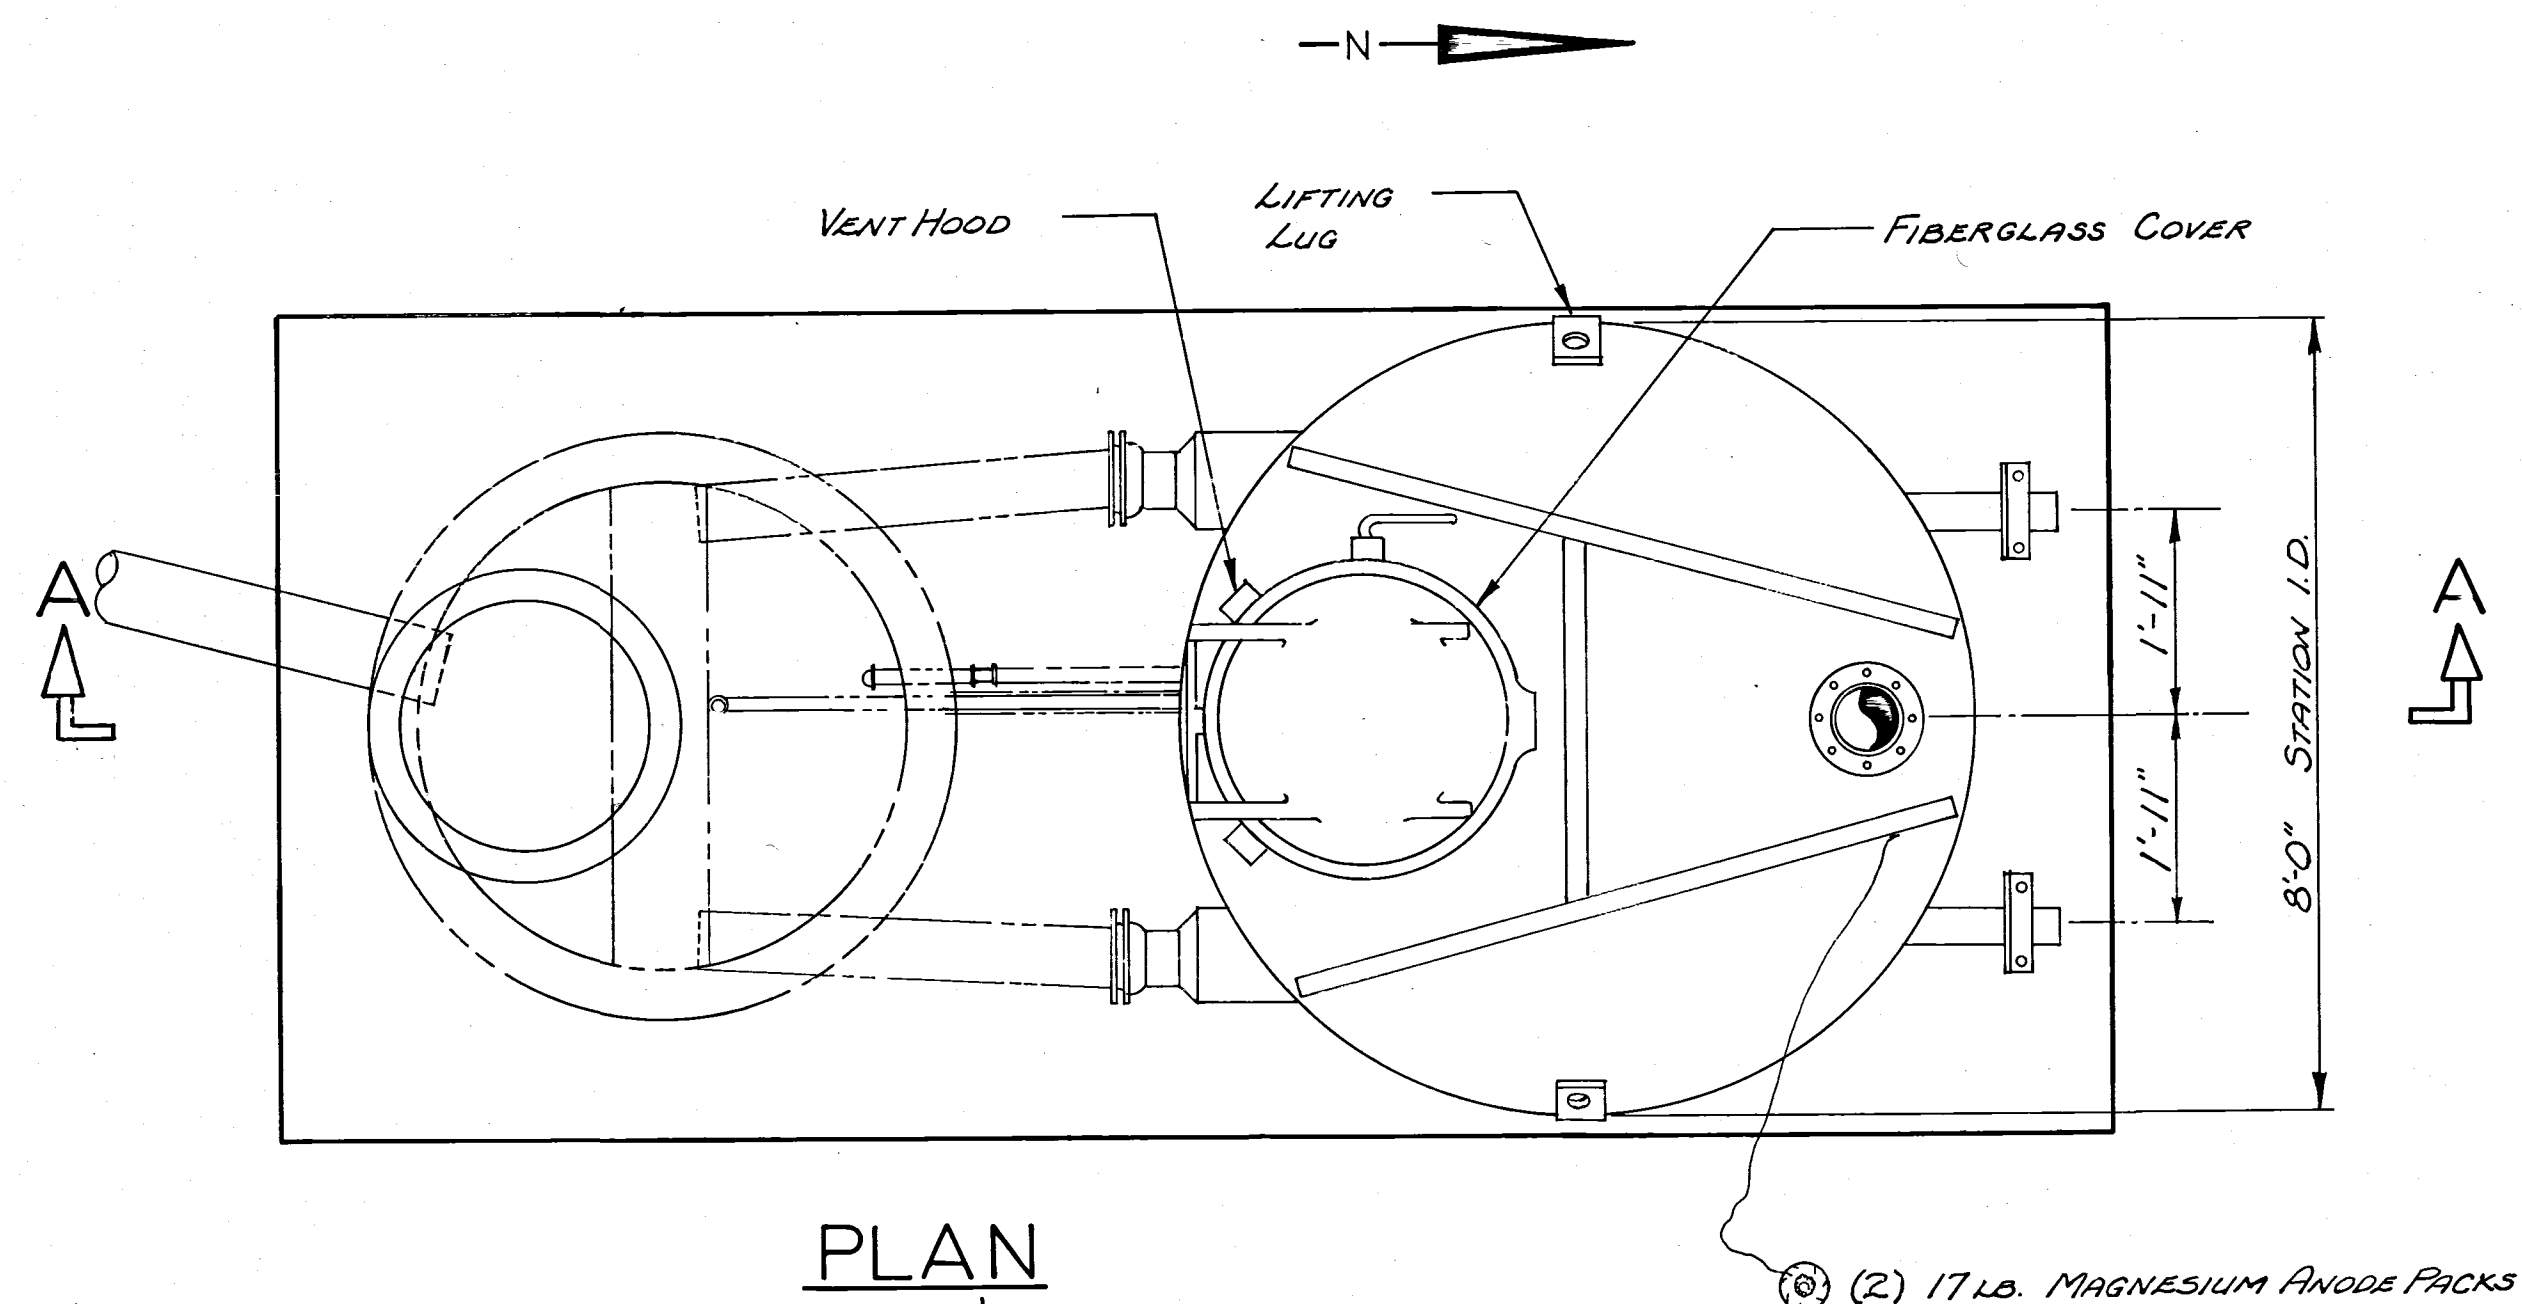

SEWAGE LIFT STATION scale as shown

NOTE

The Owner will make all necessary arrangements with the Electric Co. to bring a 3-phase line into the customer service pole as shown on the plan. A self-contained 200-amp, 480/277-volt meter will be mounted on the pole. Also, on this pole will be located the conduit and weatherhead with 4-4/0 conductor and 200-amp fused disconnect switch on the load side of the meter. Any cost involved to bring this power to the pole will be paid to the Electric Co. by the Owner.

The Contractor will make all necessary connections from this pole to the Pump Station at his own expense.