


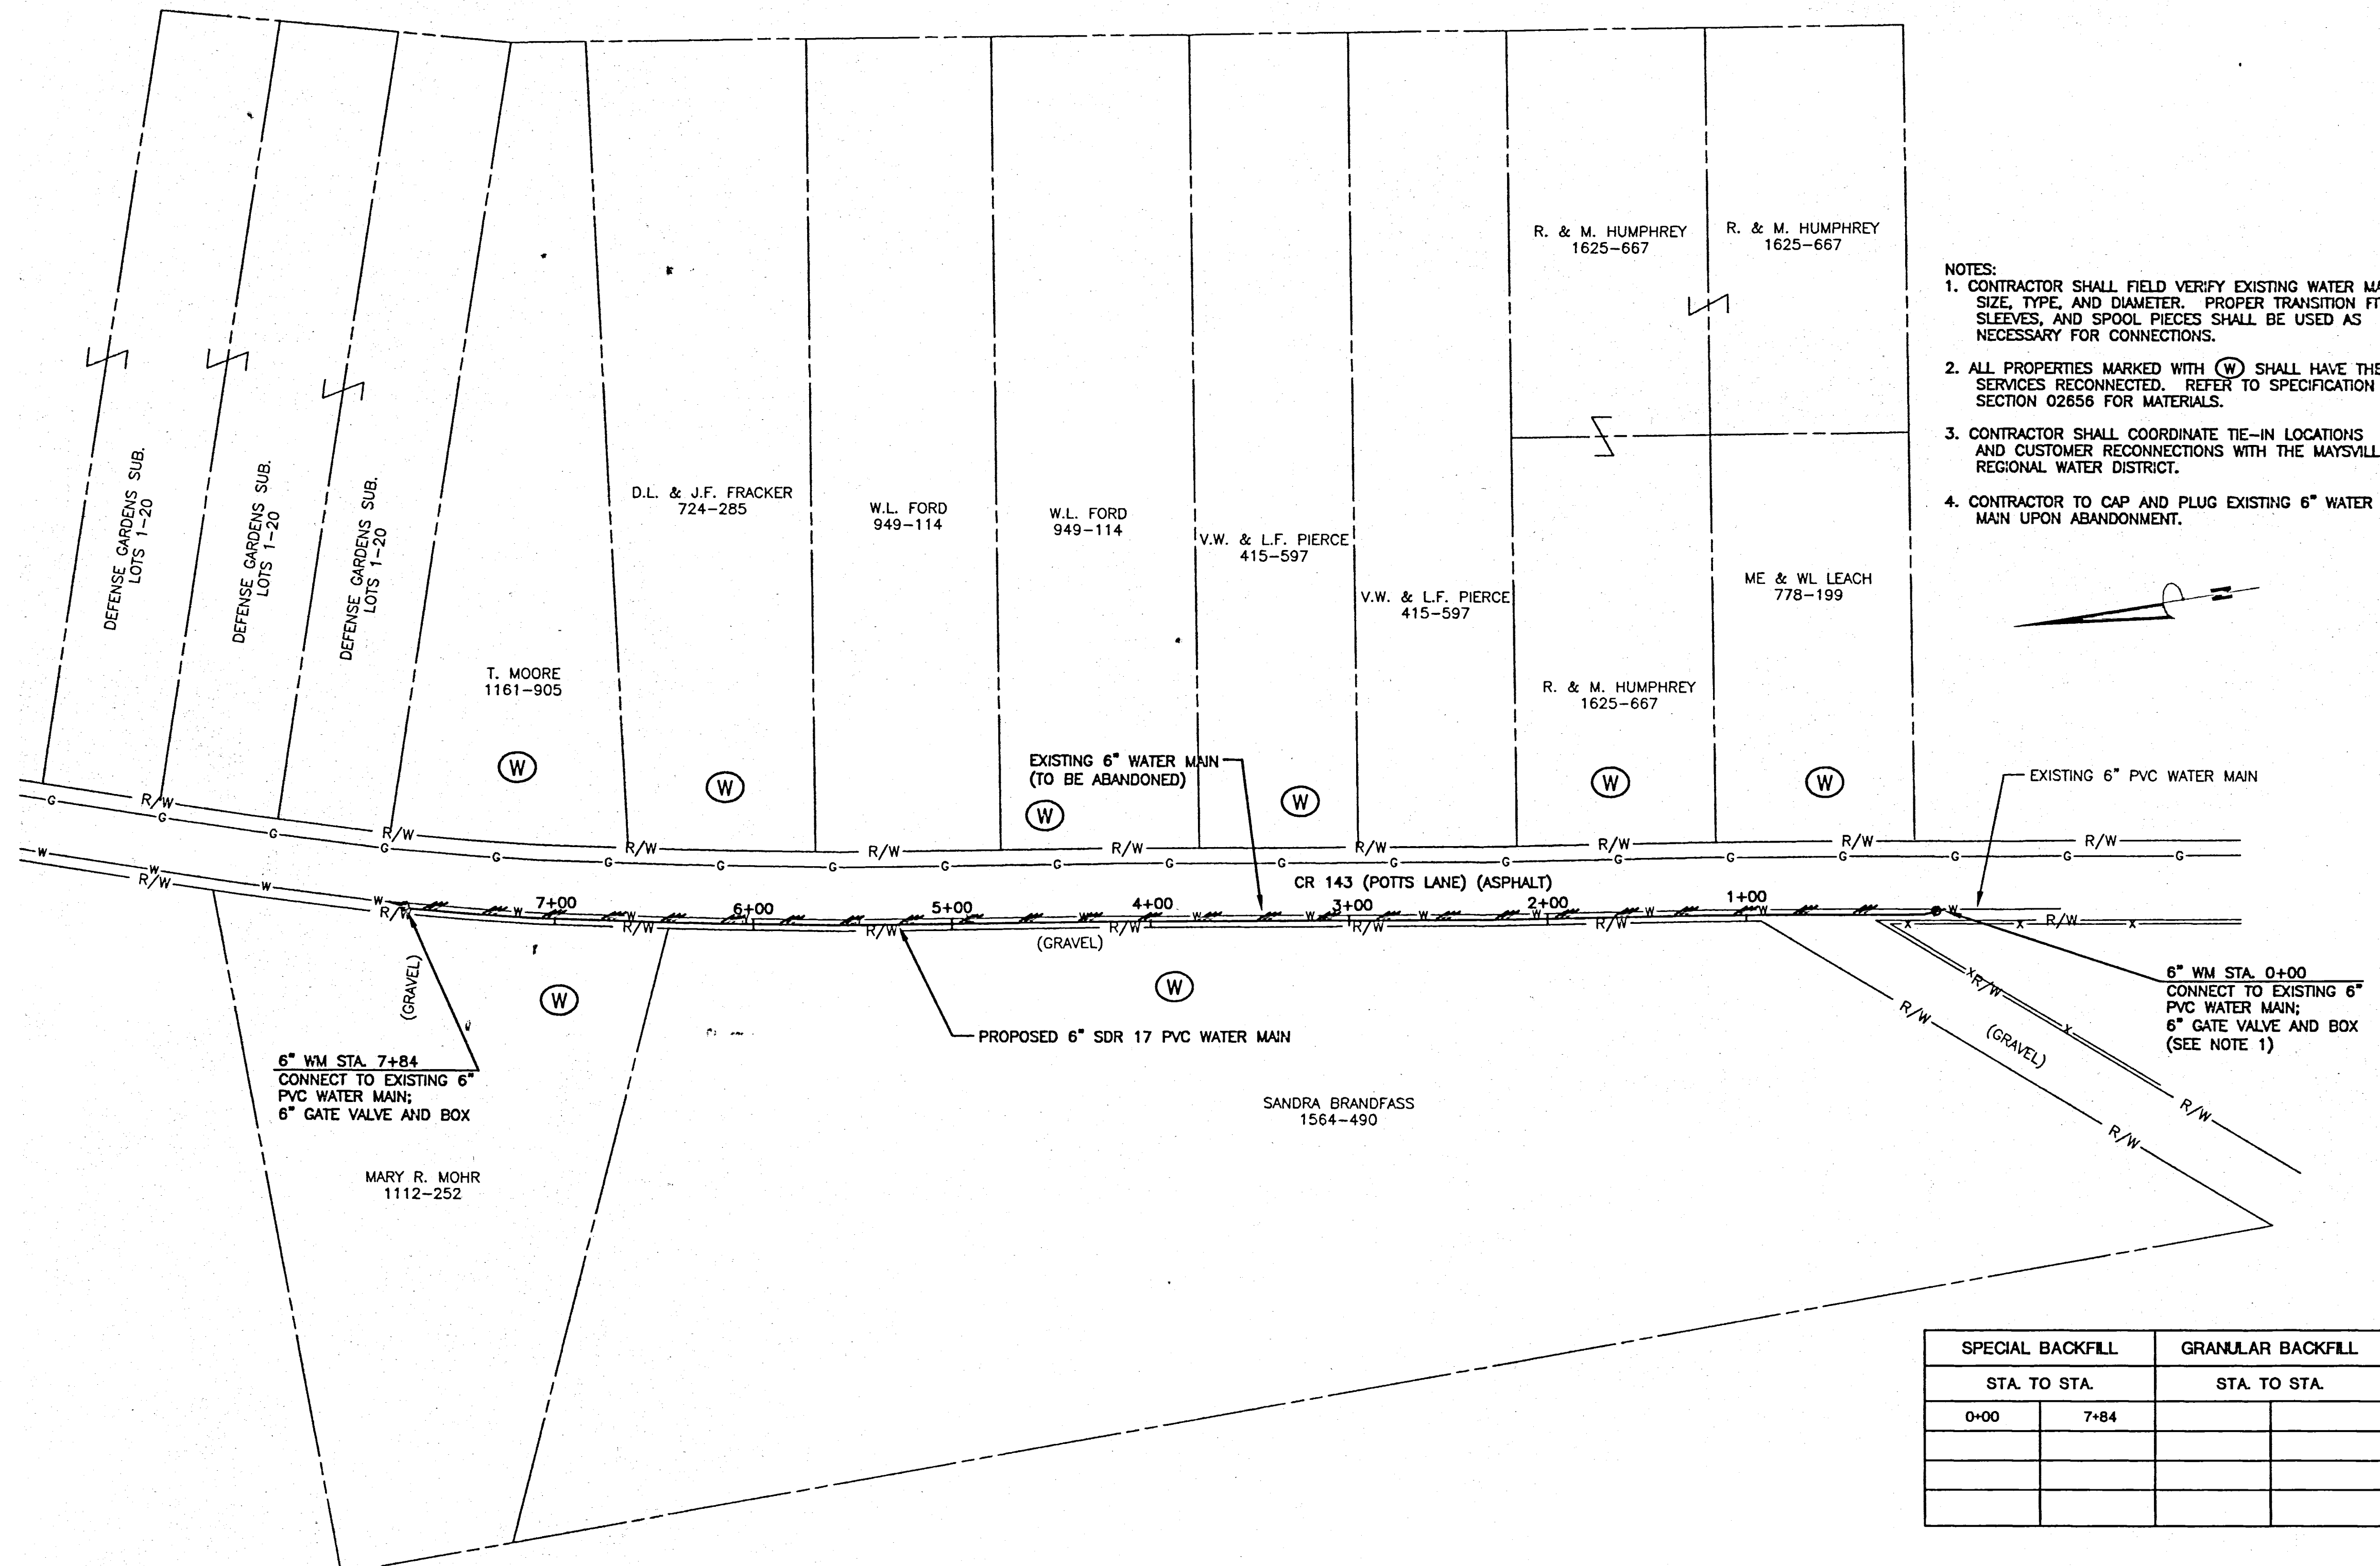

- NOTES:
1. CONTRACTOR SHALL FIELD VERIFY EXISTING WATER MAIN SIZE, TYPE, AND DIAMETER. PROPER TRANSITION FITTINGS, SLEEVES, AND SPOOL PIECES SHALL BE USED AS NECESSARY FOR CONNECTIONS.
 2. ALL PROPERTIES MARKED WITH (W) SHALL HAVE THEIR SERVICES RECONNECTED. REFER TO SPECIFICATION SECTION 02656 FOR MATERIALS.
 3. CONTRACTOR SHALL COORDINATE TIE-IN LOCATIONS AND CUSTOMER RECONNECTIONS WITH THE MAYSVILLE REGIONAL WATER DISTRICT.
 4. CONTRACTOR TO CAP AND PLUG EXISTING 6" WATER MAIN UPON ABANDONMENT.

SPECIAL BACKFILL		GRANULAR BACKFILL	
STA. TO STA.		STA. TO STA.	
0+00	7+84		

P:\PR31759\CADD\PLAN.DWG 5-29-02 3:07:17 pm DYE

NO.	REVISIONS	DATE	BY	CHK.

Burgess & Niple, Limited Parkersburg, WV

BURGESS & NIPLE

MAYSVILLE REGIONAL WATER DISTRICT
WATER DISTRIBUTION SYSTEM IMPROVEMENTS
POTTS LANE
CONTRACT 02-2

JOB NO.	31759
DESIGNED BY:	AMH
DRAWN BY:	DRD
CHECKED BY:	LES
APPROVED BY:	LES
DATE:	JUNE 2002

6" WATER MAIN STA. 0+00 TO STA. 7+84

SCALE:	
1"=50'	
SHEET NO.	OF
6	9

