


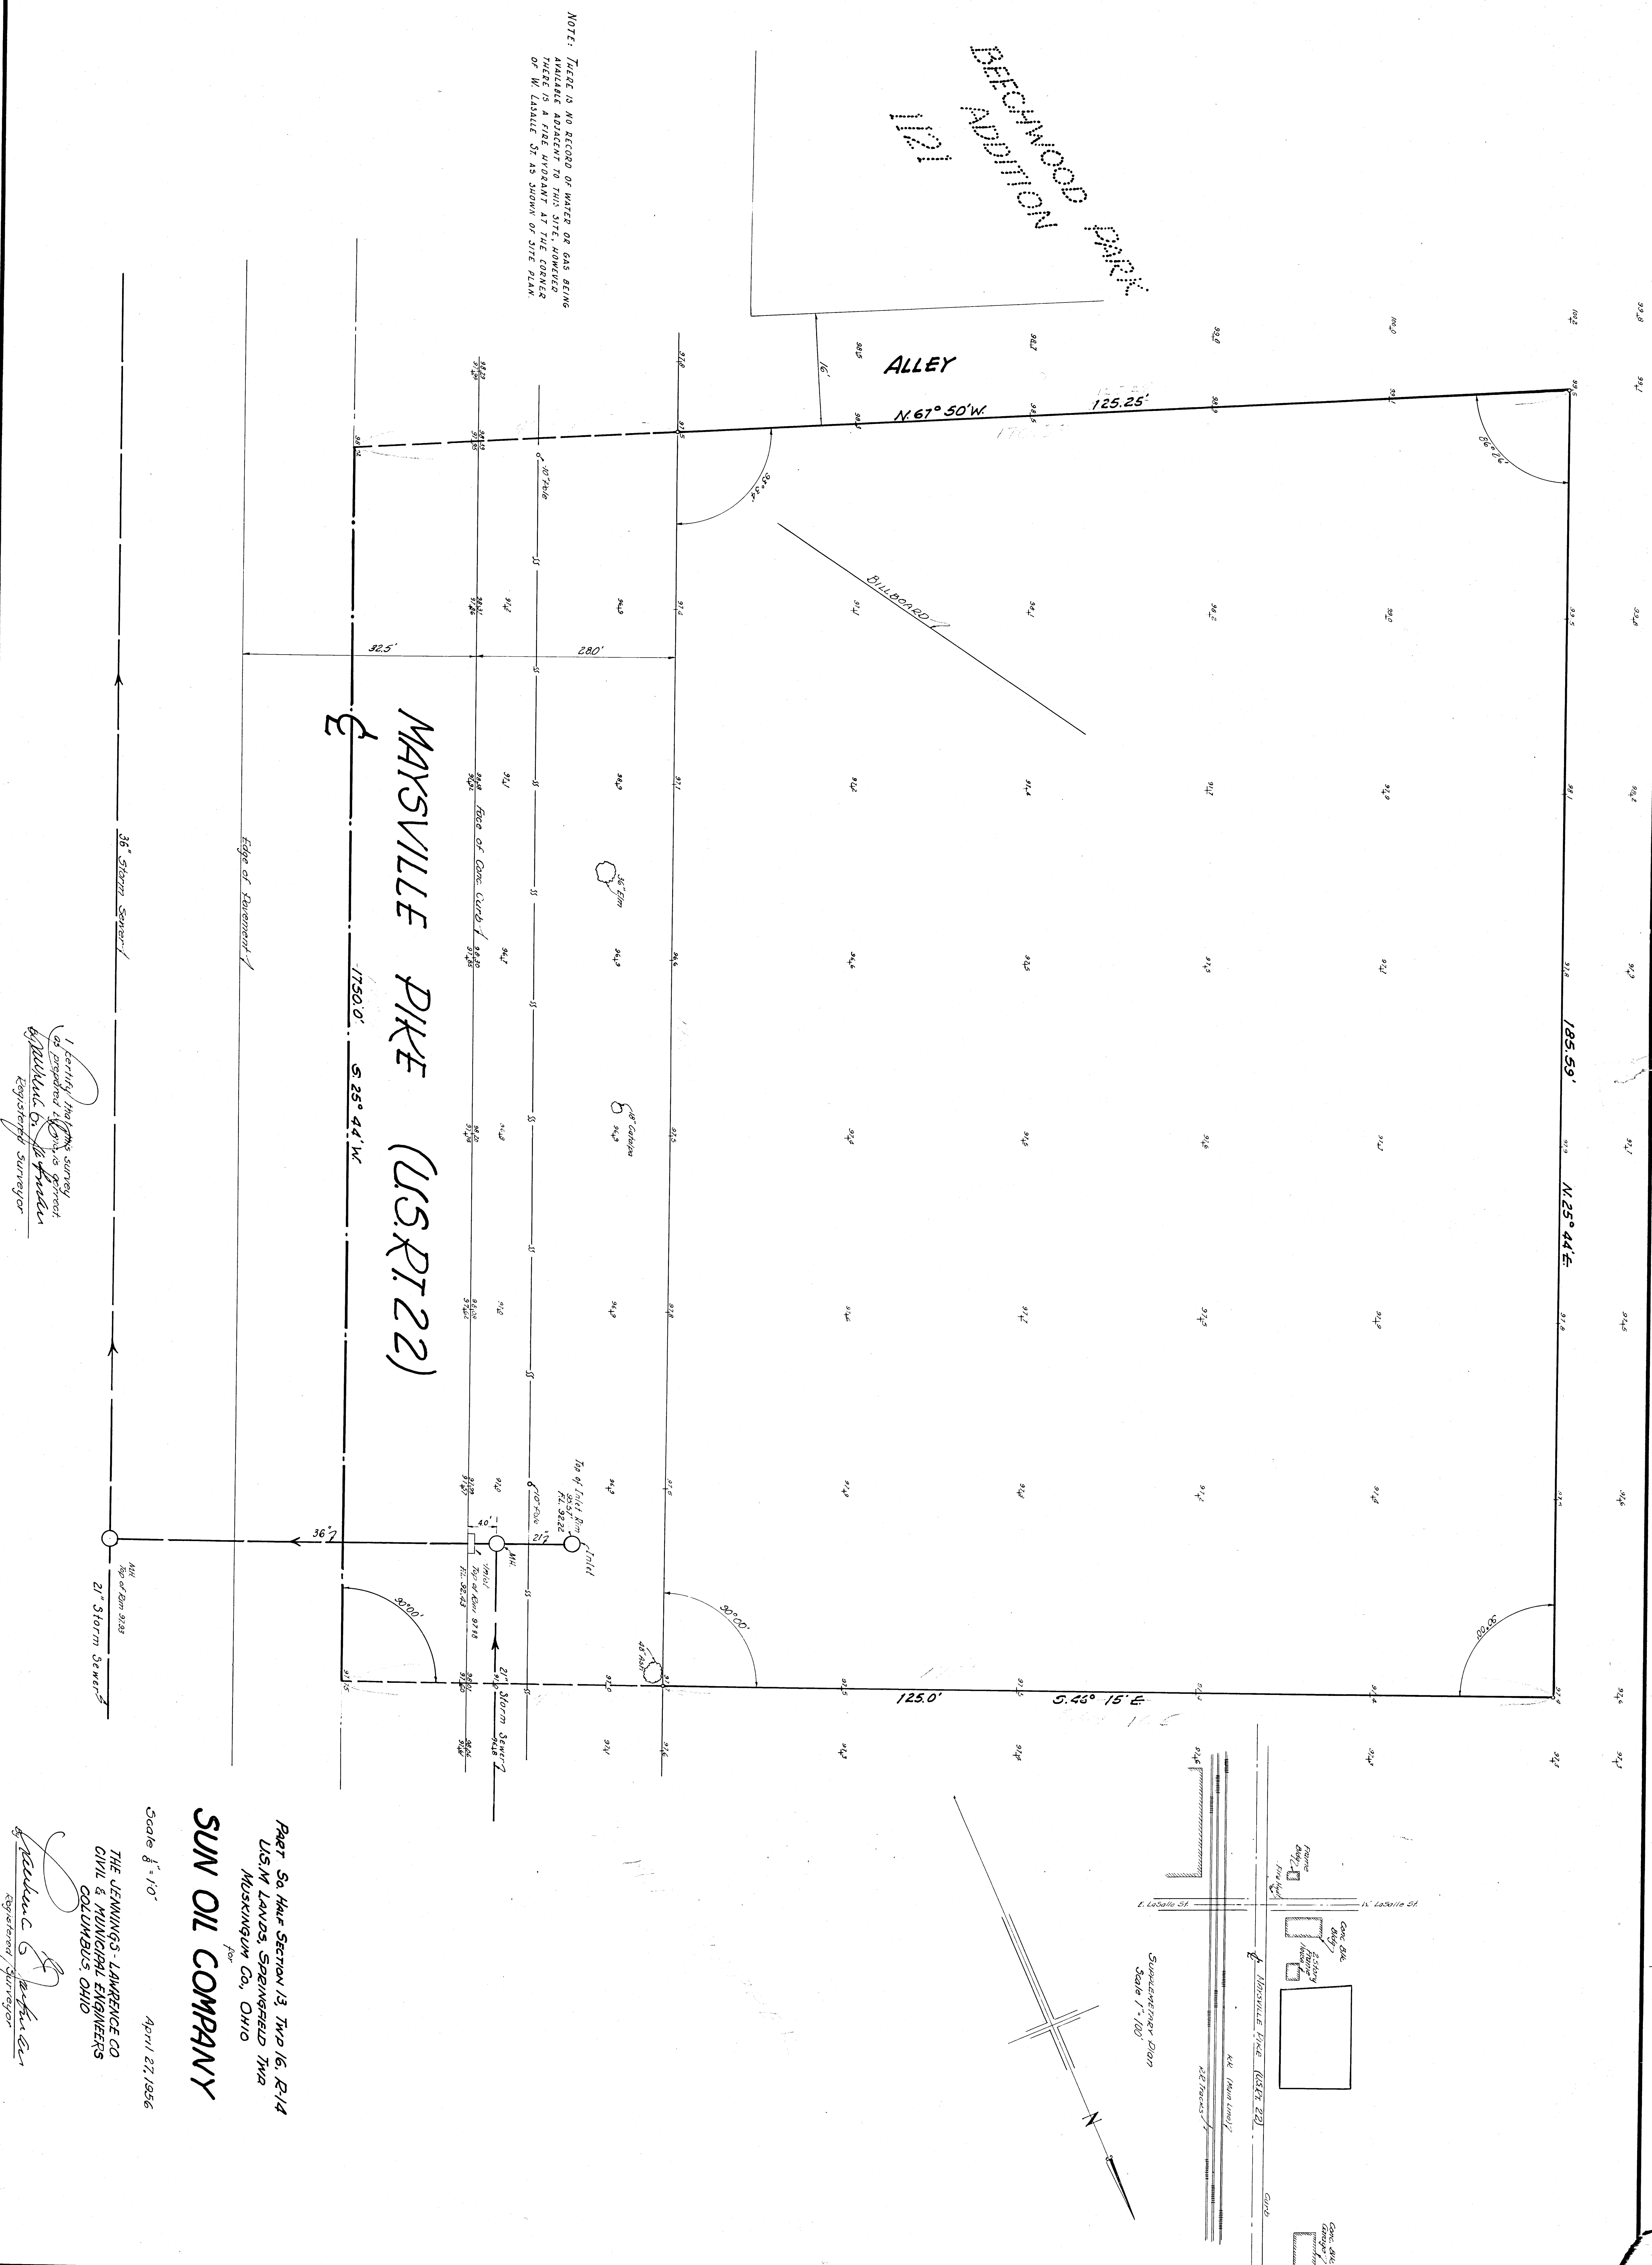

NOTE: There is no record of water or gas being available adjacent to this site, however there is a fire hydrant at the corner of W. Casselle St. as shown on site plan.

I certify that this survey as prepared herein is correct to the best of my knowledge and belief.

THE JENNINGS-LAWRENCE CO.
CIVIL & MECHANICAL ENGINEERS
COLUMBUS, OHIO

SUN OIL COMPANY
PART 50, HALF SECTION 13, TWP 16, R. 14
USM LANDS, SPRINGFIELD TWP
MUSKINGUM CO., OHIO

Scale 1" = 10'
April 27, 1956