

Utilities Owners
Ohio Central Telephone Co.
Ohio Fuel Gas Co.
Ohio Power Co.
Buckeye Pipe Line Co.
Pure Oil Company

FED. RD. DIVISION	STATE	PROJECT
2	OHIO	

MUSKINGUM COUNTY
MUS-146-0.15



ROADWAY QUANTITIES

Reference Number	Station to Station	Side	I-15	I-15	I-18	F-8	F-12	Special	Special
			Guard Rail Removed & Disposed of	Guard Rail Steel Beam Type (Deep)	Stabilized Crushed Aggregate	Removal of Existing Pavement	12" Pipe Removal	Relocating Existing Telephone Lines	Relocating Existing Power Lines
			Lin. Ft.	Lin. Ft.	Cu. Yds.	Sq. Yds.	Lin. Ft.	Lump	Lump
1-D	8+14	RT							
2-R	8+44.40	LT			25.6				
3-R	8+375 to 10+00	RT		162.5					
4-D	9+25 to 10+00	LT		75					
5-D	8+09 to 8+46	LT					32		
6-D	8+52 to 10+00	LT	148						
7-R	8+87 to 10+00	RT	113						
8-R	6+50 to 10+00	R/L				700			
9-R	6+50 to 42+00	R/L						Lump	
10-R	6+50 to 42+00	R/L							Lump
TOTALS			261	237.5	41.2	700	32	Lump	Lump

DRAINAGE QUANTITIES

Reference Number	Station to Station	Side	Pipe for Driveways Sec. 116.2(a)		Sodding				
			12" Lin. Ft.	15" Lin. Ft.		Sq. Yds.			
1-D	6+50 to 8+04	LT				103			
2-D	6+50 to 8+03	RT				102			
4-D	8+14	RT		36					
5-D	8+32 to 9+79	RT				98			
6-D	8+44.40	LT	40						
7-D	8+37 to 10+00	LT				109			
9-D	9+85 to 10+00	RT				10			
1	See Sheet No. 28								
TOTALS			40	36		422			

REVISION	DATE	DESCRIPTION	BY
8-6-59		REVISED IN ACCORDANCE WITH ADDENDUM NO. 2	N.J.B.
U. S. ARMY ENGINEER DISTRICT, HUNTINGTON CORPS OF ENGINEERS HUNTINGTON, W. VA.			
DRAWN BY: E.A.P.		LICKING RIVER DILLON RESERVOIR PROJECT RELOCATION OF OHIO STATE ROUTE NO. 146 (Section I)	
TRACED BY:		DATE: June, 1959	
CHECKED BY: J.W.		APPROVED: [Signature] COL. C.E., DISTRICT ENGINEER	
SUBMITTED BY: [Signature] ELMER S. BARRETT ASSOCIATES		SCALE: Horiz. 1"=30' VERT. 1"=10'	
RECOMMENDED BY: [Signature] CHIEF ENG. DIV.		SHEET 16 OF 36	
ELMER S. BARRETT ASSOCIATES CONSULTING ENGINEERS CHILLICOTHE, OHIO		SPEC. NO. DRAWING NUMBER 027f-UD5-68/16	

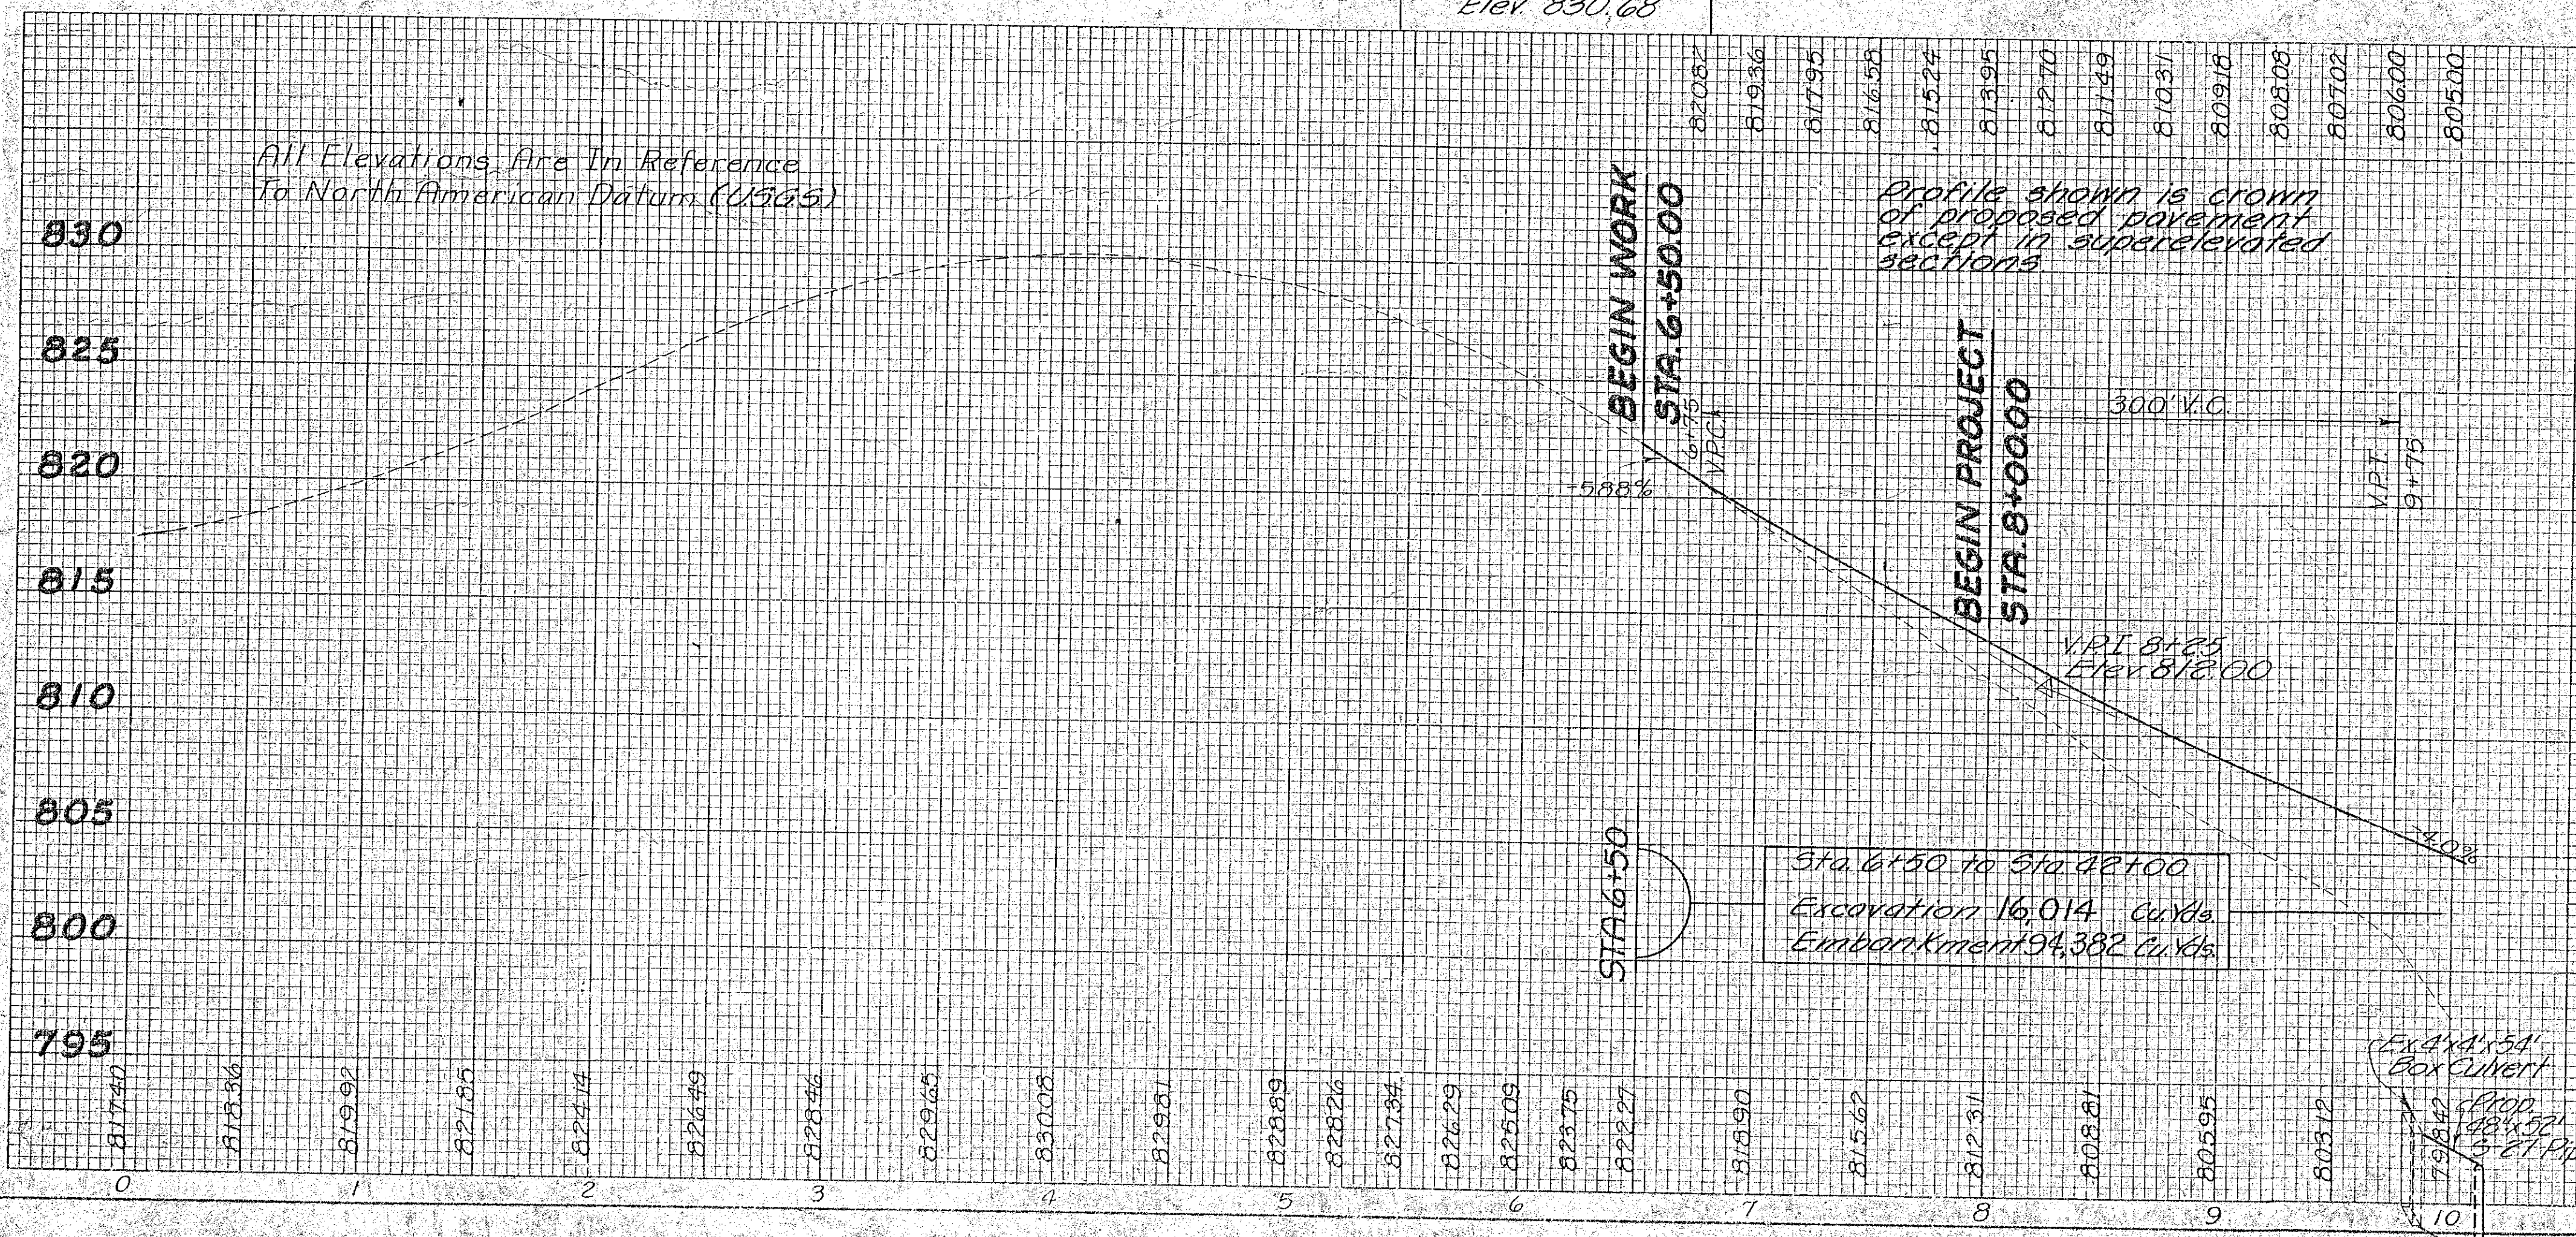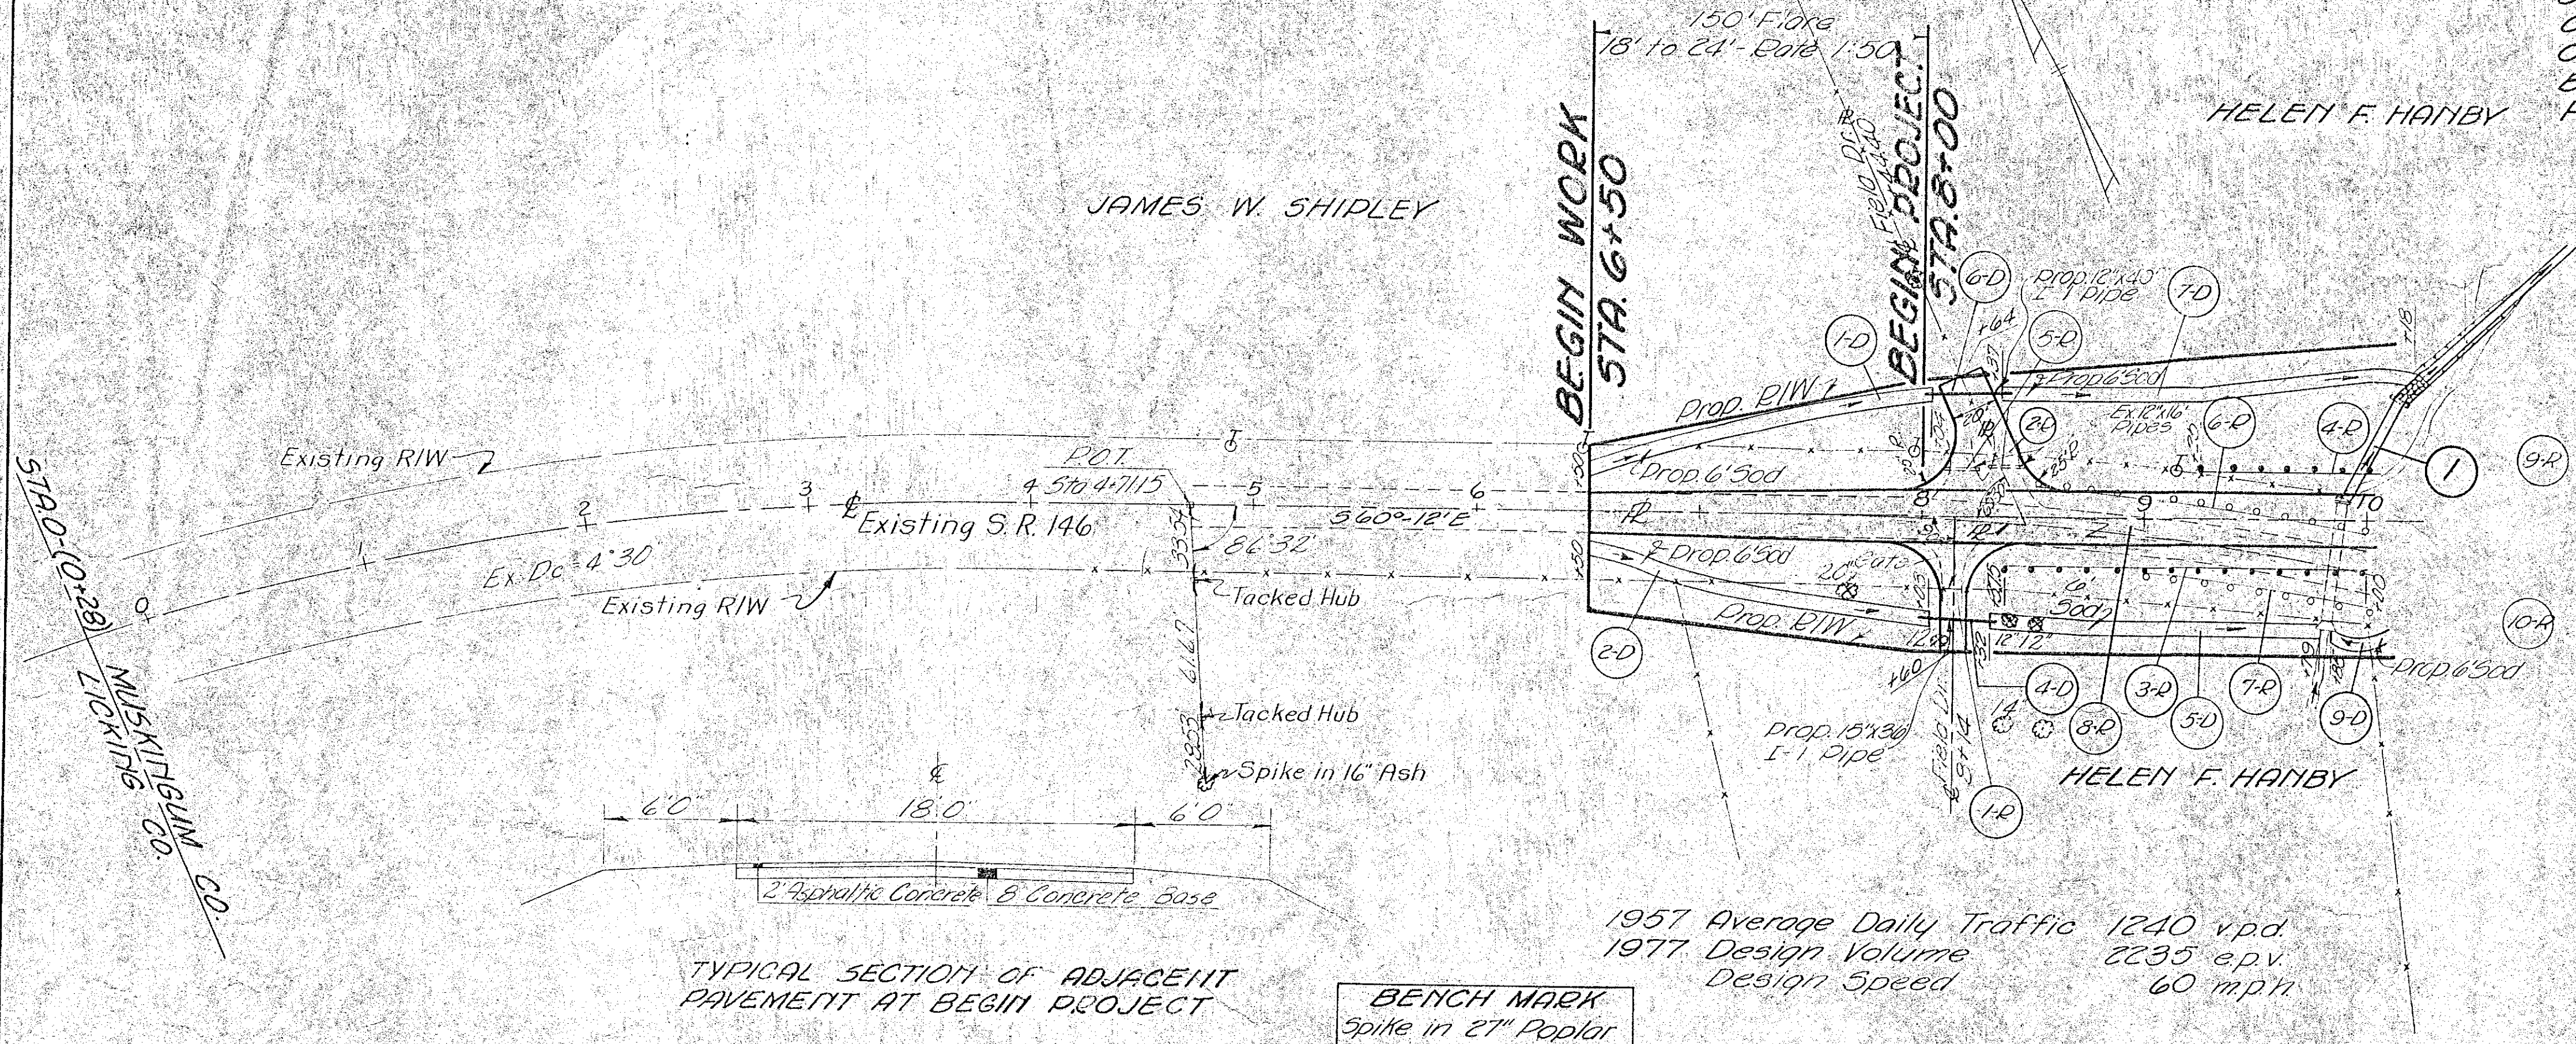

S.R. 146* 0.15
STA. 0+00 TO STA. 10+00
S.R. 146* 0.15
STA. 0+00 TO STA. 10+00