

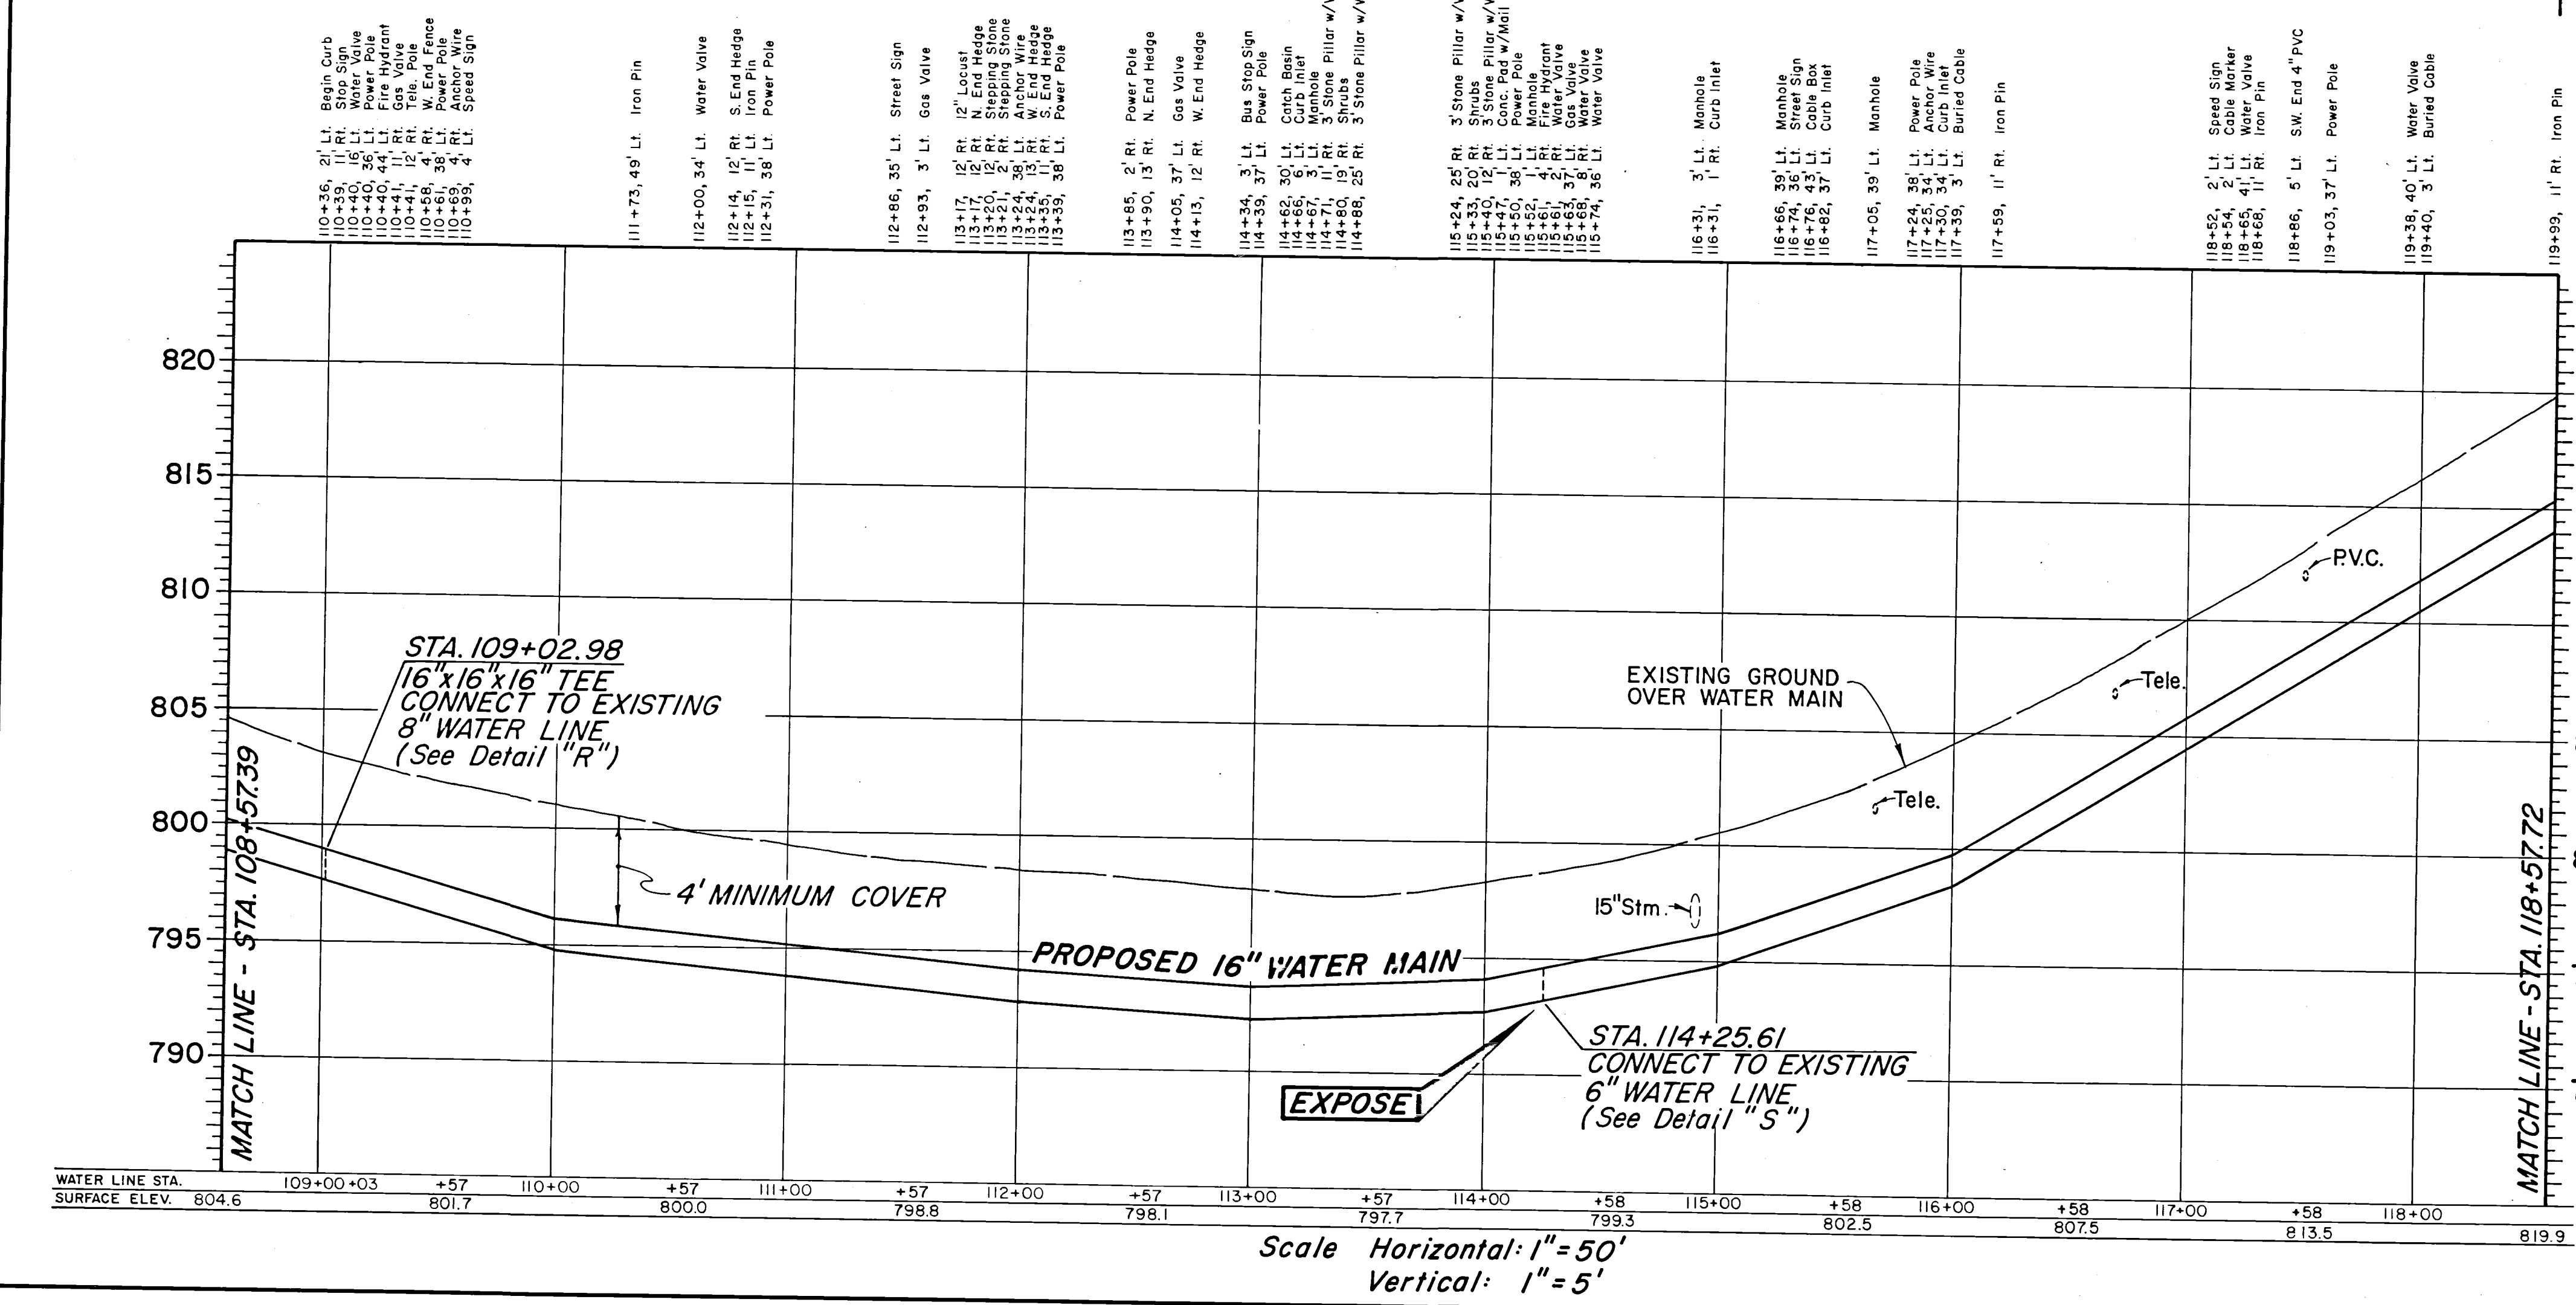
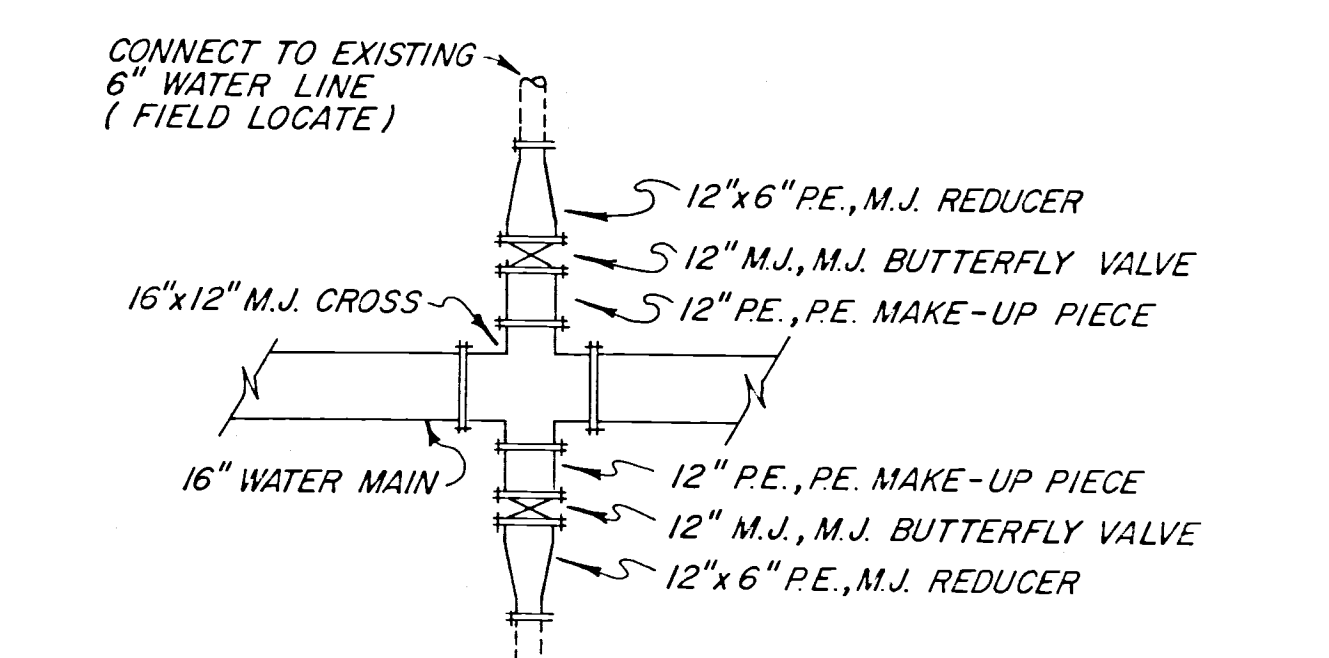
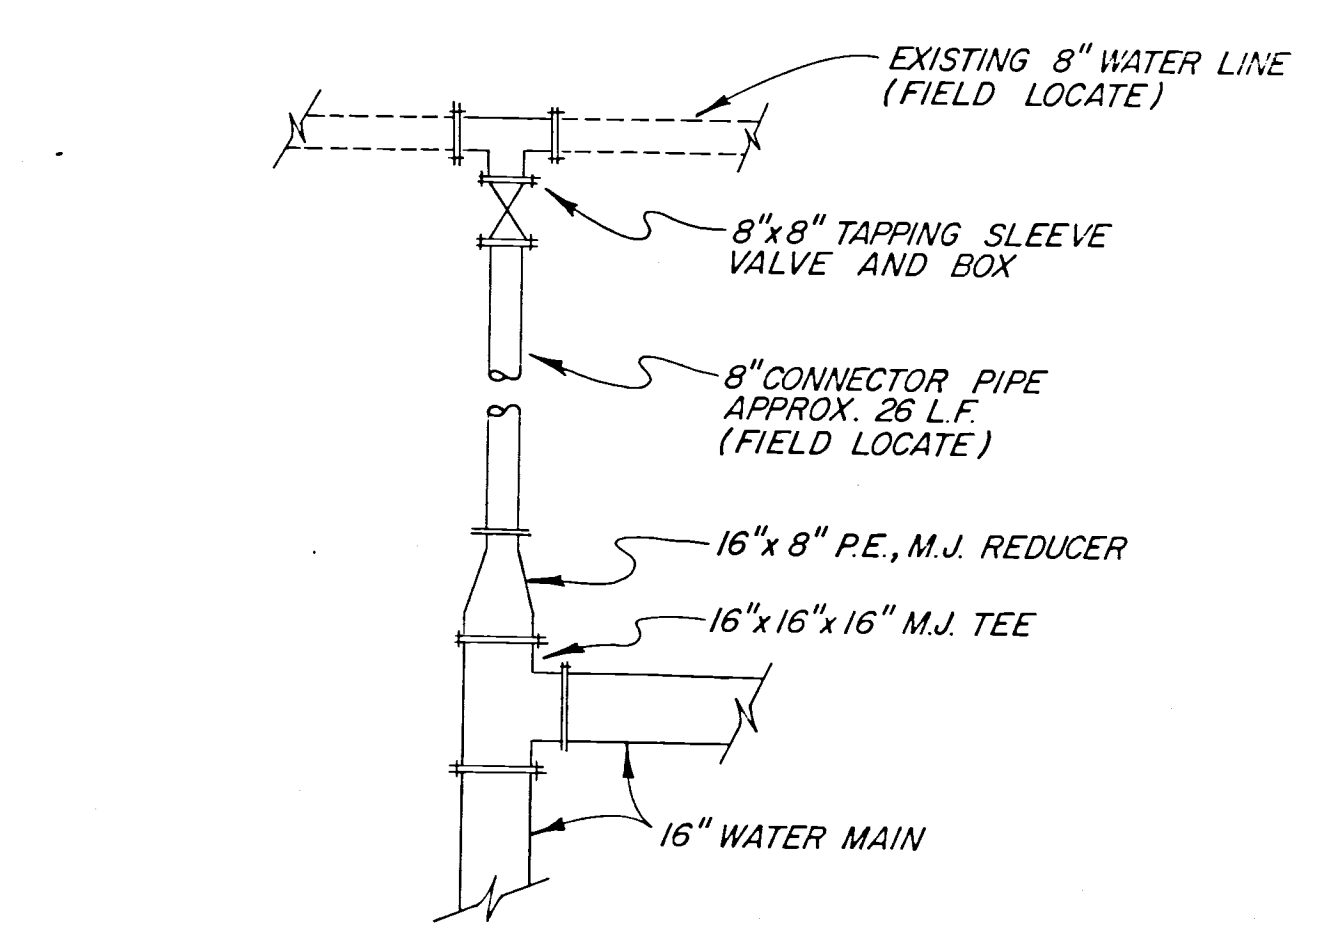
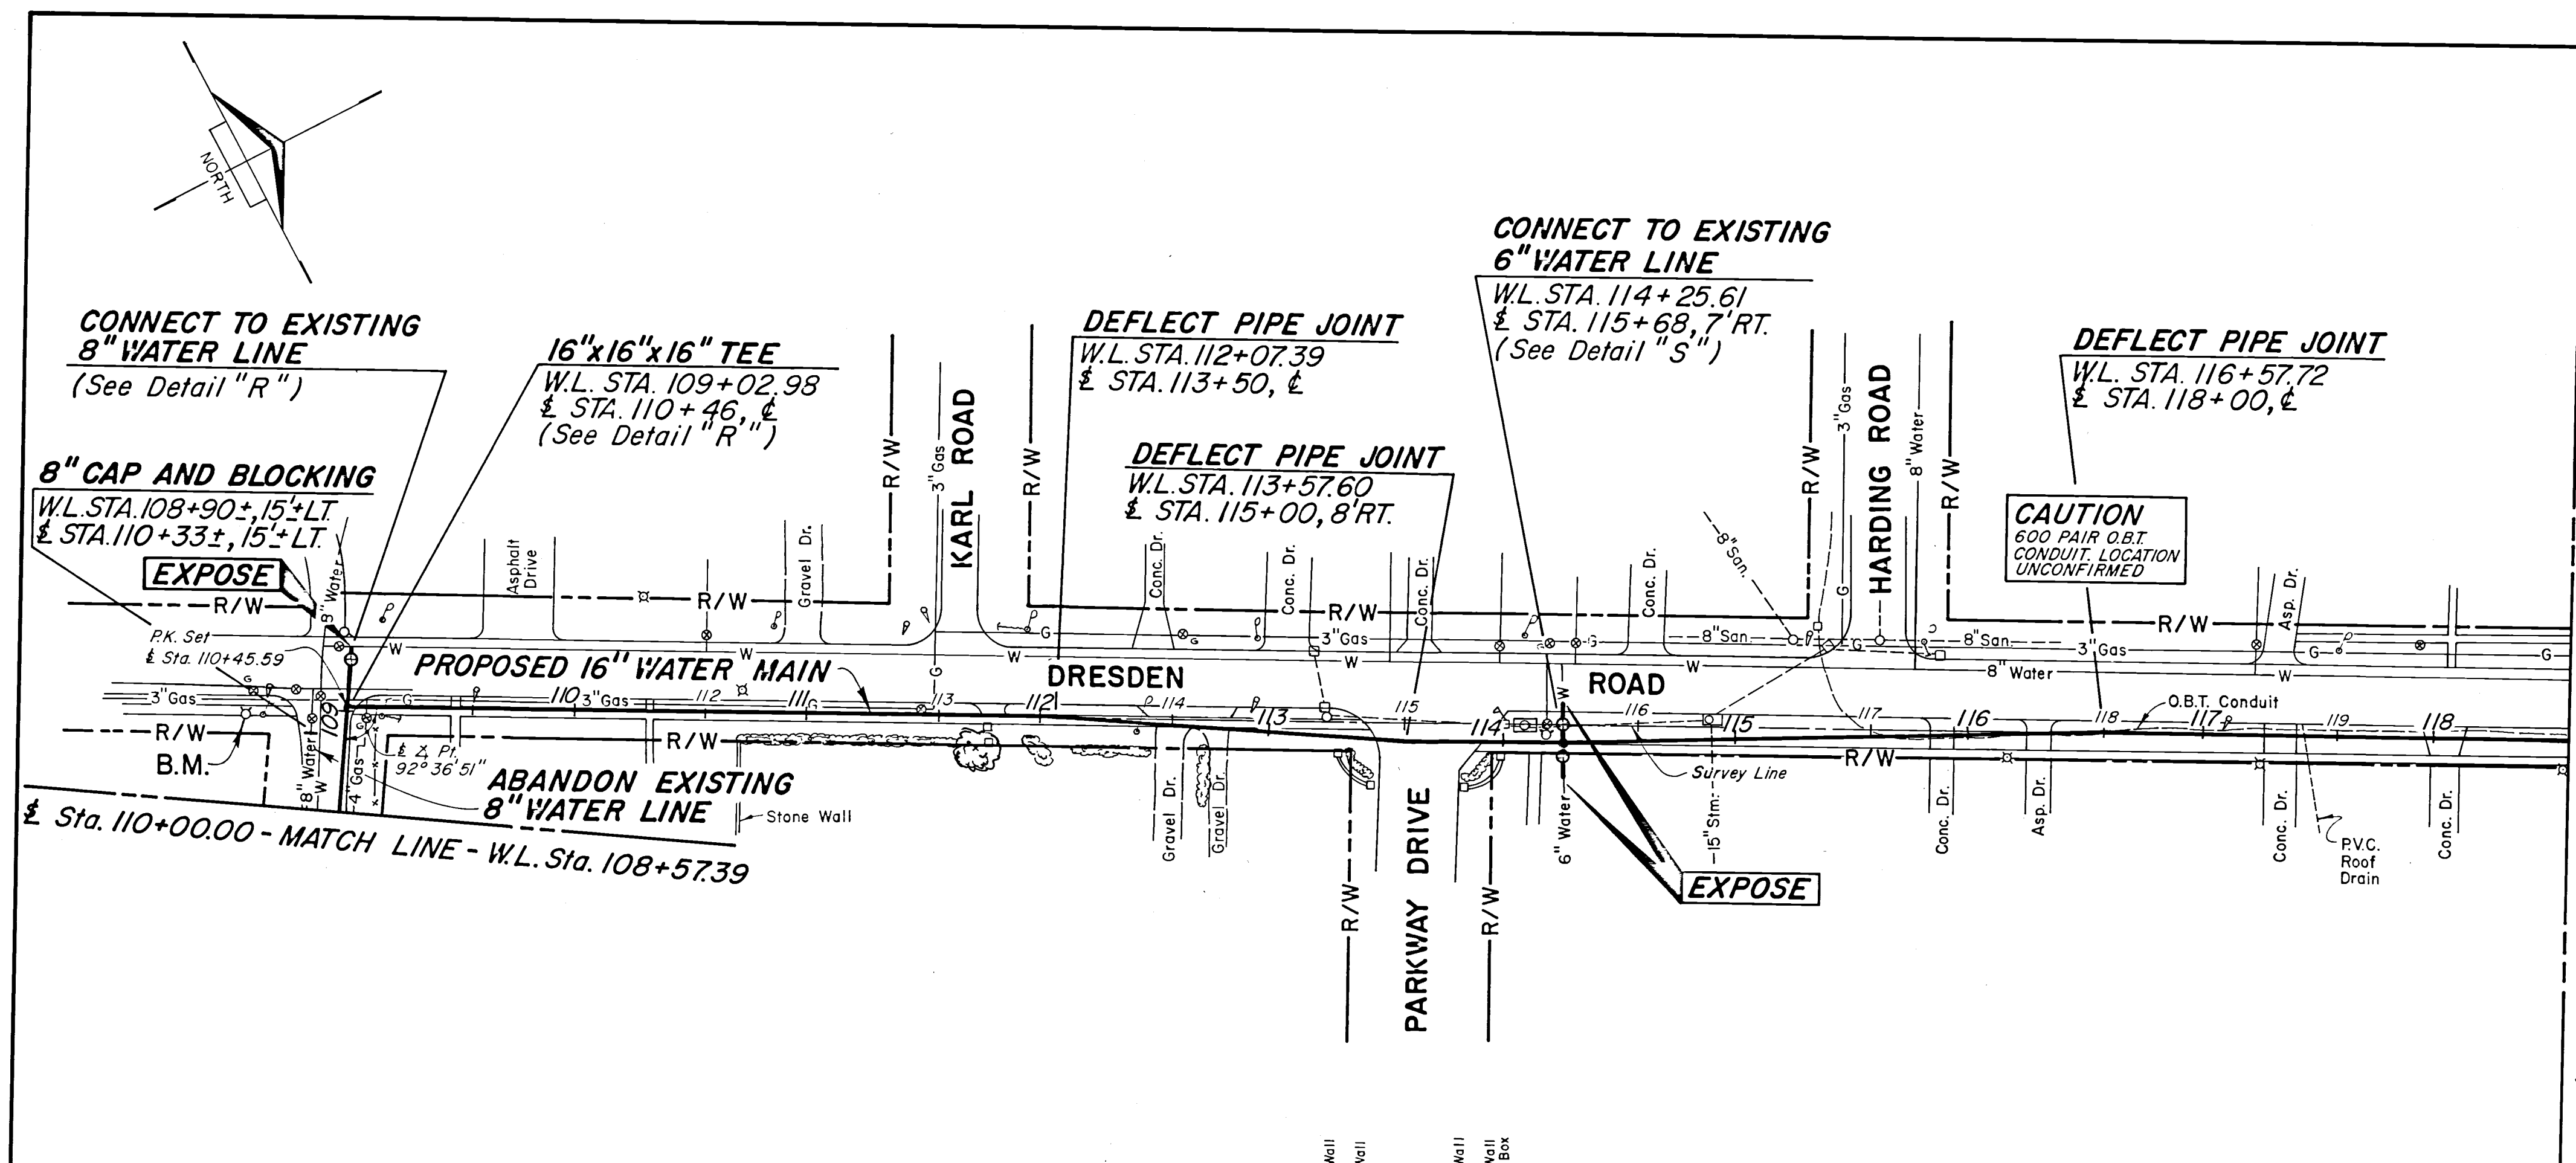


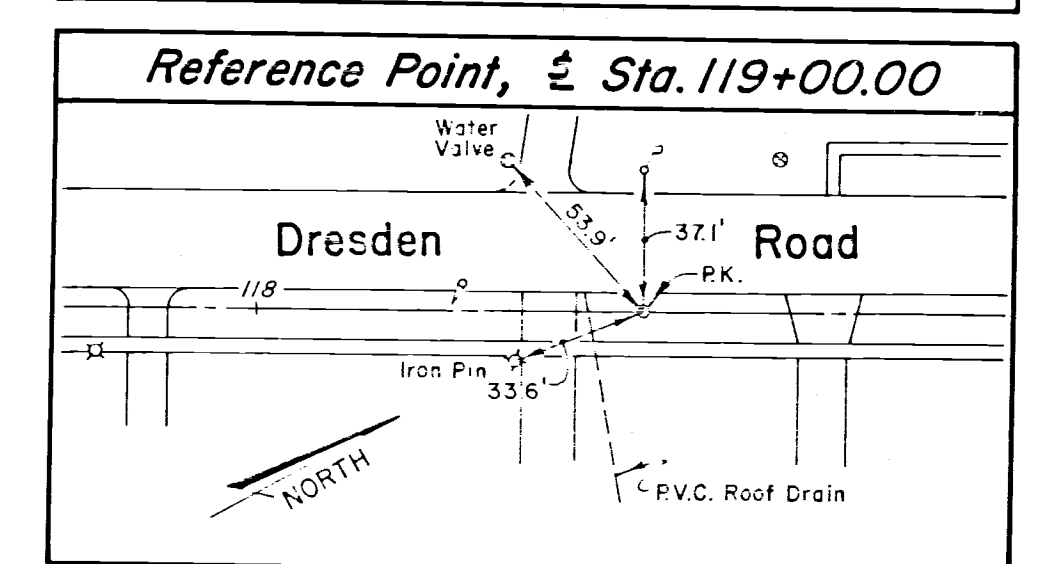

- NOTE #1**
All topographic information is located with respect to survey line stationing.
- NOTE #2**
No deflected pipe joint shall exceed 4° 30' or 17' of centerline deflection at 18 lineal feet.
- NOTE #3**
Contractor is to avoid existing utilities and structures by deflecting pipe joints.
- NOTE #4**
All water lines to be abandon shall be disconnected after the proposed water main is in use with all services functioning.

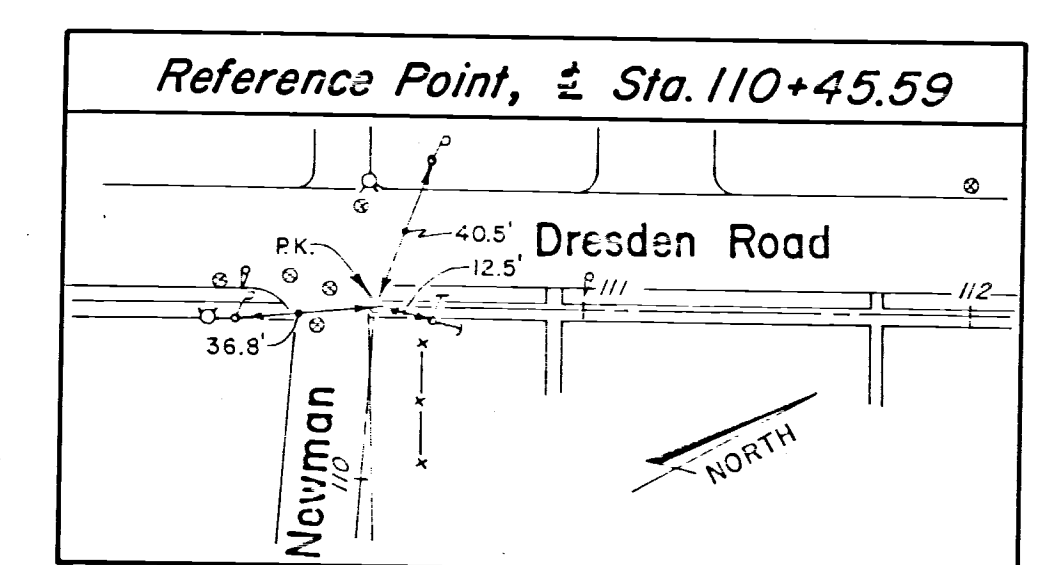

- BENCH MARK -
West bolt on fire hydrant South of the corner of Dresden Road and Newman Street.
Elev. 805.21

JOHN E. FOSTER AND ASSOCIATES, INC.
555 Buttlers Avenue, Columbus, Ohio 43215

CITY OF ZANESVILLE, OHIO
CENTRAL LINDEN TAYLOR
WATER MAIN
16" WATER MAIN
DRESDEN ROAD
Sta. 108+57.39 to Sta. 118+57.72

DESIGNED D.P.K.	DRAWN W.E.H.	TRACED W.E.H.	CHECKED E.L.F.	REVIEWED J.E.F.	DATE 6-10-88	REVISED
--------------------	-----------------	------------------	-------------------	--------------------	-----------------	---------