
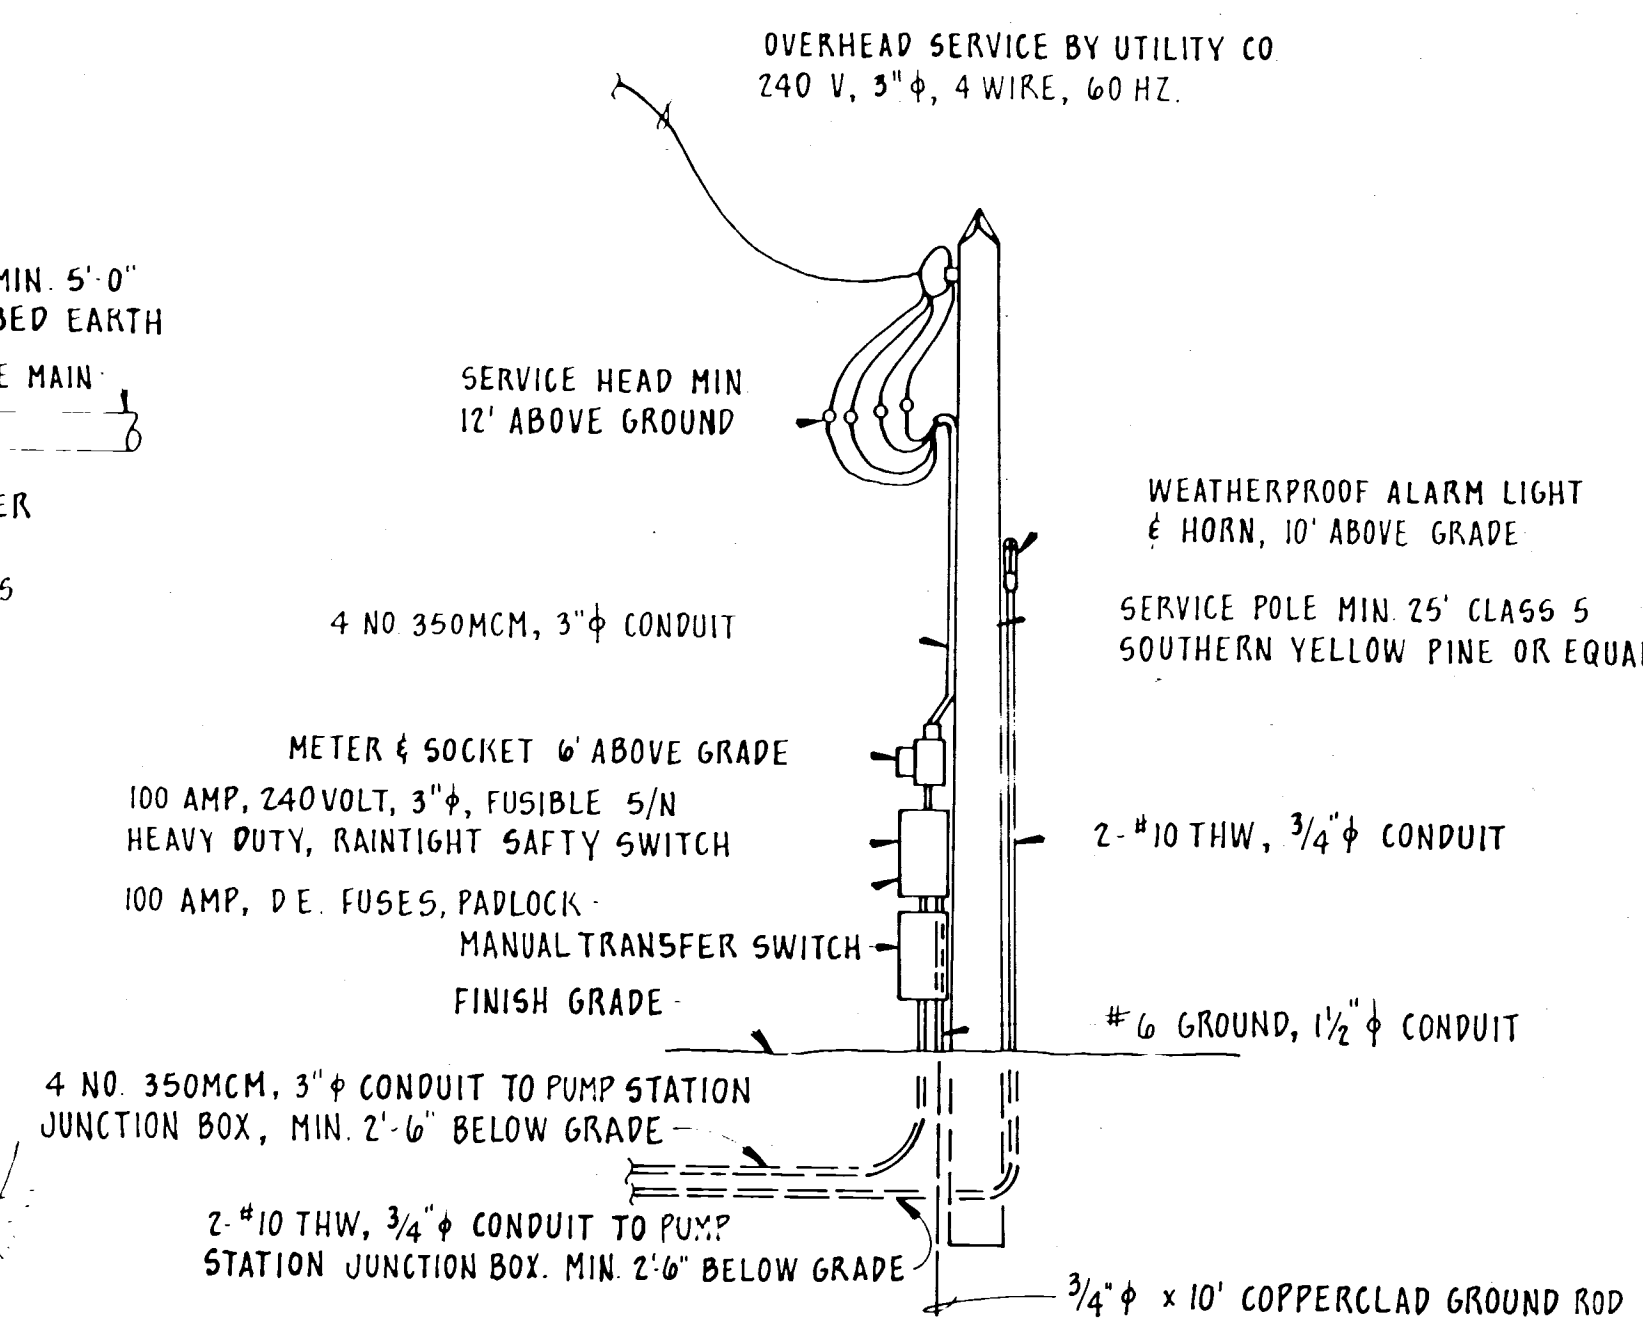
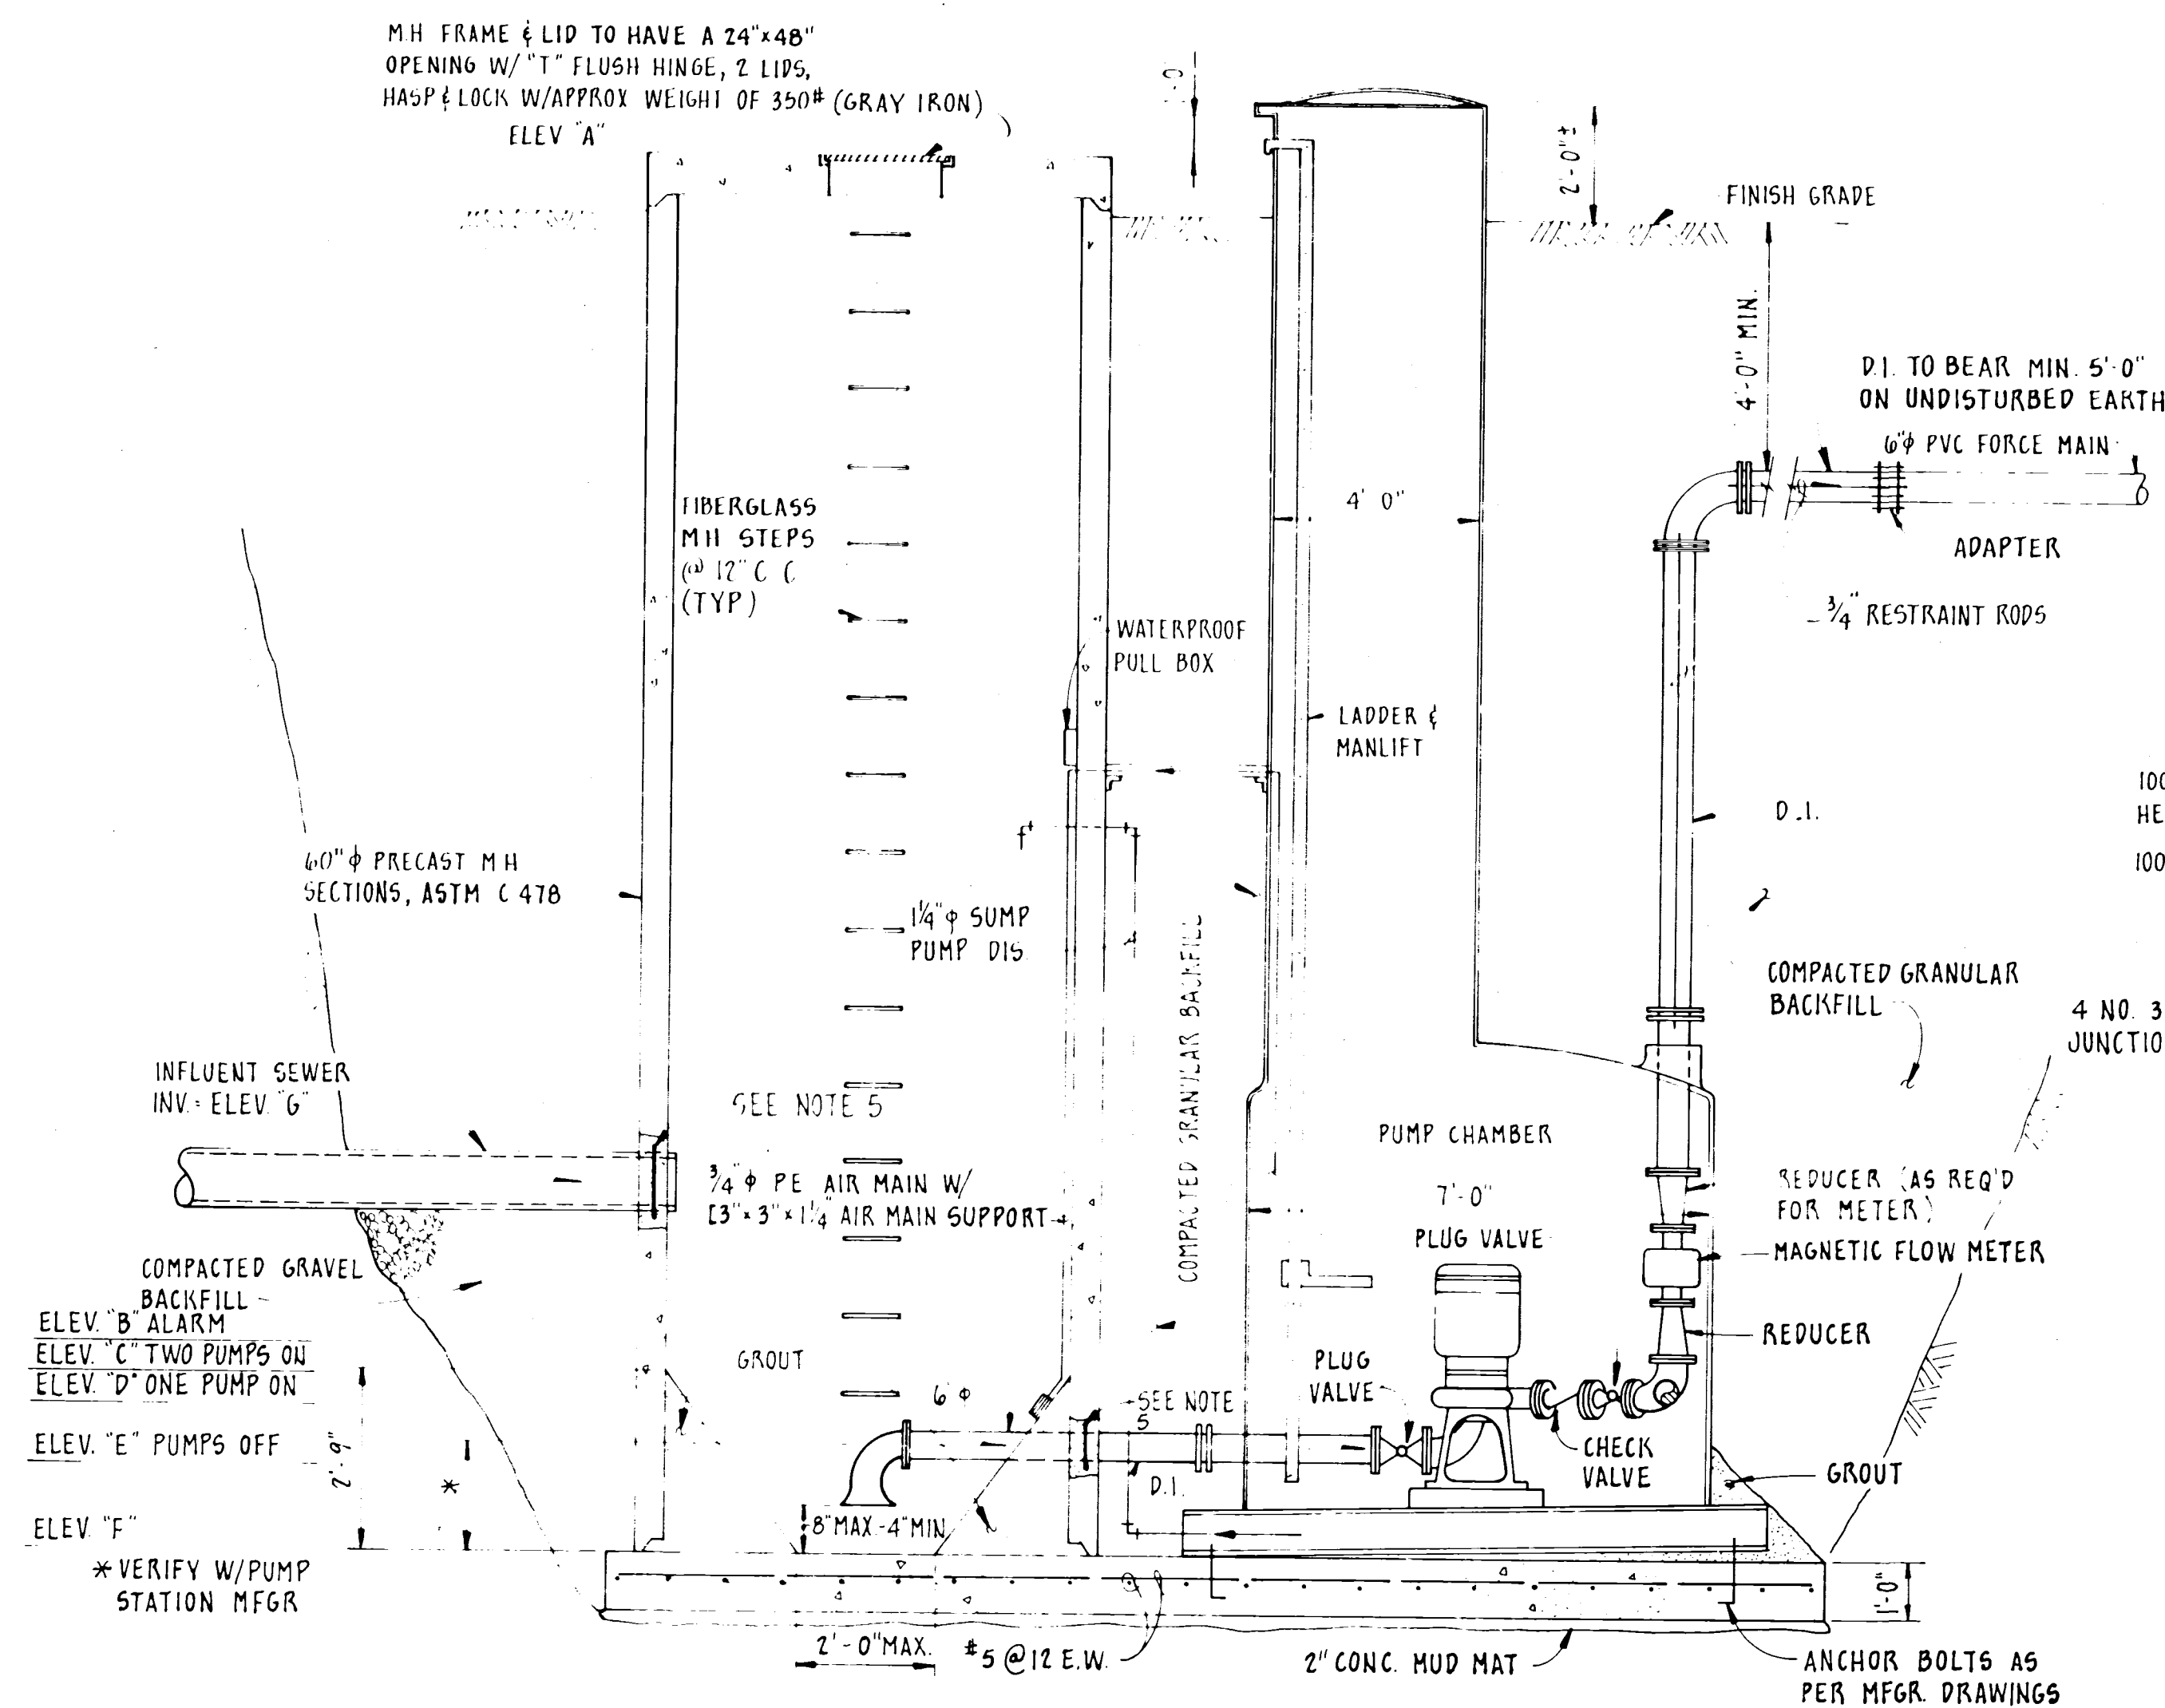
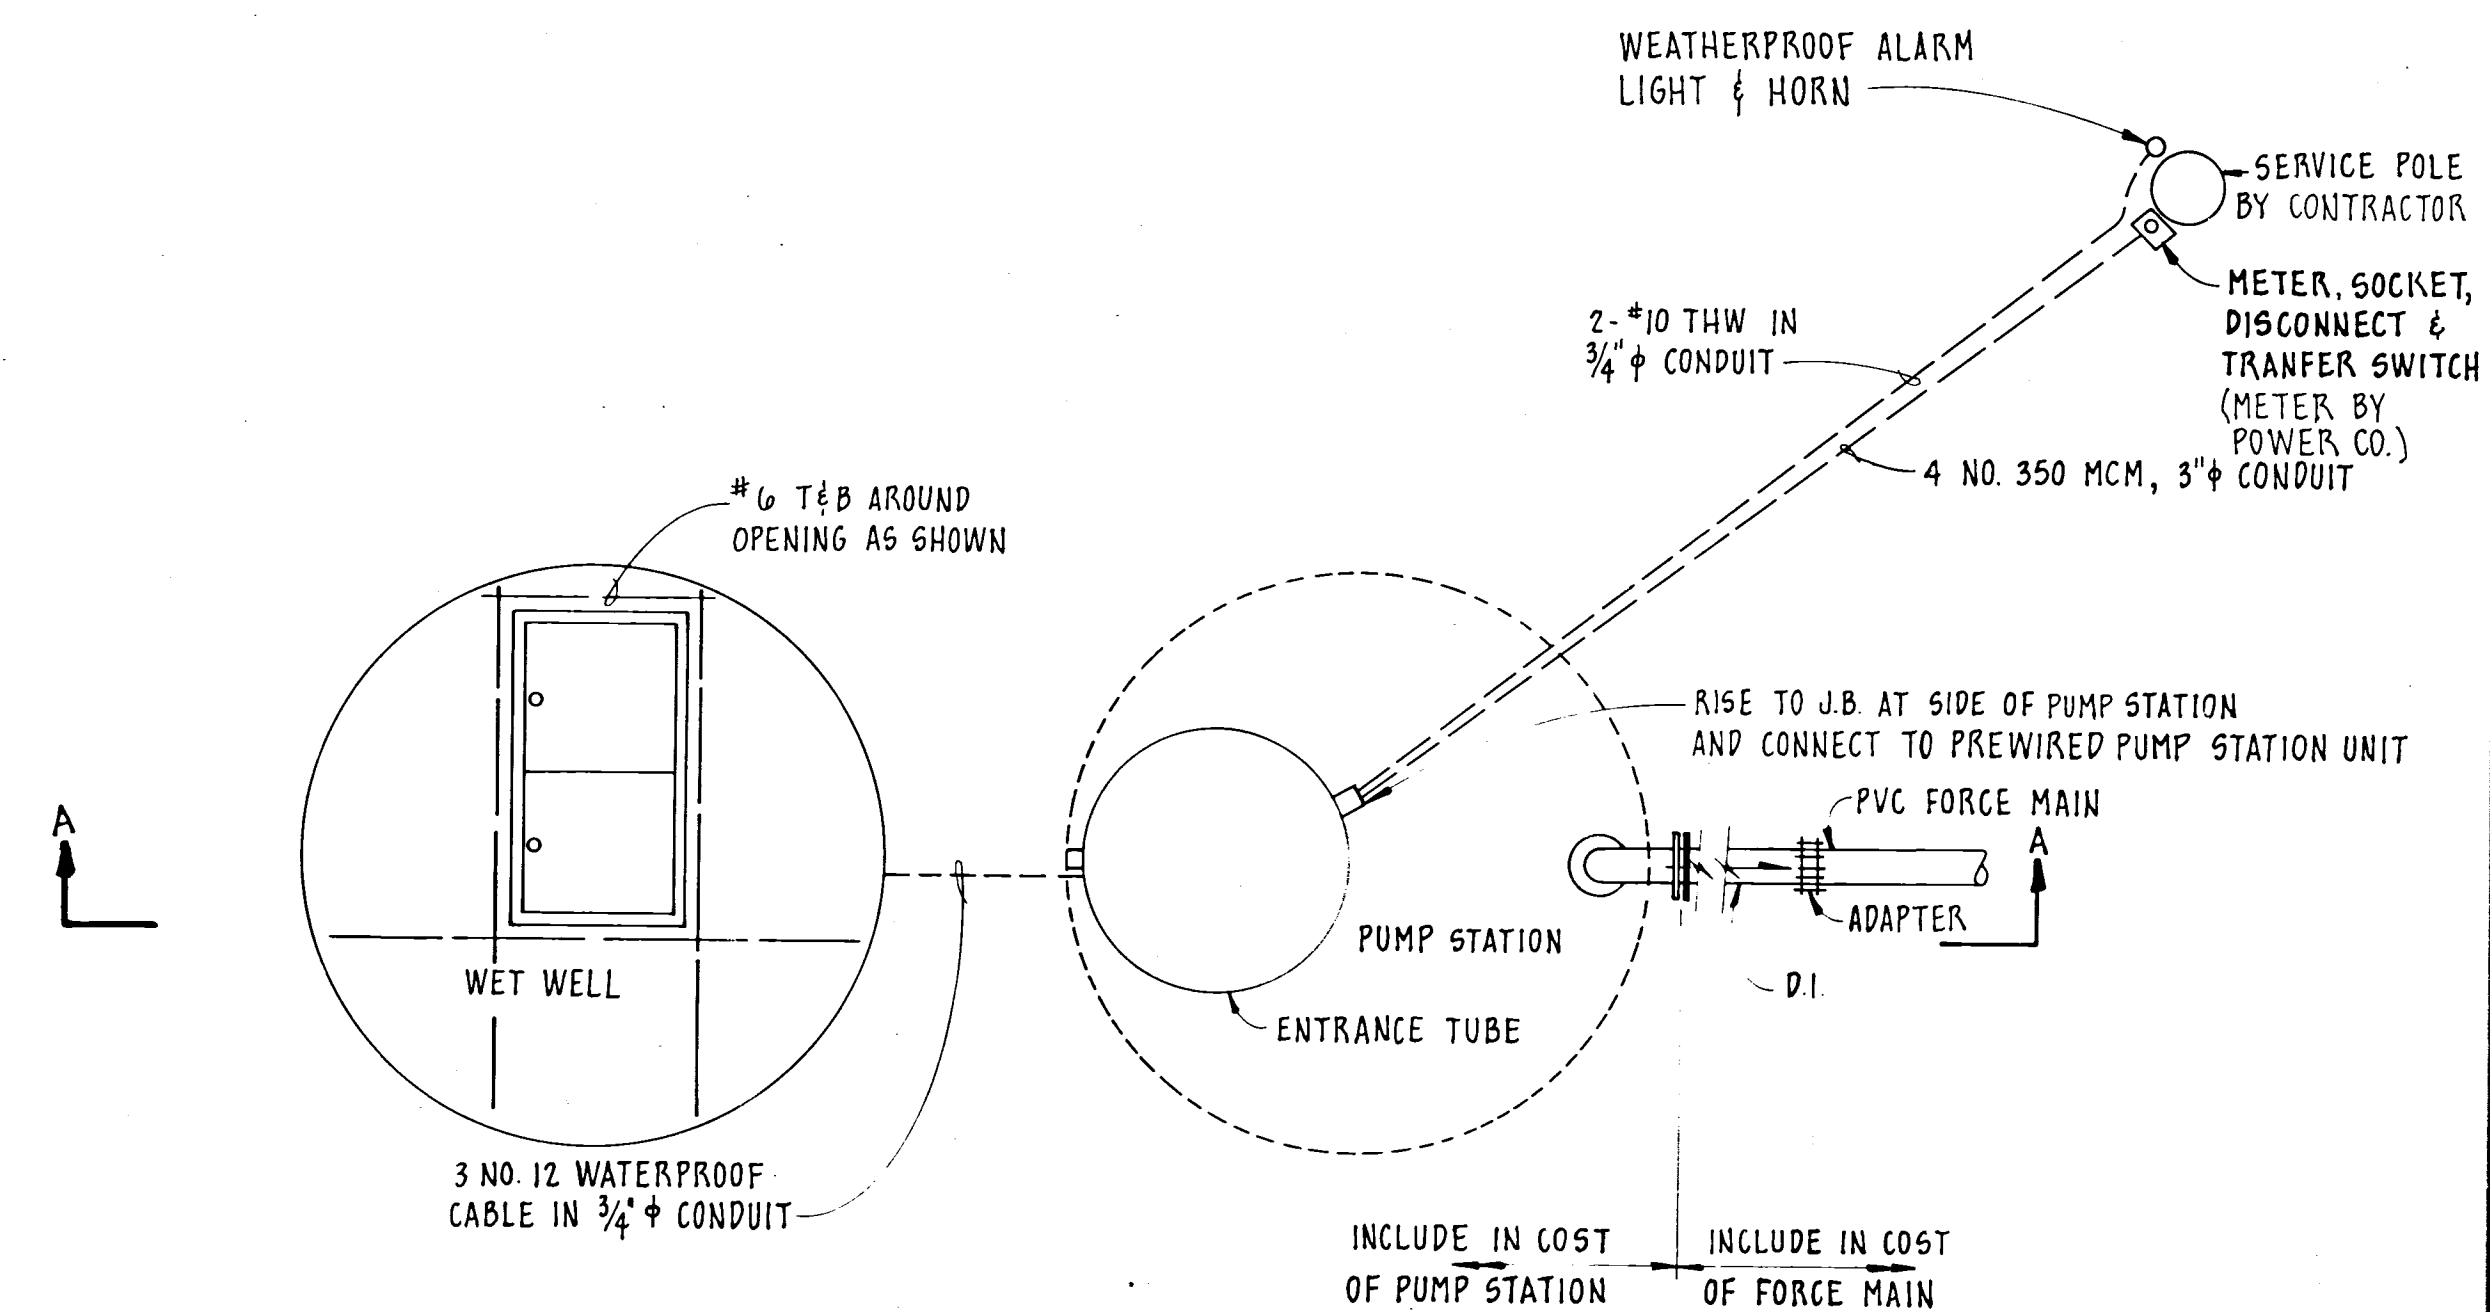


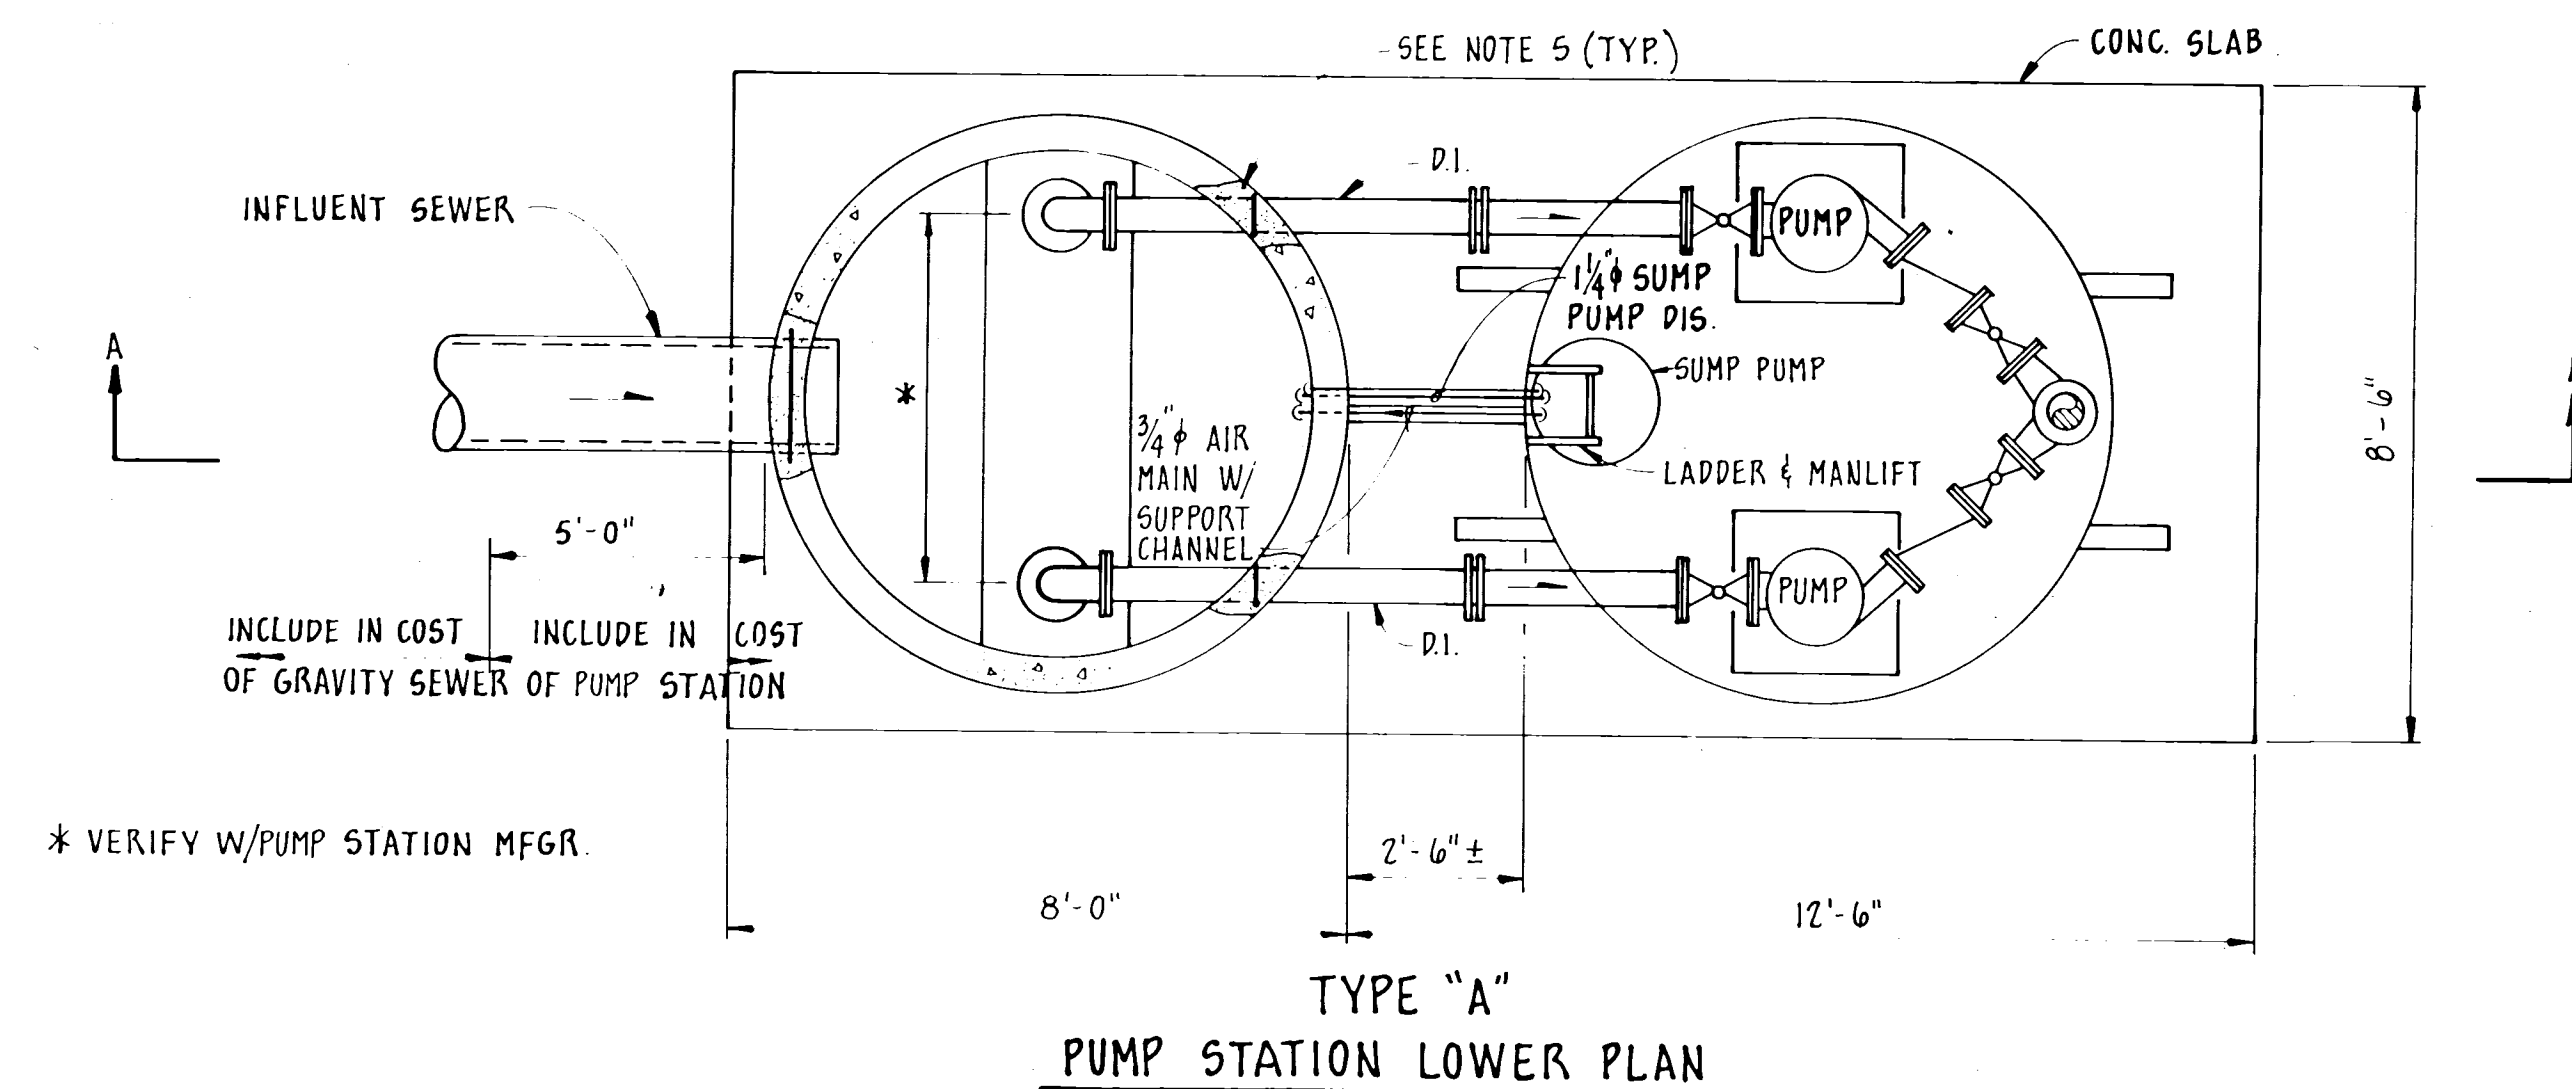

- NOTES:
1. ALL ELECTRICAL WORK TO BE IN ACCORDANCE W/STATE AND NATIONAL ELECTRICAL CODES.
 2. ALL COSTS FOR THE ELECTRICAL SERVICE BY THE UTILITY CO ARE TO BE INCLUDED IN THE CONTRACTORS BID PRICE FOR THE STATION
 3. INLET SEWERS, FORCE MAIN DISCHARGE AND ELECTRICAL CONDUITS TO BE ORIENTED AS PER THE PLAN LOCATION SHEET.
 4. MANUAL TRANSFER SWITCH TO BE 100 AMPERE, 240 VOLT, 3PDT NON-FUSED, HEAVY DUTY, NEEMA 3R SAFTY SWITCH W/4 CLAMP TYPE TERMINALS FOR NO. 3/0 MIN CABLE.
 5. PROVIDE RUBBER GASKETS ON PIPE THROUGH MANHOLE WALL, GROUT IN PLACE W/NON SHRINK GROUT.

[illegible]