



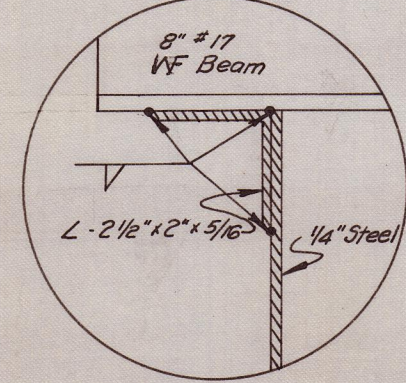


DETAIL "B"

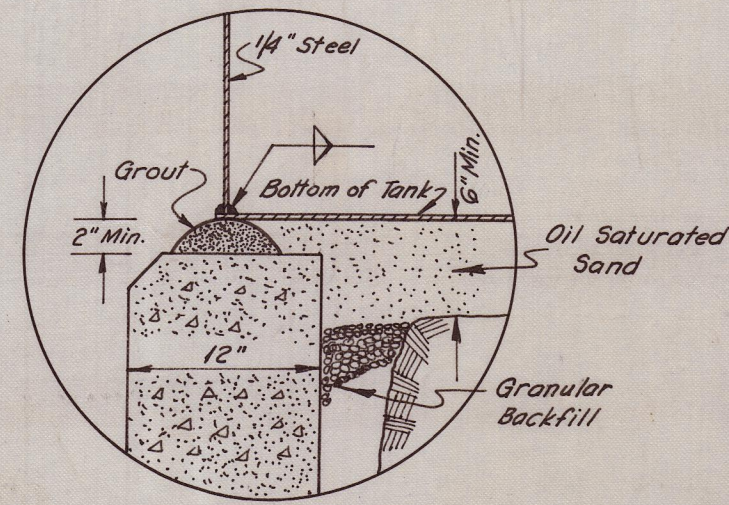


DETAIL "A"


NOTE: Two (2) existing 8" Dia. Influo Type R Filters to be emptied and reset in new location with new filter media.

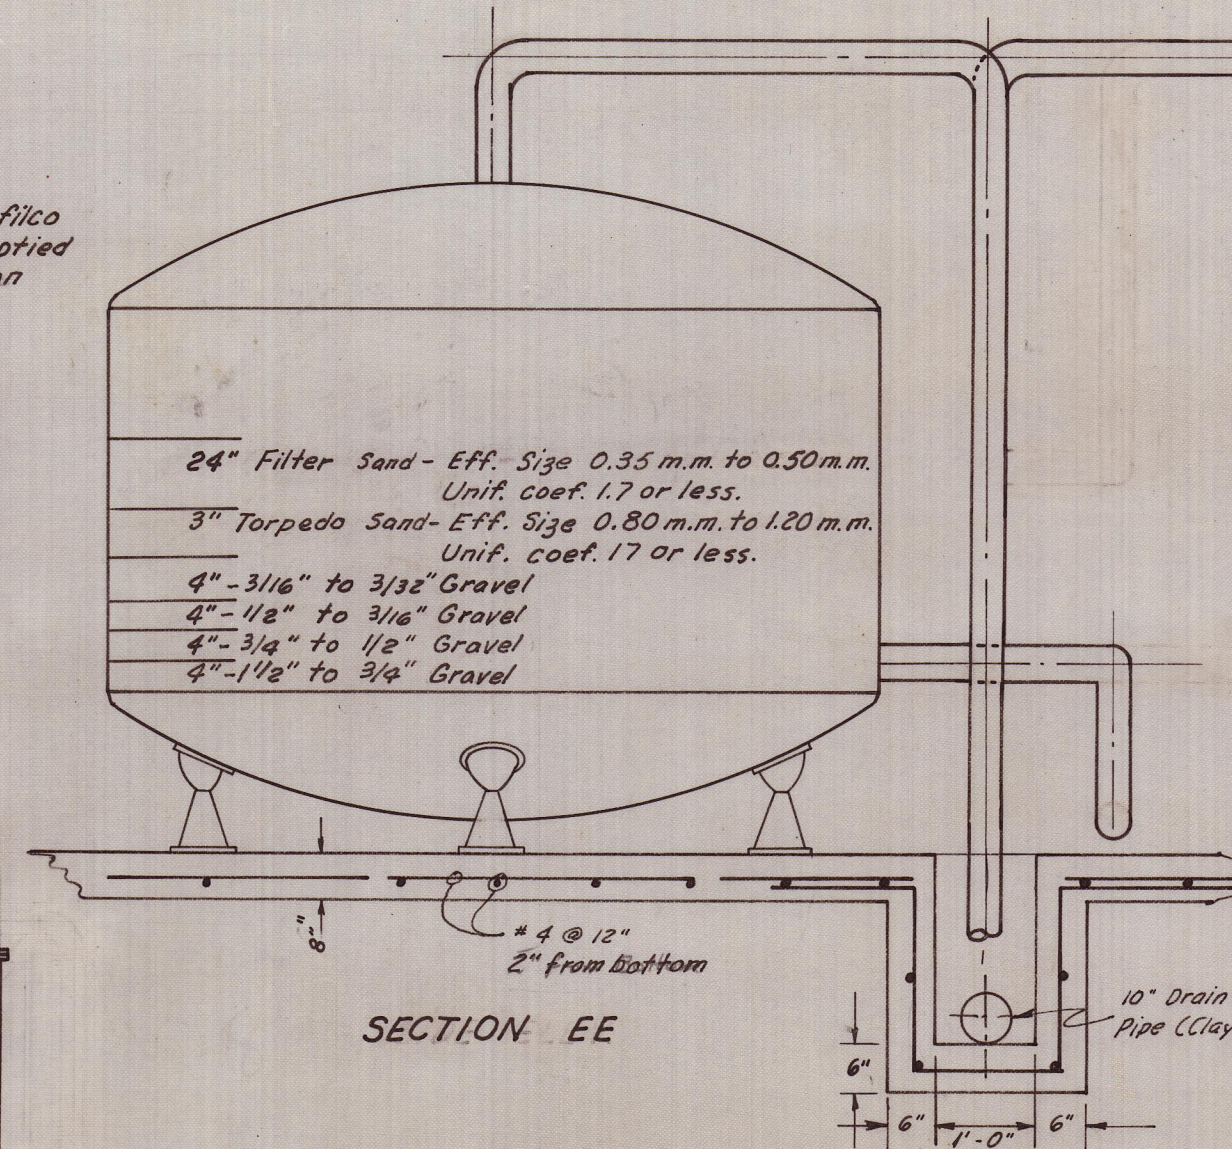


SECTION EE

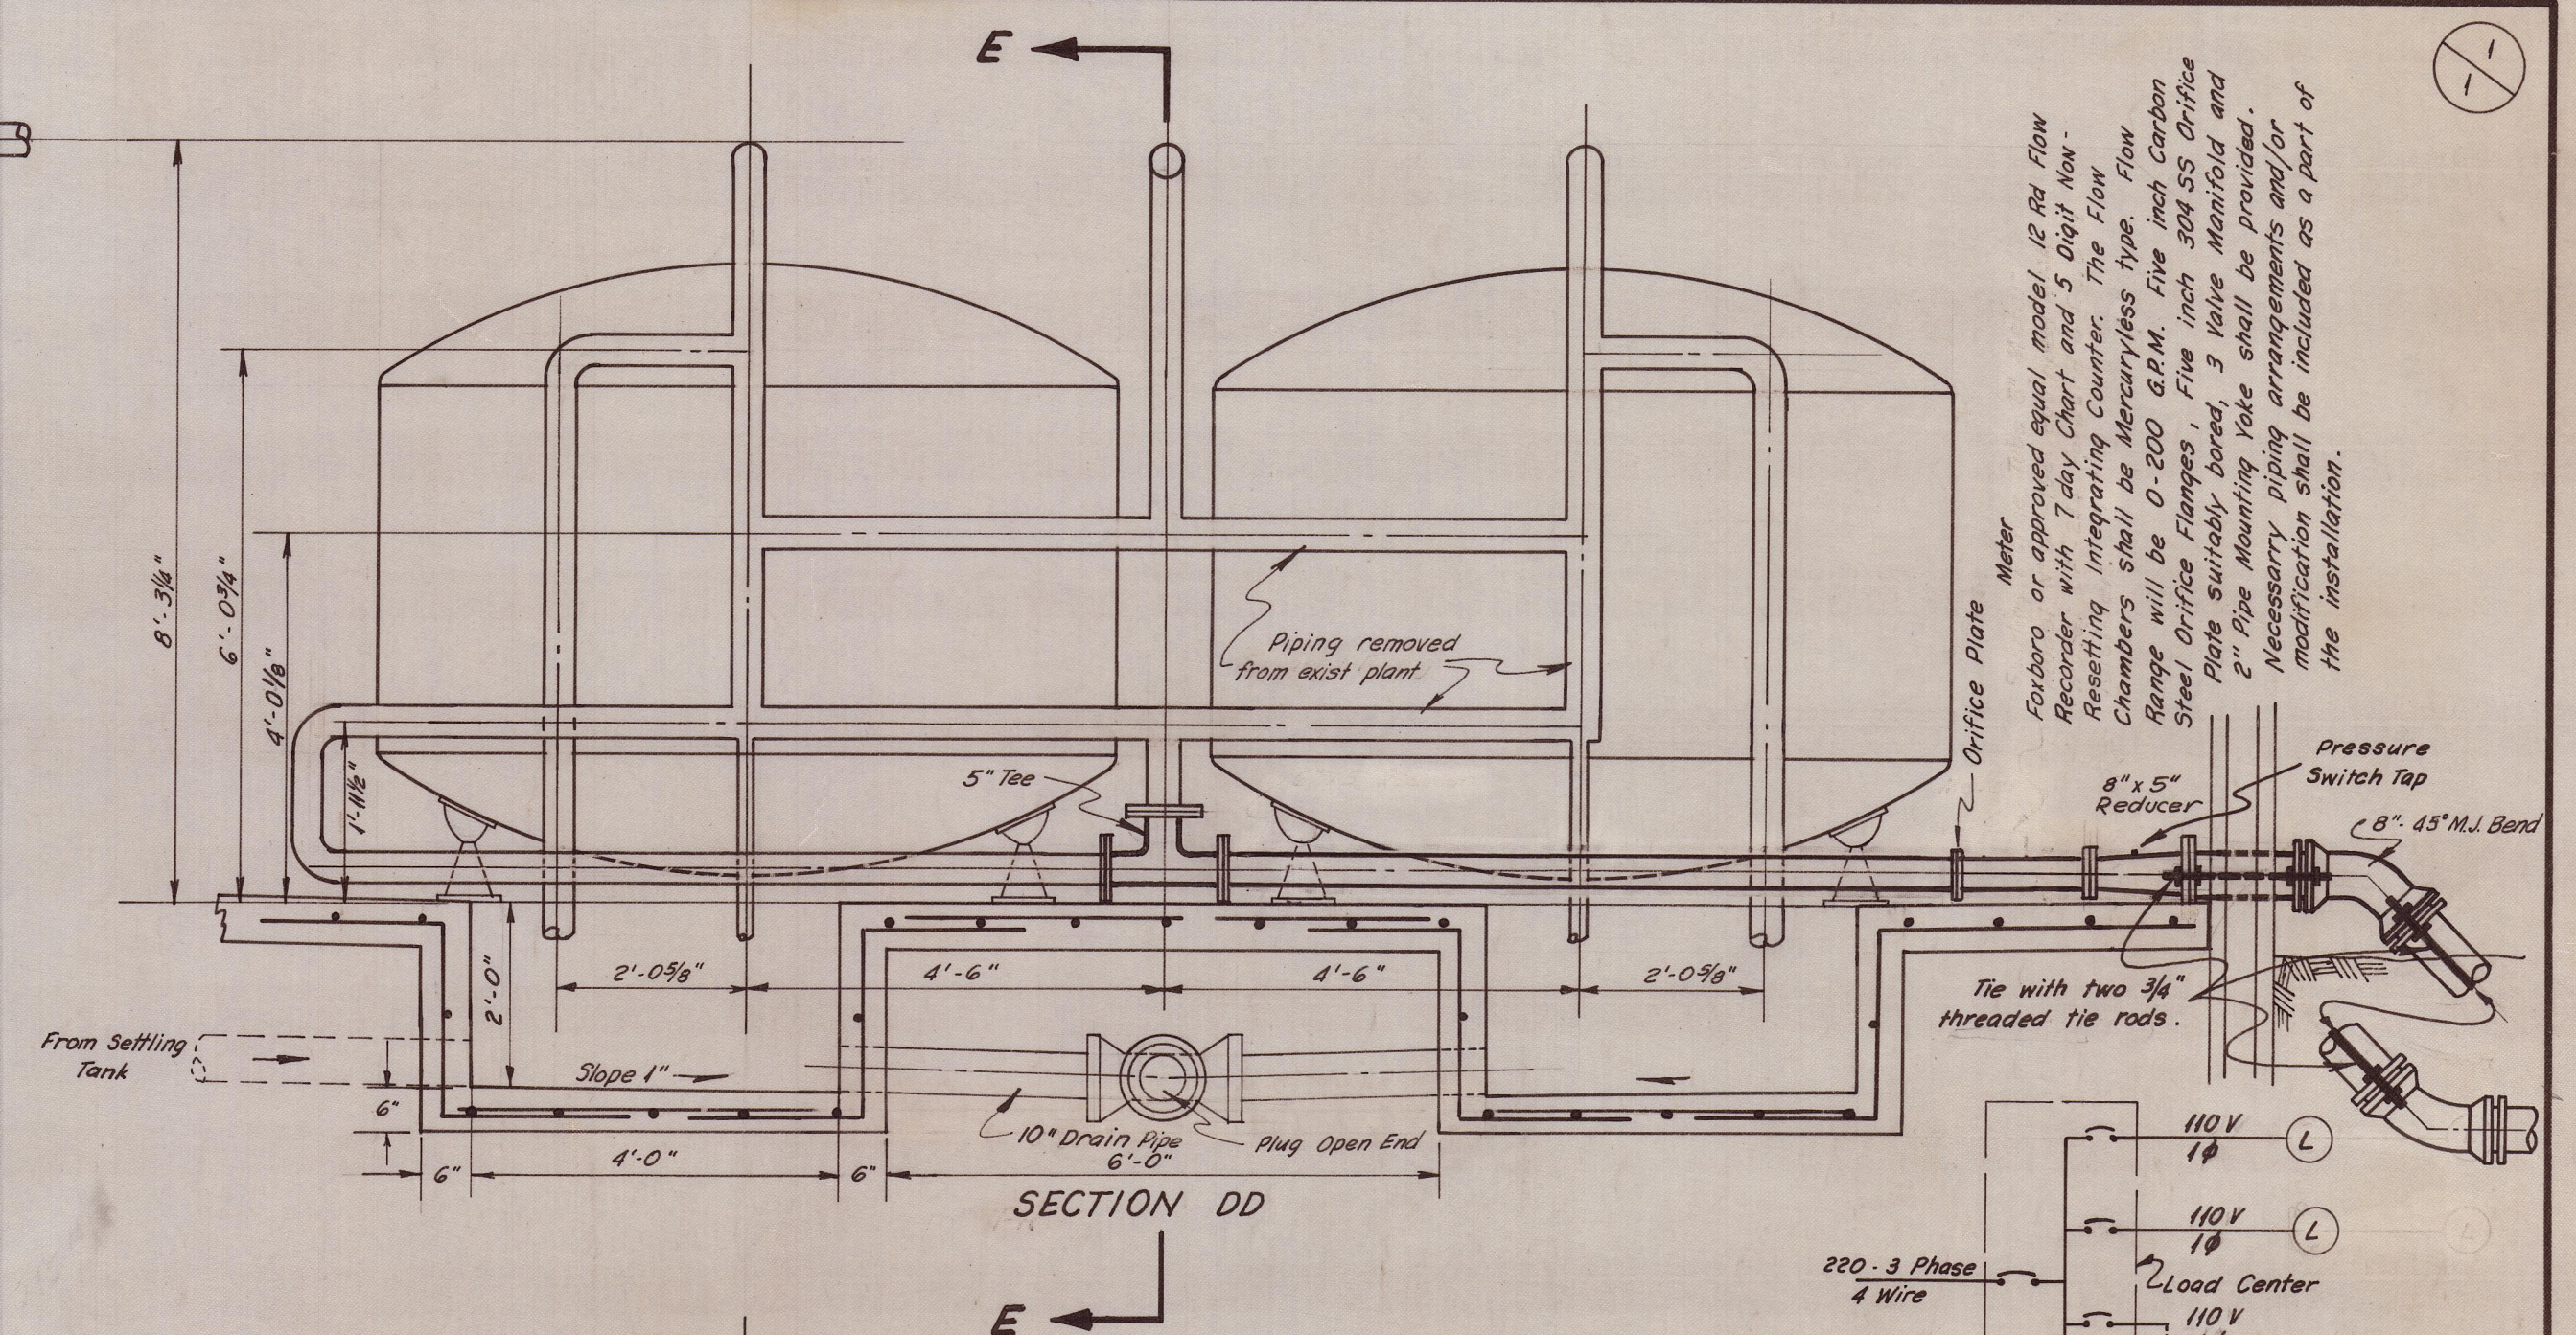


SECTION DD

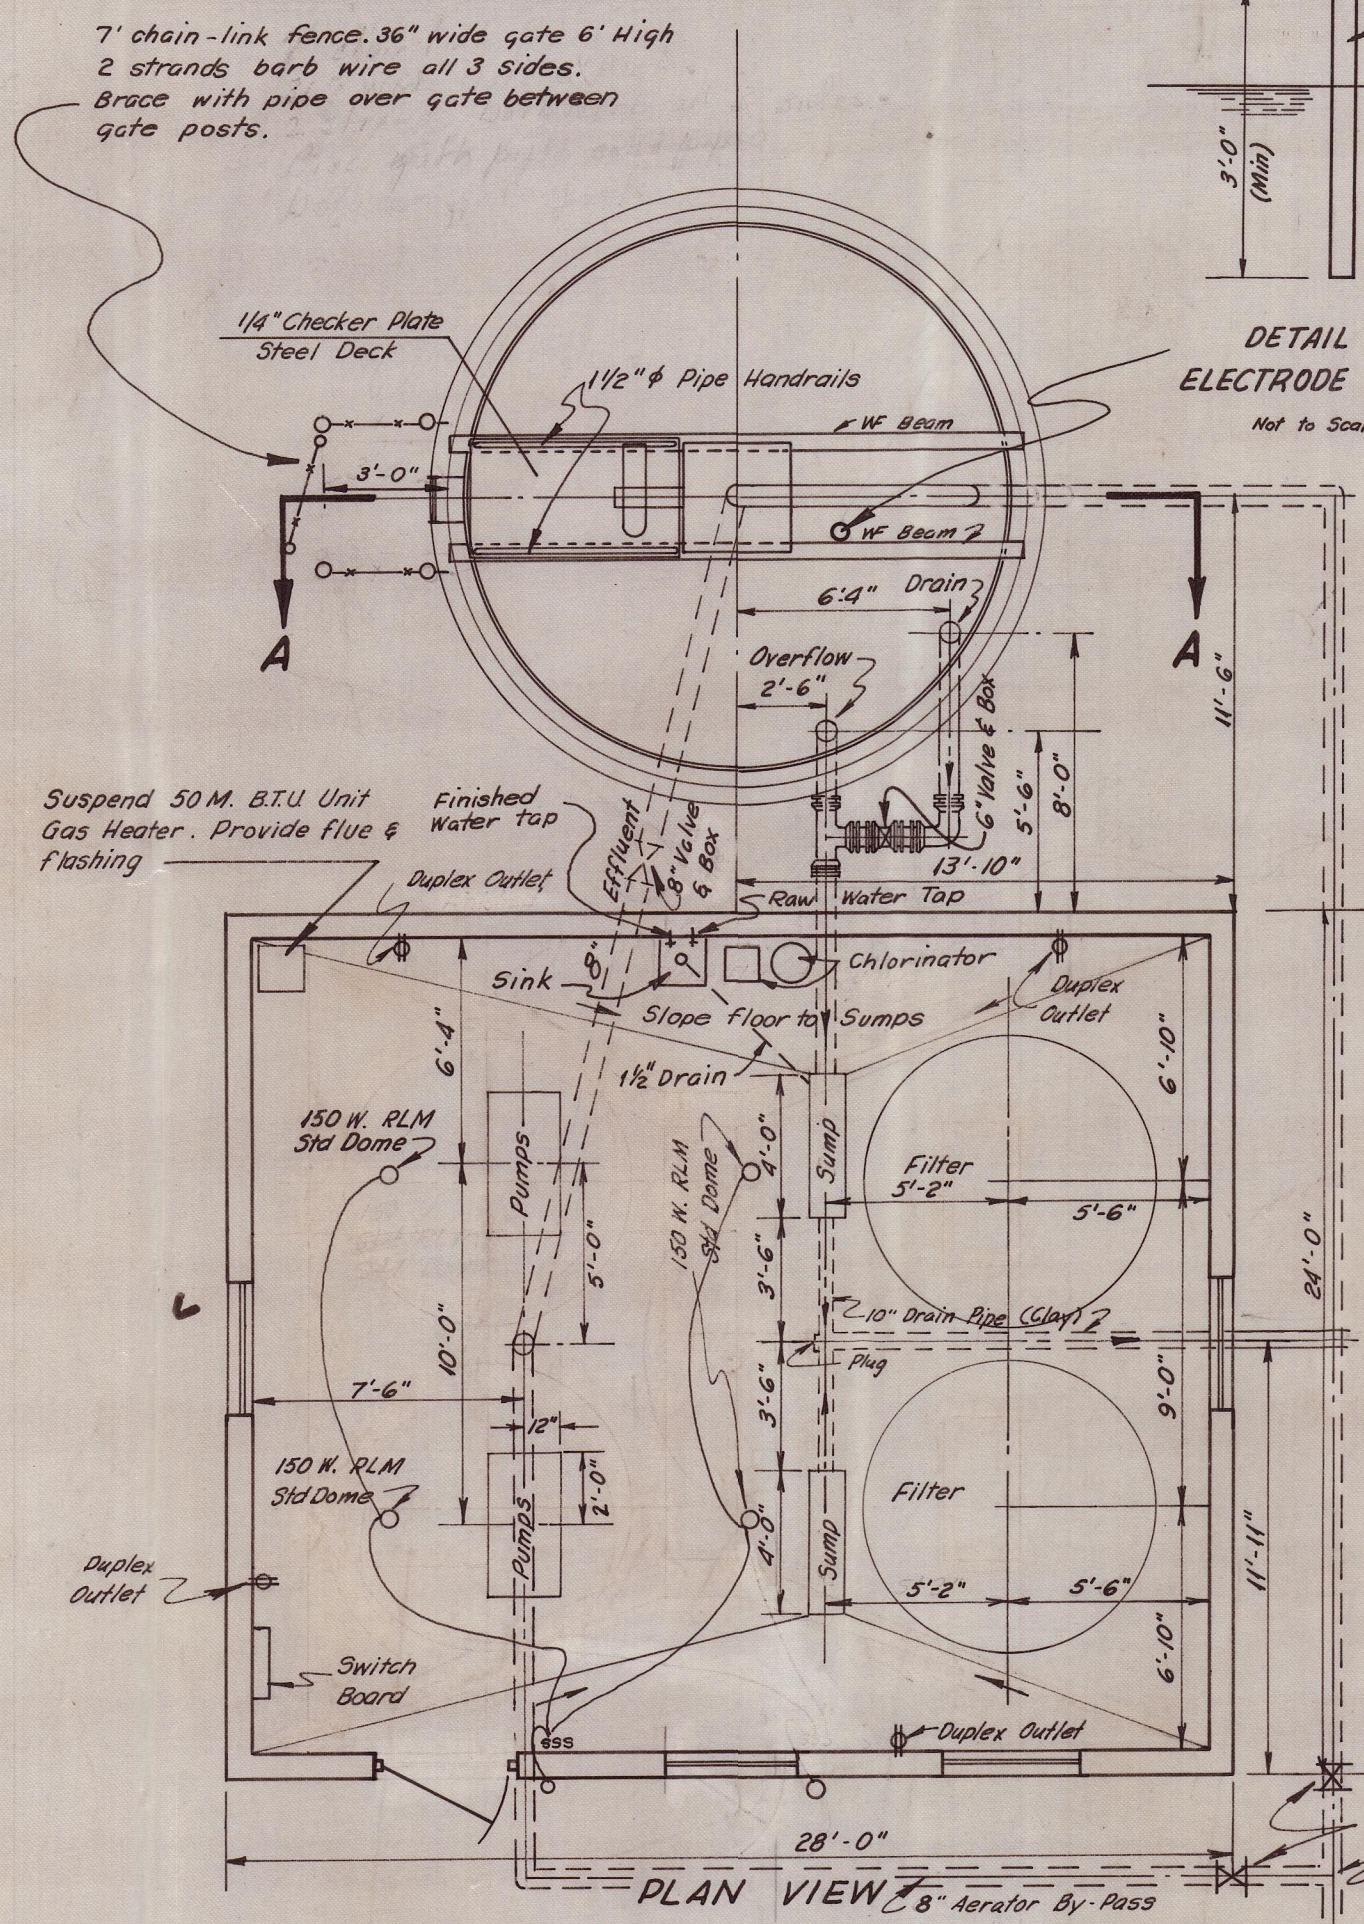

PLAN VIEW

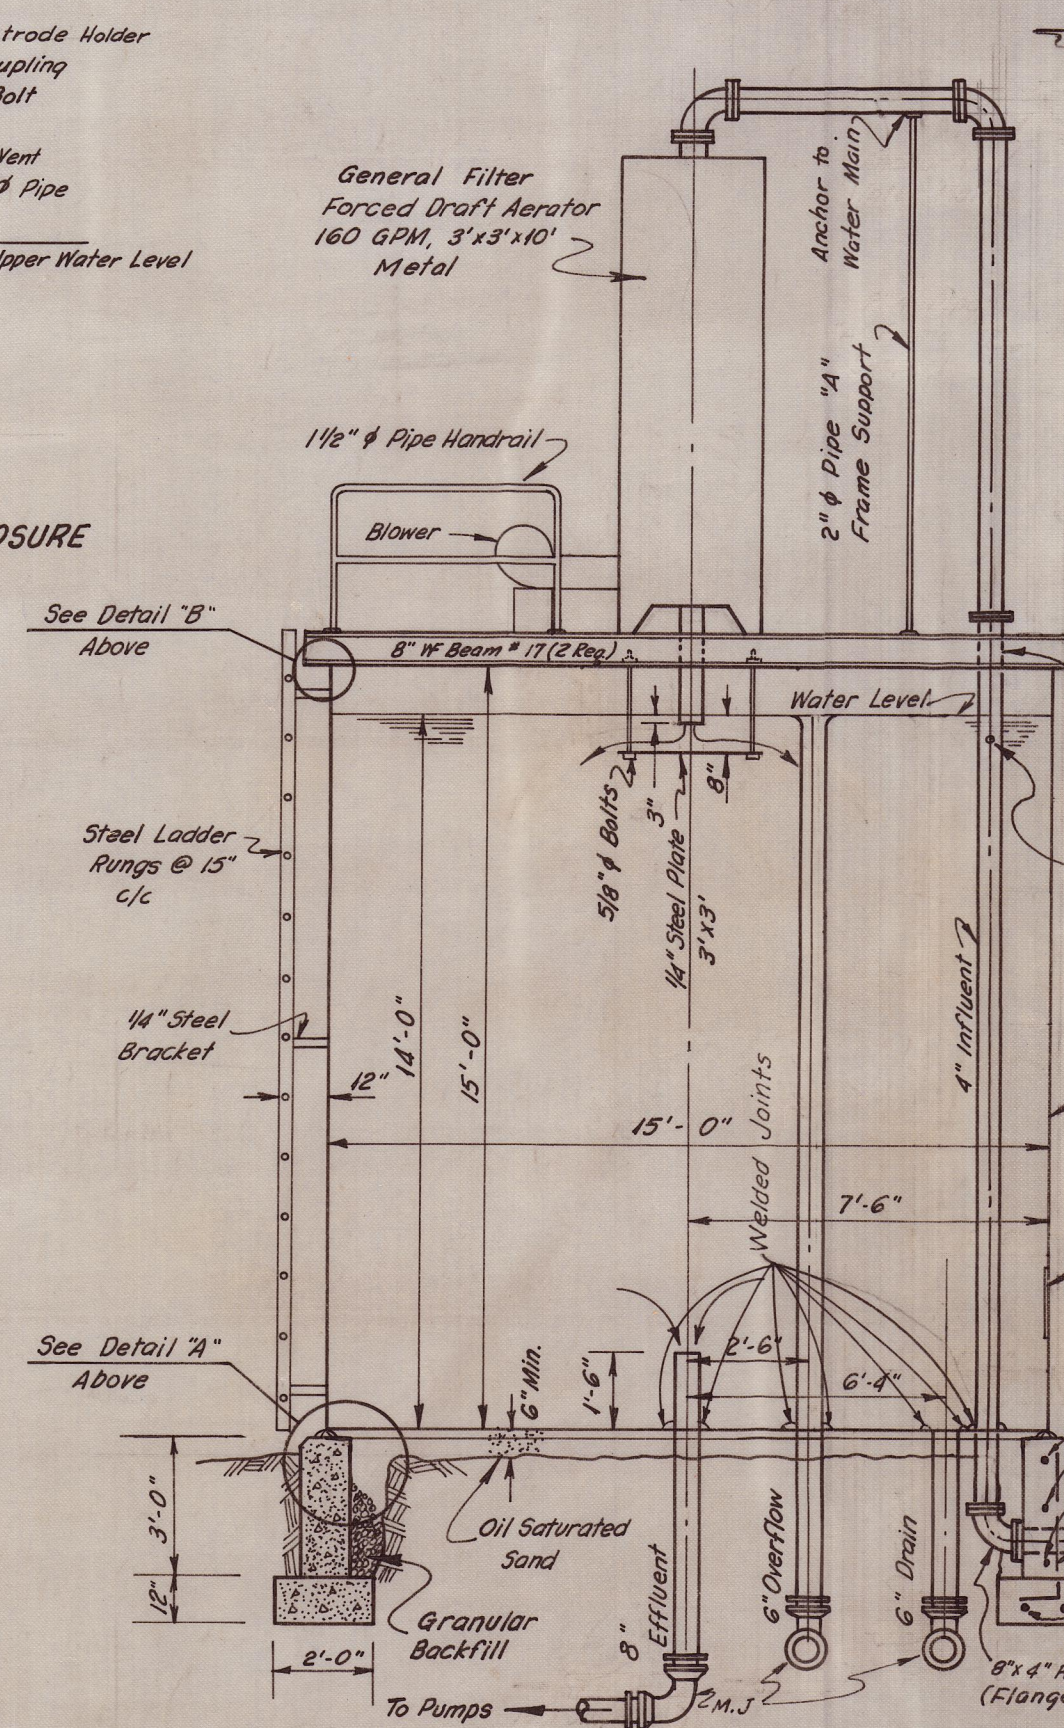


SETTLING TANK SECTION AA

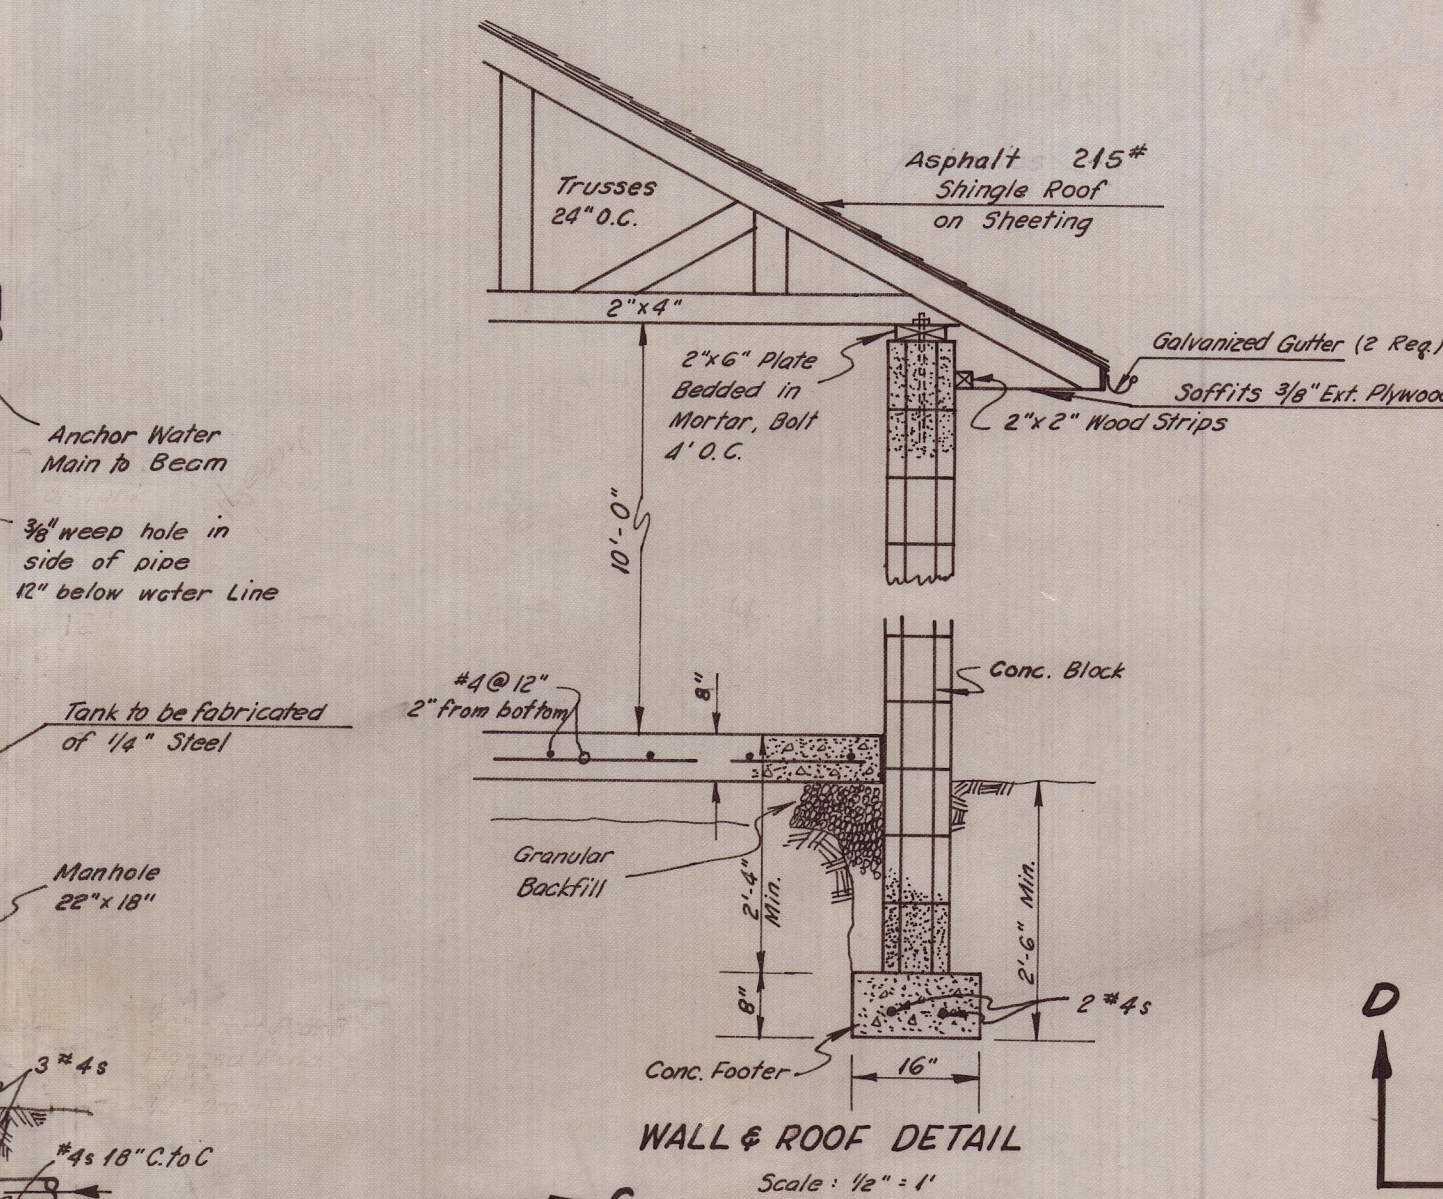


WALL & ROOF DETAIL


PLAN VIEW
FILTER TANKS
& PIPING

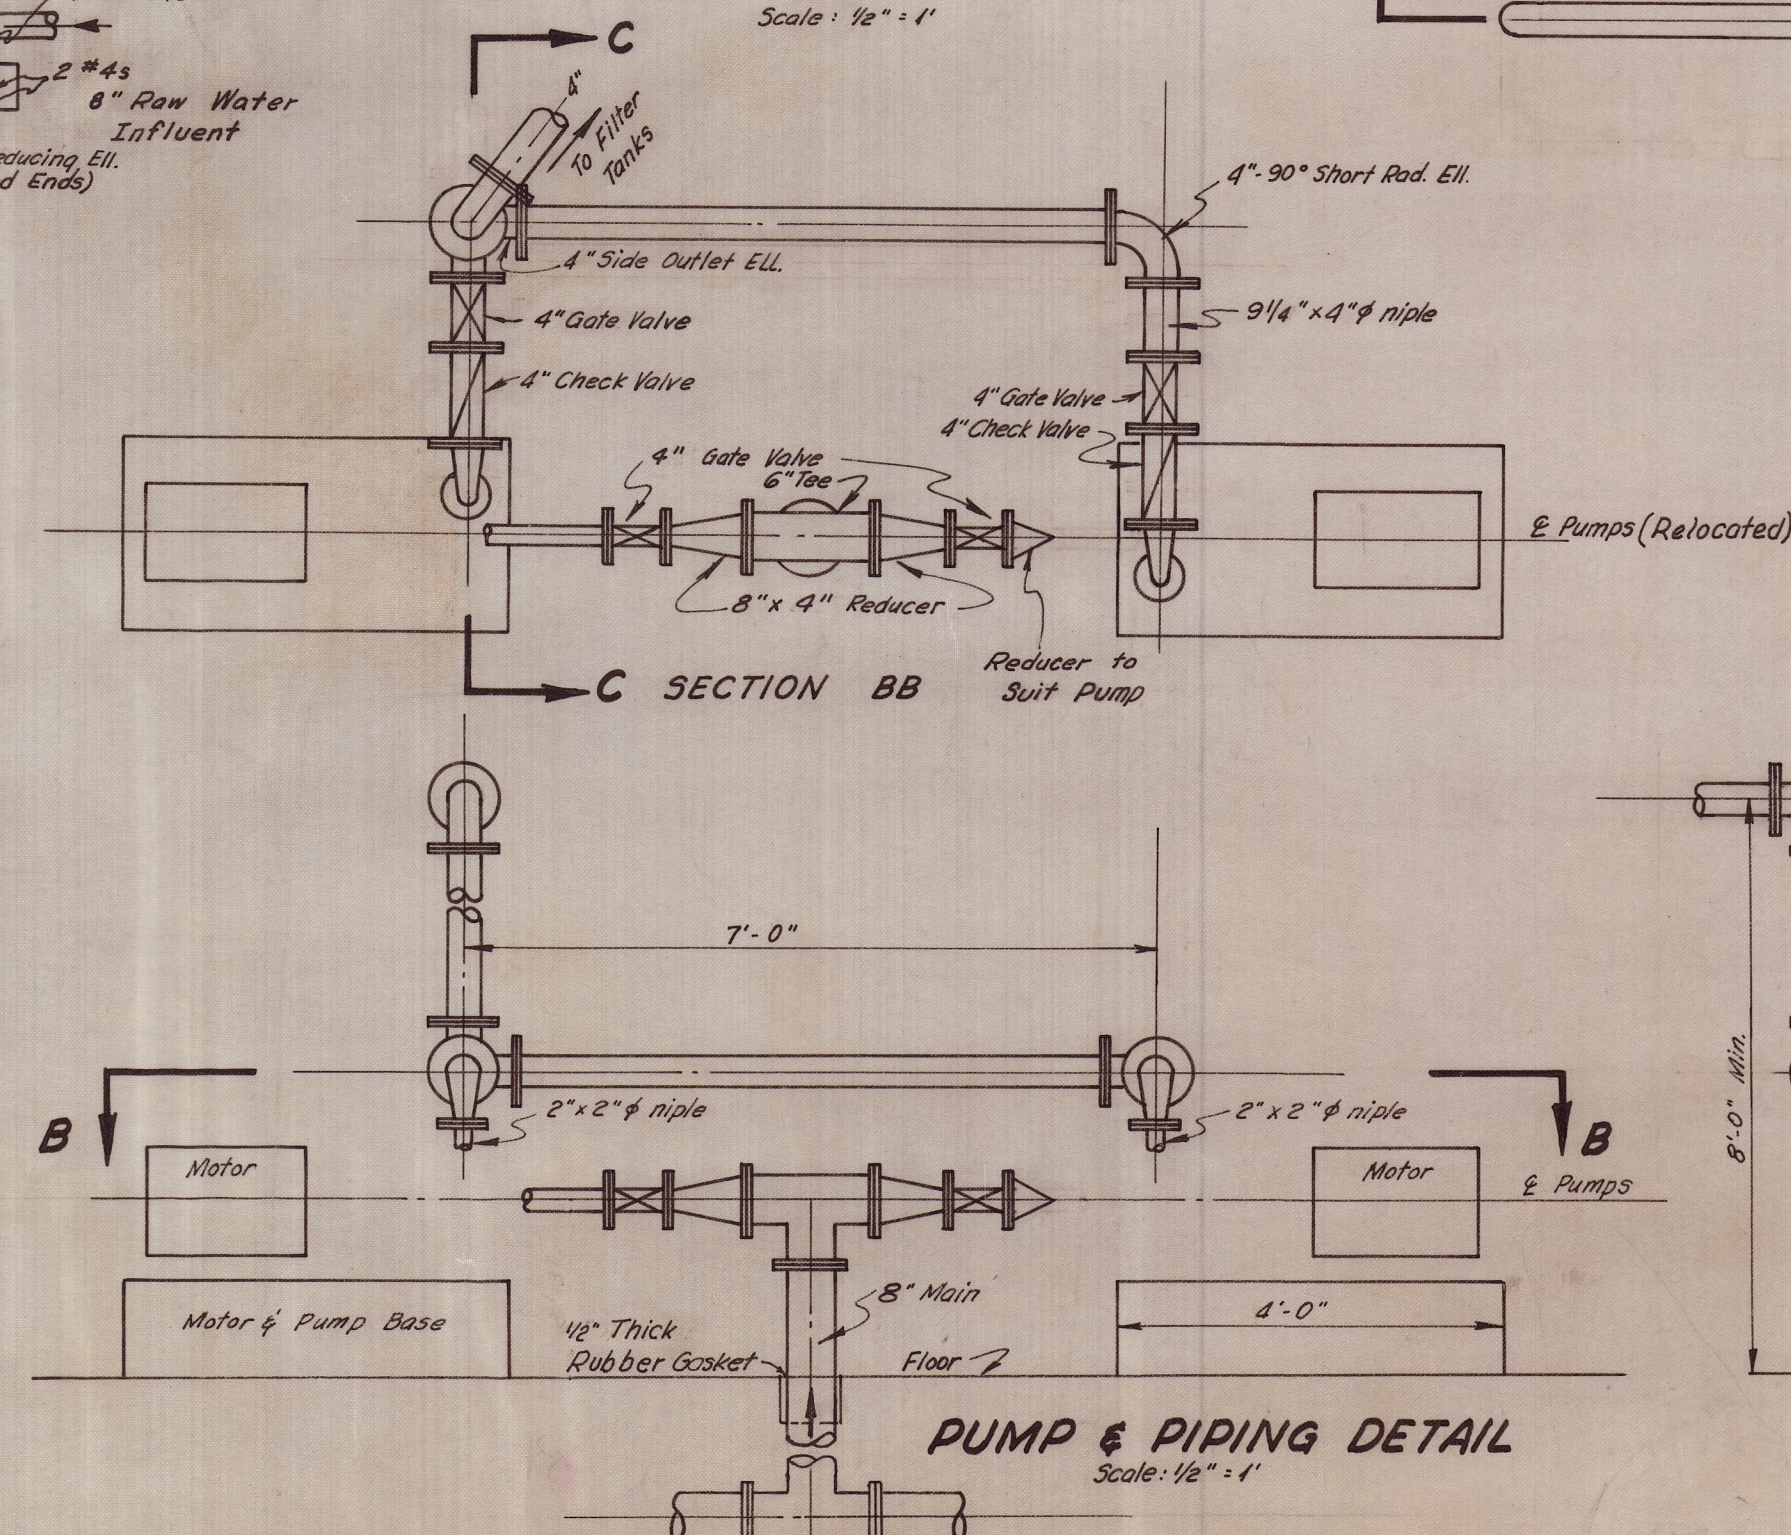

PUMP & PIPING DETAIL

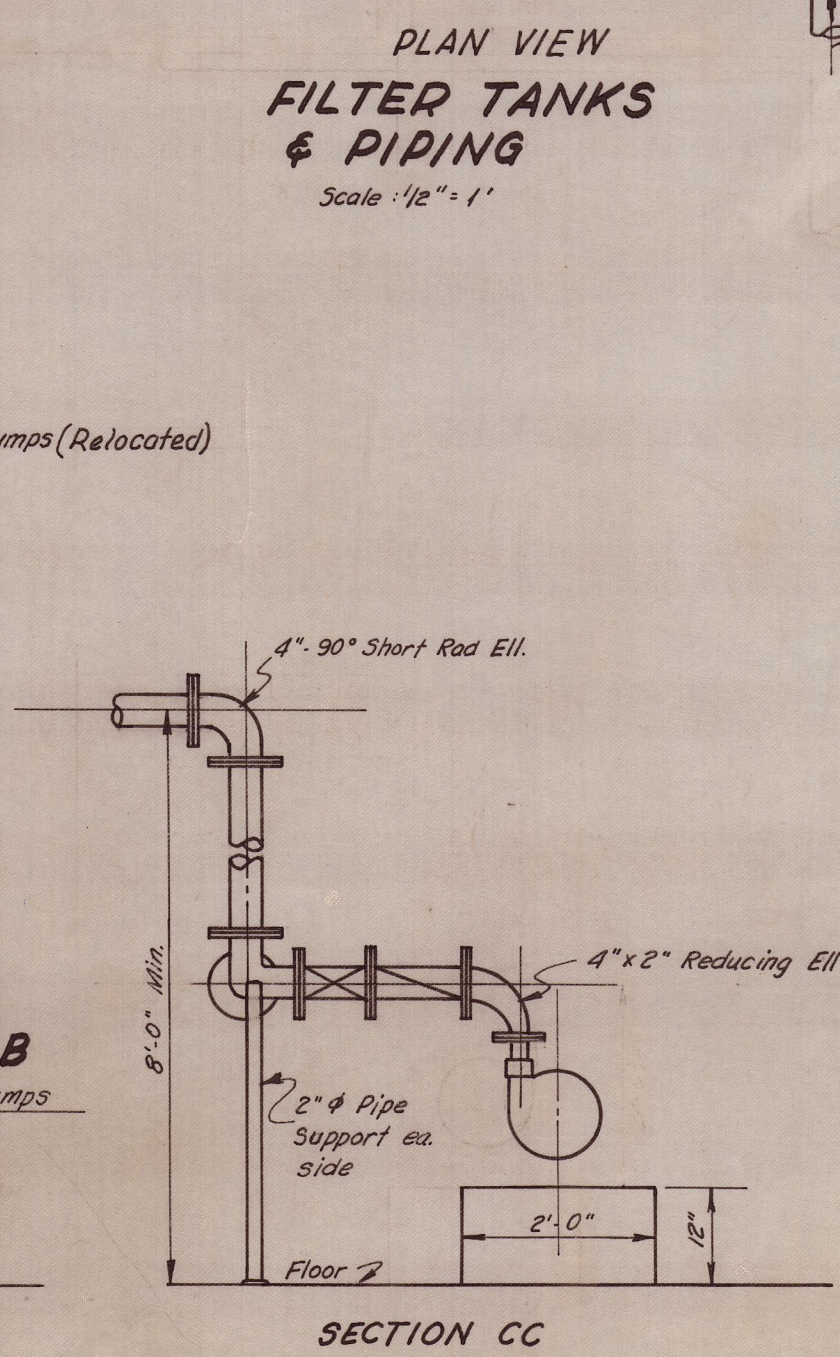

SECTION CC

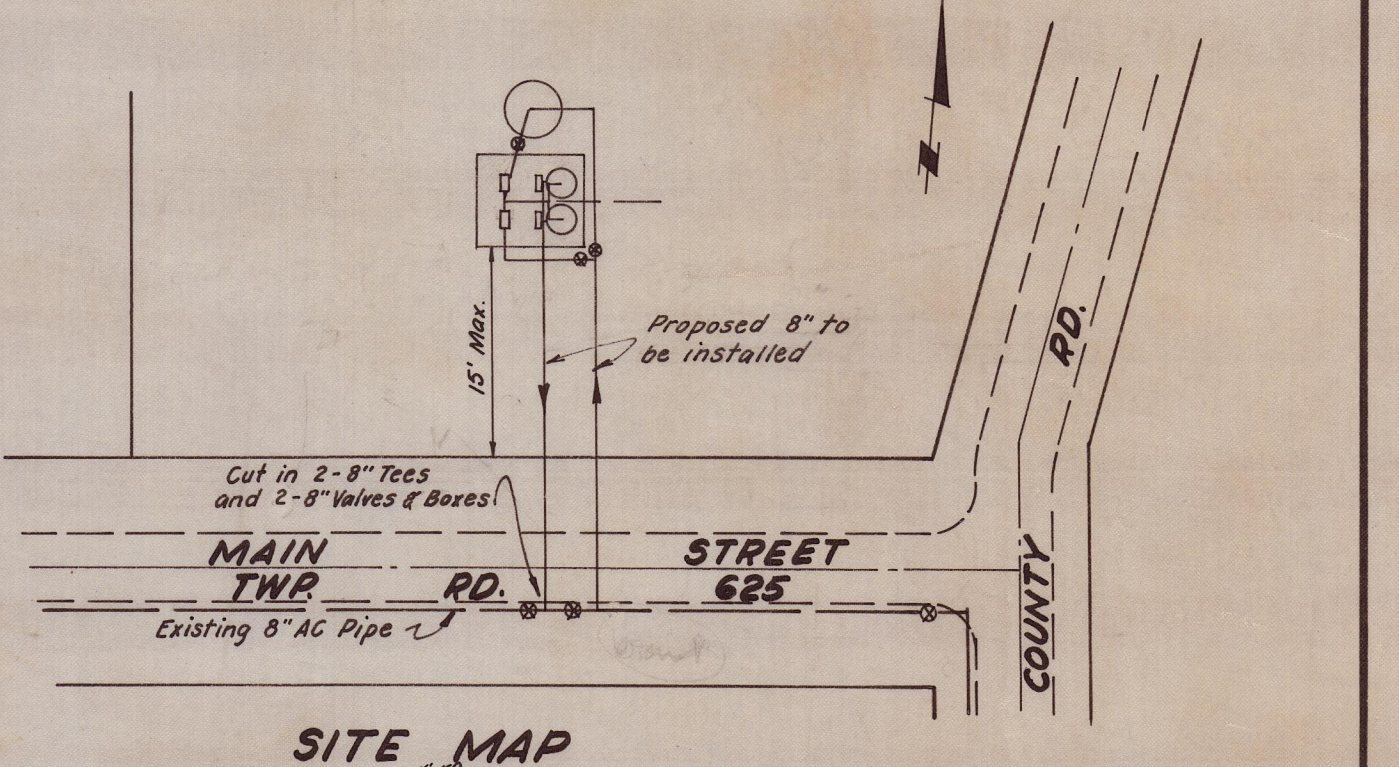

SITE MAP

SOUTH ZANESVILLE, OHIO WATER IMPROVEMENT RELOCATION OF IRON REMOVAL PLANT

SCALE: AS SHOWN MAY, 1964

THE JENNINGS-LAWRENCE CO.
CIVIL & MUNICIPAL ENGINEERS
COLUMBUS, OHIO

DWG NO
P-1067

Revised 27 January 1965

By *Will Walker*
Registered Engineer